

2010 CBC
STANDARD
SUSPENDED CEILING
DETAILS
FOR
ACOUSTICAL TILE OR
LAY-IN PANEL CEILINGS

Issue Date :	04/25/2013
Revision :	Date :

5/1/2013 12:16:56 AM

DRAWING INDEX

REVISIONS

CLX DRAWING INDEX, NARRATIVE AND FLOWCHART

- CLX.00 DRAWING INDEX - PAGE 1 OF 2
- CLX.01 DRAWING INDEX - PAGE 2 OF 2
- CLX.02 NARRATIVE - PAGE 1 OF 3
- CLX.03 NARRATIVE - PAGE 2 OF 3
- CLX.04 NARRATIVE - PAGE 3 OF 3
- CLX.05 FLOWCHART - OVERVIEW OF OPD USE
- CLX.06 FLOWCHART - CEILING GRID
- CLX.07 FLOWCHART - COMPRESSION STRUT AND OBSTRUCTIONS
- CLX.08 FLOWCHART - CONNECTIONS TO STRUCTURE

CL0 GENERAL NOTES

- CL0.00 GENERAL NOTES - PAGE 1 OF 4
- CL0.01 GENERAL NOTES - PAGE 2 OF 4
- CL0.02 GENERAL NOTES - PAGE 3 OF 4
- CL0.03 GENERAL NOTES - PAGE 4 OF 4

CL1 SUSPENDED CEILING FRAMING COMPONENTS

- CL1.1 POWER ACTUATED FASTENER (PAF) IN CONCRETE FILLED METAL DECK OR CONCRETE SLAB - PAGE 1 OF 2
- CL1.2 POWER ACTUATED FASTENER (PAF) IN CONCRETE FILLED METAL DECK OR CONCRETE SLAB - PAGE 2 OF 2
- CL1.3 POWER ACTUATED FASTENER (PAF) IN STEEL
- CL1.4a EXPANSION ANCHOR GENERAL NOTES
- CL1.4b EXPANSION ANCHOR ALLOWABLE STRENGTHS
- CL1.5 SHEET METAL SCREW GENERAL NOTES
- CL1.6 SHEET METAL SCREW ALLOWABLE STRENGTHS - PAGES 1 OF 2
- CL1.7 SHEET METAL SCREW ALLOWABLE STRENGTHS - PAGES 2 OF 2
- CL1.8 METAL STUD PROFILES

CL2 SUSPENDED CEILING BRACING ASSEMBLY

- CL2.1 SUSPENDED CEILING BRACING ASSEMBLY
- CL2.2a TYPICAL CEILING PLAN FOR $S_{DS} > 1.73$ AND $z/h \leq 1.0$
- CL2.2b TYPICAL CEILING PLAN FOR $1.15 < S_{DS} \leq 1.73$ AND $z/h \leq 1.0$
- CL2.2c TYPICAL CEILING PLAN FOR $S_{DS} \leq 1.15$ AND $z/h \leq 1.0$
- CL2.3 CORRIDOR CEILING PLAN
- CL2.4 EXPANSION JOINT AT INTERSECTIONS
- CL2.5 TYPICAL CEILING SECTION AT EXITWAYS
- CL2.6 CEILING PERIMETER NOT AT EXITWAYS
- CL2.7 CUBICLE CURTAIN/ I.V. TRACK
- CL2.8 LIGHT FIXTURE/ AIR TERMINAL SUPPORT DETAIL



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED -

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC

Issue Date : 04/25/2013

OPD No:

Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS

Revision : Date :

Sheet Title : DRAWING INDEX - PAGE 1 OF 2

CLX.00

5/1/2013 12:16:59 AM

DRAWING INDEX	REVISIONS
<p>CL3 COMPRESSION STRUT DETAILS</p> <p>CL3.1 CHANNEL TYPE COMPRESSION STRUT CL3.2 TUBE TYPE COMPRESSION STRUT</p> <p>CL4 HANGER AND BRACING WIRE CONNECTION DETAILS</p> <p>CL4.1 TYPICAL WIRE TURNS CL4.2 CONNECTION MATRIX CL4.3 CONNECTION TO CONCRETE FILLED METAL DECK CL4.4 CONNECTION TO CONCRETE FILLED METAL DECK AND STRUCTURAL CONCRETE CL4.5 CONNECTION TO CONCRETE SLAB, BEAM OR JOIST CL4.6 CONNECTION TO STRUCTURAL STEEL CL4.7 CONNECTION TO SAWN TIMBER CL4.8 CONNECTION TO METAL STUD WALL FRAMING - PAGE 1 OF 3 CL4.9 CONNECTION TO METAL STUD WALL FRAMING - PAGE 2 OF 3 CL4.10 CONNECTION TO METAL STUD WALL FRAMING - PAGE 3 OF 3</p> <p>CL5 COMPRESSION STRUT CONNECTION DETAILS</p> <p>CL5.1 CONNECTION MATRIX CL5.2 CONNECTION TO CONCRETE FILLED METAL DECK CL5.3 NOT USED CL5.4 CONNECTION TO CONCRETE SLAB, BEAM OR JOIST CL5.5 CONNECTION TO STRUCTURAL STEEL CL5.6 CONNECTION TO SAWN TIMBER WITH GYPSUM BOARD CL5.7 CONNECTION TO SAWN TIMBER WITHOUT GYPSUM BOARD</p> <p>CL6 SPECIAL DETAILS</p> <p>CL6.1 OBSTRUCTION - COUNTER SLOPING WIRES AND TRAPEZE CONDITION CL6.2 OBSTRUCTION - BRIDGE AT LARGE OFFSET CONDITION CL6.3 OBSTRUCTION - COUNTER SLOPING COMPRESSION STRUTS CL6.4 OBSTRUCTION - PERIMETER CONDITION CL6.5 OBSTRUCTION - RECESSED LIGHT AT PERIMETER CL6.6 OBSTRUCTION - STUD BRACE TO OVERHEAD CL6.7 OBSTRUCTION - STUD BRACE TO WALL</p>	



REVIEWED IN ACCORDANCE WITH
 THE REQUIREMENTS OF T24. CCR
 APPROVED .

Office of Statewide Health
 Planning & Development
 FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.01
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : DRAWING INDEX - PAGE 2 OF 2		

5/1/2013 12:23:34 AM

NARRATIVE

2010 California Building Code (2010 CBC) Standard Ceiling Details document contains OSHPD Pre-Approved Details (OPD), which may be incorporated into construction documents. These details have been reviewed for compliance with the 2010 CBC and, when used as shown, without modifications, are deemed to comply with code. They are intended to cover common conditions that occur on many projects. It is anticipated that use of these details will facilitate the design, review, and construction process.

The Narrative and supporting Flowchart, which follows the Narrative, are provided to assist in selecting applicable details from the OPD for incorporation into the construction documents. It is to be used only as a guide and does not provide complete step-by-step instructions for use of the OPD. Narrative comment numbers correspond to the numbered items on the Flowchart.

The following steps apply to use of OPD:

1. Define Project Parameters

- A. Short Period Spectral Response Acceleration (S_{DS}) for project site.
 - i. The (S_{DS}) identified for use with the OPD shall not be lower than the S_{DS} documented in the project General Notes and/or Specifications.
- B. Type of construction.
 - i. The Registered Design Professional (RDP) in responsible charge shall identify the floor and/or roof framing materials which apply to the use of the OPD under consideration (e.g. wood, concrete, metal deck).
- C. Project specific geometry and other conditions.
 - i. The RDP in responsible charge shall identify the geometry which applies to the use of the OPD under consideration (e.g. floor-to-ceiling height, etc).
 - ii. The RDP in responsible charge shall identify other unique conditions which apply to the use of the OPD under consideration (e.g. mechanical duct conflicts and other obstructions).

2. Verify Applicability of OPD

Refer to PIN 51.

OPD allow design professionals to incorporate pre-approved details into their construction documents. Projects that utilize OPD shall satisfy the following conditions.

- A. The RDP in responsible charge shall verify the applicability of the OPD for their specific project conditions. For example, when designing a fire-rated ceiling, use of ceiling details OPD are acceptable provided the OPD are compatible with the construction requirements for the fire rated assembly.
- B. The details must be directly applicable to the project conditions. For example, OPD for attachment of a ceiling below a steel deck with concrete fill are not applicable to wood frame construction.
- C. Substitutions of items shown in the OPD are not permitted, unless specifically allowed by the OPD. For example, a power-actuated fastener (PAF) may not be substituted in a connection detail that specifies an expansion anchor, unless the OPD specifically permits it. Use of post-installed anchors from different manufacturers is permitted, provided the substituted anchors meet the installation criteria and Allowable Strengths as specified in the OPD.
- D. Changes to the OPD to accommodate project conditions are not permitted. In such cases, project specific details are required.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.02
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : NARRATIVE - PAGE 1 OF 3		

3. Select Appropriate Details from OPD

Review OPD General Notes before the start of OPD selection process.

- A. The GENERAL NOTES section of this OPD document provides detailed specification of the materials and the workmanship associated with the details. The RDP in responsible charge shall confirm the applicability of the OPD details and the specifications noted in this section (CL0.00, CL0.01, CL0.02, CL0.03, CL0.04). Refer to CL2.1 to confirm general configuration requirements.
- B. Typical geometric conditions shall be verified from CL2.2X. Refer to Section 10 of the GENERAL NOTES for system component requirements.
- C. Ceiling boundary condition shall be provided in conformance with the requirements detailed on CL2.5 and CL2.6. Refer to Section 11 of the GENERAL NOTES for system installation requirements.
- D. Detailing requirements needed to comply with the requirements for both slip and fixed conditions in corridor ceilings are shown on CL2.3, CL2.4, CL2.5 and CL2.6. Refer to Section 12 of the GENERAL NOTES.
- E. CL2.7 and CL2.8 show the necessary detailing requirements for the support of Curtain Tracks, Air Terminals, and Light Fixtures suspended directly from the ceiling system. Refer to Section 15 of the GENERAL NOTES.
- F. Hanger and Bracing Wire specifications are shown in Section 9 of the GENERAL NOTES. CL4.1 graphically illustrates the requirements of the specifications at the terminal ends of the wire.
- G. Compression Strut requirements are detailed in CL3.X. Channel and Electrical Metallic Tubing (EMT) are the two types of Compression Struts that are included within the scope of this OPD. Refer to Section 13 of the GENERAL NOTES for system installation requirements.
 - 1. Channel Type Compression Strut details are shown on CL3.1.
 - 2. Electrical Metallic Tubing (EMT) Compression Strut details are shown on CL3.2.
- H. Requirements for detailing at obstructions between the ceiling and the support structure are illustrated in CL6.X. Different obstruction types require special detailing of Hanger Wires, Bracing Wires, and Compression Struts. Refer to Section 14 of the GENERAL NOTES for system installation requirements.
 - 1. Requirements for detailing at obstructions at Hanger and Bracing Wires are shown on CL6.1, CL6.2, CL6.4, CL6.6, CL6.7.
 - 2. Requirements for detailing at obstructions at Compression Struts are shown on CL6.2, CL6.3, CL6.5.
- I. Connection detail requirements for the connection of Hanger and Bracing Wire to support structure are illustrated in Details CL4.X. Detail requirements for attachment to various structural materials and systems are included in these details. Refer to Section 14 of the GENERAL NOTES for system installation requirements. Refer to Details CL1.X for fastener design capacities and component properties.
- J. Connection detail requirements for the connection of Compression Strut to support structure are illustrated in Details CL5.X. Detail requirements for attachment to various structural materials and systems are included in these details. Refer to Section 14 of the GENERAL NOTES for system installation requirements. Refer to Details CL1.X for fastener design capacities and component properties.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.03
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : NARRATIVE - PAGE 2 of 3		

4. Implementation and Use of OPD During Plan Review

Refer to PIN 51.

5. Implementation and Use of OPD During Construction Process

Refer to PIN 51.


- A. During construction, OPD are treated as any other detail in the approved documents.
- B. Pre-approved details submitted after the construction documents have been approved and a building permit has been issued shall be used and/or processed in accordance with Code Application Notice 2-107.4 "Amended Construction Documents." Pre-approved details may be applied as alternates to the approved details shown on the permitted construction documents only on a one for one basis and with written consent of the registered design professional and the registered design professional in responsible charge and in concurrence with OSHPD field staff. Pre-approved details will not be subject to additional plan review provided they are incorporated without any modification. Pre-approved details are subject to field confirmation during which the applicability of pre-approved details for specific project conditions shall be evaluated.
- C. Changing the scope of a project (adding additional ceilings, for example) does constitute a material alteration to the project, even if OPD can be used for all conditions. In such a case, an Amended Construction Document must be submitted to OSHPD field staff for review.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.04
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : NARRATIVE - PAGE 3 of 3		

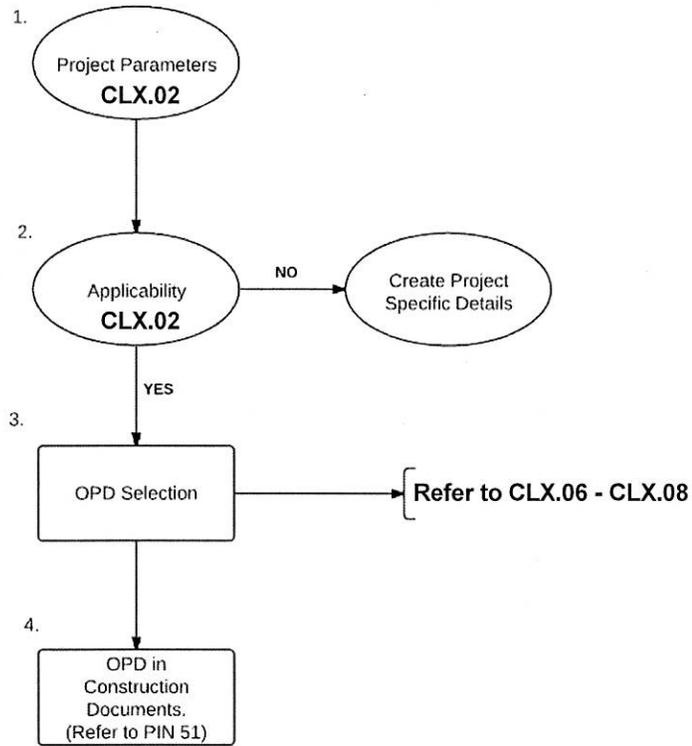


REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.05
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : FLOWCHART - OVERVIEW OF OPD USE		

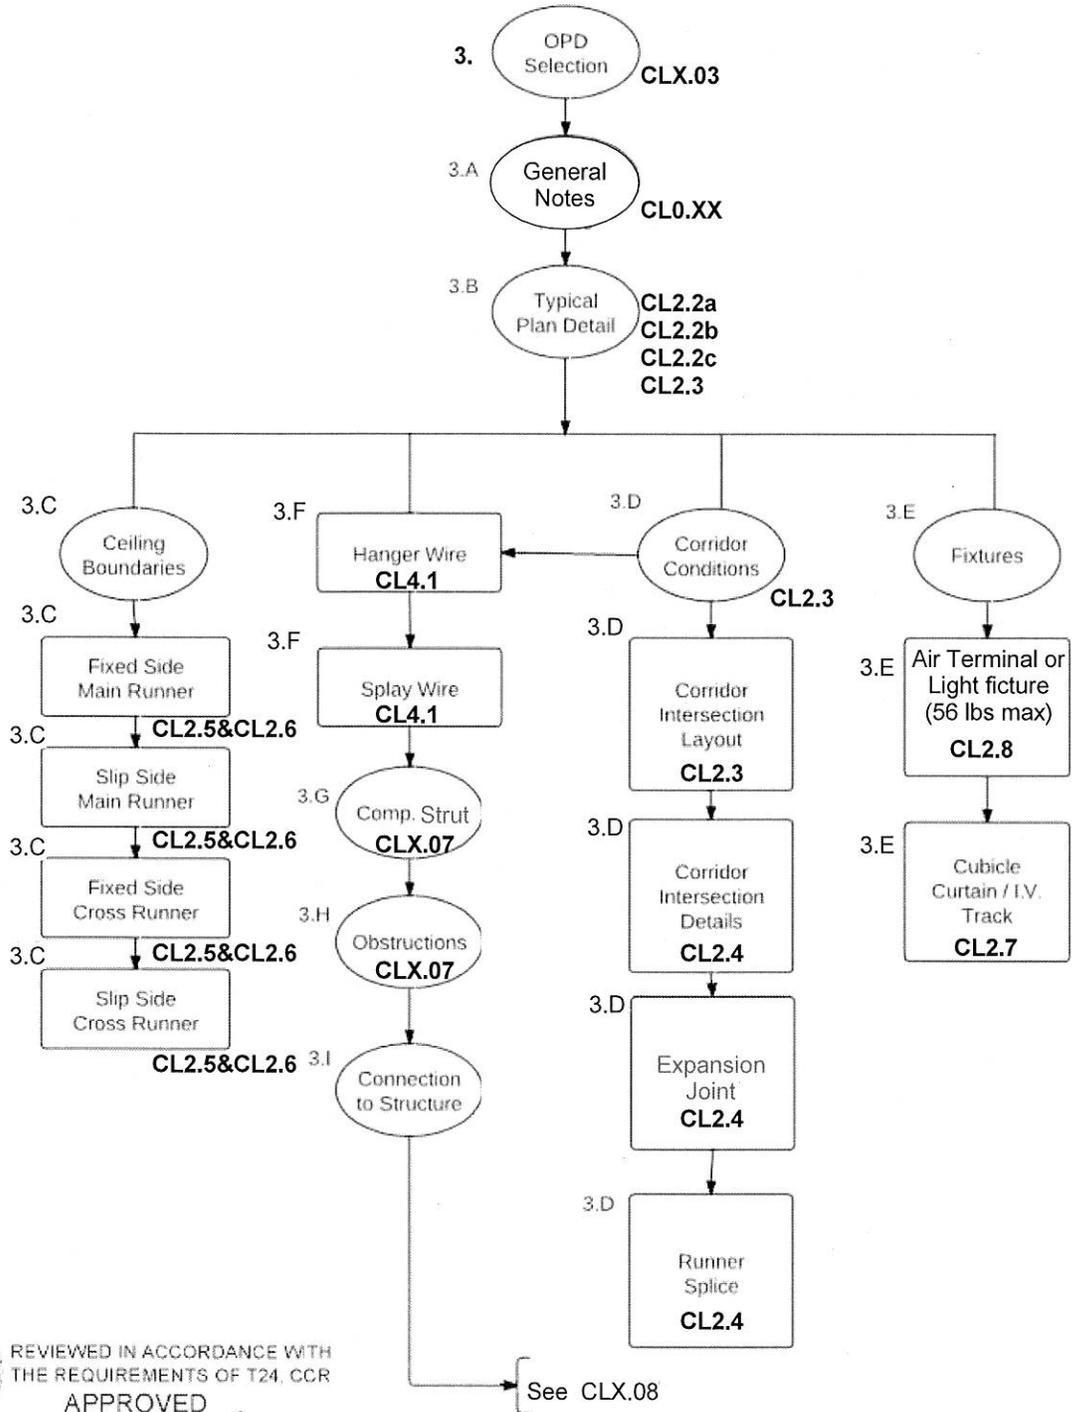


REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.06
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : FLOWCHART - CEILING GRID		

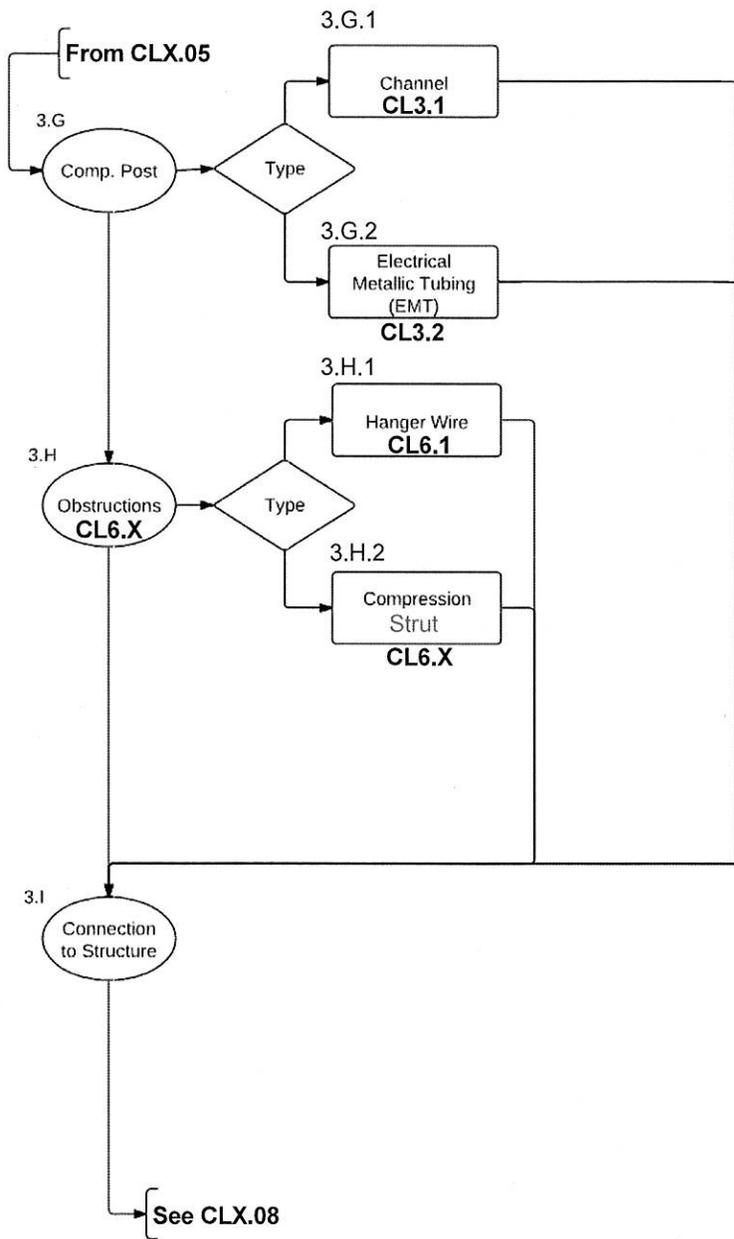


REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.07
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : FLOWCHART - COMPRESSION STRUT AND OBSTRUCTIONS		

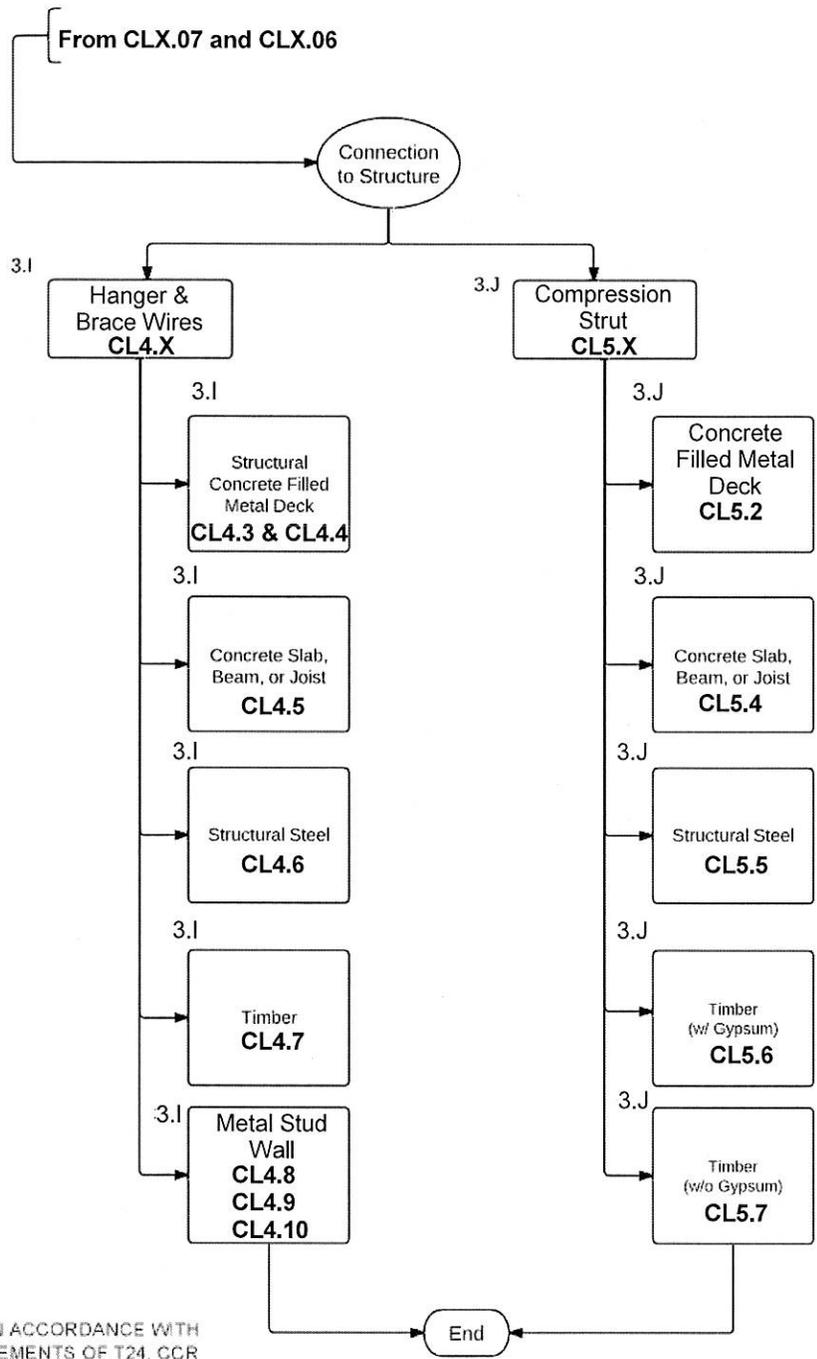

REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CLX.08
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : FLOWCHART - CONNECTIONS TO STRUCTURE		

5/1/2013 12:16:21 AM

GENERAL NOTES

1. CONSTRUCTION, WORKMANSHIP AND MATERIAL SHALL CONFORM TO THE 2010 CALIFORNIA BUILDING CODE (CBC 2010).
2. THE CONTRACTOR SHALL NOTIFY OSHPD AND THE REGISTERED DESIGN PROFESSIONAL (RDP) IN RESPONSIBLE CHARGE WHERE A CONFLICT OR DISCREPANCY OCCURS BETWEEN THE CONSTRUCTION DRAWINGS AND ANY OTHER PORTION OF THE CONSTRUCTION DOCUMENTS, FIELD CONDITIONS, OR WHERE ANY CONDITIONS ARISE NOT COVERED BY THESE DOCUMENTS WHEREIN WORK WILL NOT COMPLY WITH CODE REQUIREMENTS.
3. THE INTENT OF THE DRAWINGS AND SPECIFICATIONS IS TO CONSTRUCT THE HOSPITAL BUILDING IN ACCORDANCE WITH THE CALIFORNIA BUILDING STANDARD CODE,2010 (CBC 2010). SHOULD ANY CONDITION DEVELOP NOT COVERED BY THE APPROVED CONSTRUCTION DOCUMENTS WHEREIN THE WORK WILL NOT COMPLY WITH CBC 2010, A CHANGE ORDER DETAILING AND SPECIFYING THE REQUIRED WORK SHALL BE SUBMITTED TO AND APPROVED BY OSHPD BEFORE PROCEEDING WITH THE WORK.
4. GALVANIZED METAL STUDS, TRACKS AND SHEET STEEL SHALL CONFORM TO ASTM A653-09a MATERIAL, OR OTHER EQUIVALENT ASTM LISTED MATERIALS IN SECTION A2.1 OF THE AISI S100-07/S2-10; NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS WITH SUPPLEMENT 2, DATED 2010, WITH A MINIMUM YIELD STRENGTH OF 33 KSI FOR 43 MIL (18 GAGE) AND LIGHTER AND MINIMUM YIELD STRENGTH OF 50 KSI FOR HEAVIER GAGES.
5. METAL STUDS AND TRACKS SHALL BE OF SIZE, THICKNESS AND SECTION PROPERTIES SHOWN ON TABLES 1-1, 1-2 AND 1-3 OF THE AISI MANUAL, COLD-FORMED STEEL DESIGN, 2008 EDITION. THE RDP IN RESPONSIBLE CHARGE SHALL OBTAIN OSHPD APPROVAL FOR ANY SUBSTITUTIONS.
6. THESE OPD REFER TO FASTENER TYPE AND SIZE BUT DO NOT SPECIFY OR ENDORSE A SPECIFIC MANUFACTURER. THE RDP IN RESPONSIBLE CHARGE SHALL SELECT A MANUFACTURER AND SELECTED FASTENER CAPACITIES SHALL MATCH OR EXCEED THE STRENGTHS LISTED HEREIN. THE FOLLOWING REQUIREMENTS SHALL ALSO BE MET:
 - a. SHEET METAL SCREWS SHALL COMPLY WITH ASTM C 1513-10, ASME B18.6.4-98 (R2005) AND ICC-ES AC 118 AND ALLOWABLE STRENGTH SHALL BE BASED ON INFORMATION PROVIDED IN CL1.6 AND CL1.7. PENETRATION OF SCREWS THROUGH JOINED MATERIAL SHALL NOT BE LESS THAN THREE EXPOSED THREADS.
 - b. WELDING SHALL BE IN ACCORDANCE WITH AWS D1.3 USING E60XX SERIES ELECTRODES. FIELD WELDING SHALL HAVE SPECIAL INSPECTION IN ACCORDANCE WITH 2010 CBC SECTION 1704A.3.
 - c. POST- INSTALLED ANCHORS (E.G. EXPANSION ANCHORS, SCREW ANCHORS AND POWER ACTUATED FASTENERS) SHALL HAVE SPECIAL INSPECTION AND TESTING IN ACCORDANCE WITH THE 2010 CBC SECTIONS 1704A.4 & 1916A.7. FOR QUALIFICATION, DESIGN AND USE OF POST- INSTALLED ANCHORS IN CONCRETE SEE THE 2010 CBC SECTIONS 1615A.1.14, 1615A.1.15 AND 1911A1.1. LISTING OF CURRENT ICC-ES EVALUATION REPORTS (OR REPORTS FROM OTHER TESTING AGENCIES ACCEPTABLE TO OSHPD) SHALL BE REQUIRED FOR FASTENER USED.
 - d. POWER-ACTUATED FASTENERS (PAF), POWDER DRIVEN FASTENERS (PDF), POWER DRIVEN PINS (PDP) AND SHOT PINS ALL REPRESENT THE SAME FASTENER AND WILL HEREAFTER BE REFERRED TO AS POWER ACTUATED FASTENERS (PAF). PAF'S SHALL SATISFY THE CURRENT AC70-ACCEPTANCE CRITERIA FOR FASTENERS POWER-DRIVEN INTO CONCRETE, STEEL AND MASONRY ELEMENTS AND THE 2010 CBC SECTIONS 1615A.1.15 AND 1911A1.1. LISTING OF CURRENT ICC ES EVALUATION REPORTS (OR REPORTS FROM OTHER TESTING AGENCIES ACCEPTABLE TO OSHPD) SHALL BE REQUIRED FOR FASTENERS USED.
 - e. FOR PAF INSTALLED IN STEEL THE FASTENER PENETRATION SHALL HAVE THE ENTIRE POINTED END OF THE FASTENER DRIVEN THROUGH THE STEEL MEMBER, EXCEPT AS NOTED IN CURRENT REPORTS FROM TESTING AGENCIES ACCEPTABLE TO OSHPD.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL0.00
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : GENERAL NOTES - PAGE 1 OF 4		

5/1/2013 12:16:24 AM

7. DESIGN CRITERIA

- a. BUILDING CODE: 2010 CALIFORNIA BUILDING CODE (2010 CBC), ASCE 7-05, AISI S100-07/S2-10, ASTM E580-10a, C635-07, AND C636-08. THE REQUIREMENTS IN THIS OPD APPLY TO CEILING SYSTEMS WHOSE TOTAL WEIGHT, INCLUDING CEILING MOUNTED AIR TERMINALS, SERVICES AND LIGHT FIXTURES, DOES NOT EXCEED FOUR (4) PSF. HEAVY SYSTEMS, AND THOSE SUPPORTING LATERAL LOADS FROM PARTITIONS, WILL REQUIRE PROJECT SPECIFIC DESIGN DETAILS. FOR LOAD COMBINATIONS, ALLOWABLE STRESS DESIGN SHALL BE IN ACCORDANCE WITH 2010 CBC SECTION 1605A.3.1.
- b. FASTENER CAPACITIES TABLES WERE DEVELOPED BASED ON ICC REPORTS BY SEVERAL MANUFACTURERS.
- c. THE DESIGN ASSUMES THAT BUILDING ELEMENTS AND SUPPORTS, TO WHICH THE COMPONENTS ADDRESSED IN THIS DOCUMENT ARE ANCHORED, HAVE SUFFICIENT CAPACITY TO CARRY THE LOADS IMPOSED BY THE COMPONENTS IN COMBINATION WITH ALL OTHER LOADS. EVALUATION OF THE CAPACITY OF THESE SUPPORTING BUILDING ELEMENTS IS BEYOND THE SCOPE OF THE OPD.

8. THE RDP IN RESPONSIBLE CHARGE SHALL VERIFY THE FIRE RESISTENCE AND ACOUSTICAL RATINGS FOR ALL CEILING ASSEMBLIES.

9. "CEILING WIRE" SHALL CONFORM WITH GALVANIZED SOFT ANNEALED MILD STEEL WIRE AS DEFINED IN ASTM A641 (CLASS 1 COATING) WITH 70 KSI MINIMUM TENSILE STRENGTH:

- a. 4 TWISTS OF WIRE WITHIN 1.5" DEVELOPS THE ALLOWABLE LOAD FOR THE WIRE.
- b. 3 TWISTS WITHIN 3" MAY BE USED TO DEVELOP THE MAXIMUM 50% OF ALLOWABLE LOAD.

10. SUSPENSION SYSTEM COMPONENTS SHALL COMPLY WITH C635 AND E580 SECTION 5.1:

- a. THE CEILING GRID SYSTEM SHALL BE RATED HEAVY DUTY AS DEFINED BY ASTM C635.
- b. SUSPENSION WIRES SHALL BE #12 GAGE (0.106" DIAMETER), SOFT ANNEALED, AND GALVANIZED STEEL WIRES WITH CLASS 1 COATING. THEY MAY BE USED FOR UP TO AND INCLUDING 4'-0"x 4'-0" GRID SPACING ALONG AND ATTACHED TO MAIN RUNNERS. SPLICES ARE NOT PERMITTED IN ANY HANGER WIRE.
- c. MAIN RUNNERS, CROSS RUNNERS, SPLICES, EXPANSION DEVICES, INTERSECTION CONNECTORS SHALL BE DESIGNED TO CARRY A MEAN ULTIMATE TEST LOAD OF NOT LESS THAN 180 LBS. IN COMPRESSION & TENSION, IN ACCORDANCE WITH ASTM 580 SECTION 5.1.2.

11. SUSPENSION SYSTEM INSTALLATION, SHALL COMPLY WITH ASTM C636 AND E580 SECTION 5.2:

- a. PROVIDE #12 GAGE HANGER WIRES AT THE ENDS OF ALL MAIN AND CROSS RUNNERS WITHIN EIGHT (8) INCHES OF THE SUPPORT OR WITHIN ONE-FOURTH (1/4) OF THE LENGTH OF THE END TEE, WHICHEVER IS LESS. FOR THE PERIMETER OF THE CEILING AREA. PERIMETER WIRES ARE NOT REQUIRED WHEN THE LENGTH OF THE END TEE IS EIGHT (8) INCHES OR LESS.
- b. CEILING GRID MEMBERS SHALL BE ATTACHED TO TWO (2) ADJACENT WALLS, IN ACCORDANCE WITH ASTM E580 SECTION 5.2.3. CEILING GRID MEMBERS SHALL BE AT LEAST 3/4" INCH CLEAR OF OTHER WALLS. IF WALLS RUN DIAGONAL TO THE CEILING GRID SYSTEM RUNNERS, ONE END OF MAIN AND CROSS RUNNERS SHOULD BE FREE, AND A MINIMUM OF 3/4 INCH CLEAR OF WALL.
- c. THE WIDTH OF THE PERIMETER SUPPORTING CLOSURE ANGLE SHALL BE NOT LESS THAN 2 INCHES. USE OF ANGLES WITH SMALLER WIDTHS IN CONJUNCTION WITH PERIMETER CLIPS SHALL REQUIRE AN ALTERNATE METHOD OF COMPLIANCE WITH ADEQUATE JUSTIFICATION.
- d. AT THE PERIMETER OF THE CEILING AREA WHERE MAIN OR CROSS RUNNERS ARE NOT CONNECTED TO THE ADJACENT WALL, PROVIDE INTERCONNECTION BETWEEN THE RUNNERS AT THE FREE END TO PREVENT LATERAL SPREADING. A METAL STRUT OR A #16 GAGE WIRE WITH A POSITIVE MECHANICAL CONNECTION TO RUNNER MAY BE USED. WHERE THE PERPENDICULAR DISTANCE FROM THE WALL TO THE FIRST PARALLEL RUNNER IS 8 INCHES OR LESS, THIS INTERLOCK IS NOT REQUIRED.



REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL0.01
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : GENERAL NOTES - PAGE 2 OF 5		

12. EXPANSION JOINTS, SEISMIC SEPARATIONS, AND PENETRATIONS:

- a. EXPANSION JOINTS SHALL BE PROVIDED IN THE CEILING AT INTERSECTIONS OF CORRIDORS AND AT JUNCTIONS OF CORRIDORS WITH LOBBIES OR OTHER SIMILAR AREAS.
- b. FOR CEILING AREAS EXCEEDING 2500 SQUARE FEET, A SEISMIC SEPARATION JOINT SHALL BE PROVIDED TO DIVIDE THE CEILING INTO AREAS NOT EXCEEDING 2500 SQ. FT.
- c. PENETRATIONS THROUGH THE CEILING FOR SPRINKLER HEADS AND OTHER SIMILAR DEVICES THAT ARE NOT INTEGRALLY TIED TO THE CEILING SYSTEM IN THE LATERAL DIRECTION SHALL HAVE A TWO (2) INCH OVERSIZED RING, SLEEVE OR ADAPTER THROUGH THE CEILING TILE TO ALLOW FREE MOVEMENT OF ONE (1) INCH IN ALL HORIZONTAL DIRECTIONS. A FLEXIBLE SPRINKLER HOSE FITTING THAT CAN ACCOMMODATE 1 INCH OF CEILING MOVEMENT SHALL BE PERMITTED TO BE USED IN LIEU OF THE OVERSIZED RING, SLEEVE OR ADAPTER. SUCH FLEXIBLE SPRINKLER HOSE SHALL BE ADEQUATELY SUPPORTED FROM SOFFIT SO AS NOT TO EXCEED THE MAXIMUM TRIBUTARY WEIGHT OF THE CEILING.

13. LATERAL FORCE BRACING:

LATERAL FORCE BRACING IS REQUIRED PER THIS SECTION FOR ALL CEILING AREAS.

EXCEPTION: LATERAL FORCE BRACING MAY BE OMITTED FOR SUSPENDED ACOUSTICAL CEILING SYSTEMS WITH A CEILING AREA OF 144 SQ. FT. OR LESS, WHEN PERIMETER SUPPORT IN ACCORDANCE WITH ASTM E580 ARE PROVIDED AND PERIMETER WALLS ARE DESIGNED TO CARRY THE CEILING LATERAL FORCES.

- a. PROVIDE LATERAL-FORCE BRACING ASSEMBLIES CONSISTING OF A COMPRESSION STRUT AND FOUR (4) #12 GAGE BRACING WIRES ORIENTED 90 DEGREES FROM EACH OTHER.
- b. LATERAL-FORCE BRACING ASSEMBLIES SHALL BE SPACED IN ACCORDANCE WITH CL2.2 AND CL2.3 FROM EACH WALL AND AT THE EDGES OF ANY CHANGE OF ELEVATION OF THE CEILING.
- c. THE SLOPE OF BRACING WIRES MAY BE FROM 0 TO 45 DEGREES BUT MAY NOT EXCEED 45 DEGREES FROM THE PLANE OF THE CEILING AND WIRES SHALL BE TAUT.
- d. COMPRESSION STRUTS SHALL BE ADEQUATE TO RESIST THE VERTICAL COMPONENT INDUCED BY THE BRACING WIRES, AND SHALL NOT BE MORE THAN 1(HORIZONTAL) IN 6 (VERTICAL) OUT OF PLUMB.

14. ATTACHMENT OF HANGER AND BRACING WIRES:

- a. FASTEN #12 HANGER WIRES WITH NOT LESS THAN THREE (3) TIGHT TURN IN 3 INCHES. HANGERWIRE LOOPS SHALL BE TIGHTLY WRAPPED AND SHARPLY BENT TO PREVENT ANY VERTICAL MOVEMENT OR ROTATION OF THE MEMBER WITHIN THE LOOPS.
- b. FASTEN #12 BRACING WIRES WITH FOUR (4) TIGHT TURNS. MAKE ALL TIGHT TURNS WITHIN A DISTANCE OF 1 1/2" INCHES.
- c. HANGER OR BRACING WIRE ANCHORED TO THE STRUCTURE SHOULD BE INSTALLED IN SUCH A MANNER THAT THE DIRECTION OF THE ANCHOR ALIGNS AS CLOSELY AS POSSIBLE WITH THE DIRECTION OF THE WIRE.
- d. SEPARATE ALL CEILING HANGER AND BRACING WIRES AT LEAST SIX (6) INCHES FROM ALL UNBRACED DUCTS, PIPES CONDUITS, ETC.
- e. HANGER WIRES SHALL NOT BE ATTACHED TO OR BEND AROUND INTERFERING MATERIAL OR EQUIPMENT. PROVIDE TRAPEZE OR OTHER SUPPLEMENTARY SUPPORT MEMBERS AT OBSTRUCTIONS TO TYPICAL HANGER SPACING. PROVIDE ADDITIONAL HANGERS, STRUTS OR BRACES AS REQUIRED AT ALL CEILING BREAKS, SOFFITS, OR DISCONTINUOUS AREAS.
- f. HANGER WIRES THAT ARE MORE THAN 1 (HORIZONTAL) IN 6 (VERTICAL) OUT OF PLUMB SHALL HAVE COUNTER SLOPING WIRES. PERIMETER HANGER WIRES AT RUNNERS THAT ARE POSITIVELY ATTACHED TO THE PERIMETER CLOSURE ANGLE, COUNTER-SLOPING IS OPTIONAL.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL0.02
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : GENERAL NOTES - PAGE 3 OF 4		

5/1/2013 12:16:27 AM

- g. WHEN DRILLED-IN CONCRETE ANCHORS OR PAF ARE USED IN REINFORCED CONCRETE FOR HANGER WIRES 1 OUT OF 10 WIRE/ ANCHOR ASSEMBLIES SHALL BE FIELD TESTED FOR 200 LBS. IN TENSION. WHEN DRILLED-IN CONCRETE ANCHORS ARE USED FOR BRACING WIRES, 1 OUT OF 2 WIRE/ ANCHOR ASSEMBLIES SHALL BE FIELD TESTED FOR 440 LBS. IN TENSION IN THE DIRECTION OF THE WIRE. PAF IN CONCRETE ARE NOT PERMITTED FOR BRACING WIRES.

15. CEILING FIXTURES, TERMINALS, AND DEVICES:

- a. CEILING PANELS SHALL NOT SUPPORT ANY LIGHT FIXTURES, AIR TERMINALS OR DEVICES.
- b. ATTACH ALL LIGHT FIXTURES, CEILING MOUNTED AIR TERMINALS AND ALL OTHER DEVICES TO THE CEILING GRID RUNNERS TO RESIST A HORIZONTAL FORCE EQUAL TO THE WEIGHT OF THE FIXTURE. SCREWS OR APPROVED FASTENERS ARE REQUIRED. MINIMUM OF TWO ATTACHMENTS ARE REQUIRED AT EACH LIGHT FIXTURE.
- c. RECESSED OR DROP-IN LIGHT FIXTURE, GRILLES, MECHANICAL TERMINALS, AND FLEXIBLE SPRINKLER HOSE FITTINGS OR OTHER SERVICES, LESS THAN 56 LBS., SHALL BE SUPPORTED DIRECTLY ON RUNNERS CLASSIFIED AS ASTM HEAVY DUTY, BUT THEY MUST ALSO HAVE A MINIMUM OF TWO (2) #12 GAGE SLACK SAFETY WIRES ATTACHED TO THE FIXTURE AT DIAGONAL CORNERS AND ANCHORED TO THE STRUCTURE ABOVE.
- d. ALL FLUSH OR RECESSED LIGHT FIXTURES, MECHANICAL TERMINALS, AND FLEXIBLE SPRINKLER HOSE FITTINGS OR OTHER SERVICES WEIGHING 56 LBS. OR MORE SHALL BE INDEPENDENTLY SUPPORTED BY NOT LESS THAN FOUR (4) TAUT #12 GAGE WIRES ATTACHED TO THE HOUSING AND TO THE STRUCTURE ABOVE. THE FOUR (4) TAUT #12 GAGE WIRES, INCLUDING THEIR ATTACHMENT TO THE STRUCTURE ABOVE, SHALL BE CAPABLE OF SUPPORTING FOUR (4) TIMES THE WEIGHT OF THE UNIT.
- e. ALL 4 ft.x 4 ft. LIGHT FIXTURES SHALL HAVE SLACK SAFETY WIRES AT EACH CORNER.
- f. SURFACE-MOUNTED FIXTURES SHALL BE ATTACHED TO THE MAIN RUNNER WITH AT LEAST TWO POSITIVE CLAMPING DEVICES MADE OF MATERIAL WITH A MINIMUM #14 GAGE. ROTATIONAL SPRING CATCHES DO NOT COMPLY. A #12 GAGE SUSPENSION WIRE SHALL BE ATTACHED TO EACH CLAMPING DEVICE TO THE STRUCTURE ABOVE. PROVIDE ADDITIONAL SUPPORTS WHEN LIGHT FIXTURES ARE 8 ft. OR LONGER. MAXIMUM SPACING BETWEEN SUPPORTS SHALL NOT EXCEED 8 FEET.
- g. SUPPORT PENDANT-MOUNTED LIGHT FIXTURES DIRECTLY FROM THE STRUCTURE ABOVE WITH THE HANGER WIRES OR CABLES PASSING THROUGH EACH PENDANT HANGER AND CAPABLE OF SUPPORTING TWO (2) TIMES THE WEIGHT OF THE FIXTURE. A BRACING ASSEMBLY IN ACCORDANCE WITH CL2.1 IS REQUIRED IF THE PENDANT HANGER PENETRATES THE FEILD OF THE CEILING TILE. SPECIAL DETAILS ARE REQUIRED TO ATTACH THE PENDANT HANGER TO THE BRACING ASSEMBLY TO TRANSMIT HORIZONTAL FORCE. IF THE PENDANT MOUNTED LIGHT FIXTURE IS DIRECTLY AND INDEPENDANTLY BRACED BELOW THE CEILING (E.G., AIR CRAFT CABLE TO WALLS) THEN THE BRACING ASSEMBLY IS NOT REQUIRED ABOVE THE CEILING.
- h. ALL LIGHTWEIGHT MISCELLANEOUS DEVICES, SUCH AS STROBE LIGHTS, SPEAKERS, EXIT SIGNS, ETC., SHALL BE ATTACHED TO THE CEILING GRID AS SPECIFIED ABOVE. IN ADDITION, DEVICES MORE THAN 10 LBS. SHALL HAVE A #12 SLACK SAFETY WIRE ANCHORED TO THE STRUCTURE ABOVE. DEVICES WEIGHING MORE THAN 20 LBS. SHALL BE SUPPORTED FROM THE STRUCTURE ABOVE PER NOTE 15.C IN CL0.03.

16. ADDITIONAL REQUIREMENTS:

- a. FIRE RATED CEILINGS: PROVIDE A DETAIL AND DESIGN NUMBER FOR RATED CEILING ASSEMBLIES FROM AN APPROVED TESTING AGENCY. THE COMPONENTS AND INSTALLATION DETAILS CONFORM IN EVERY RESPECT WITH THE LISTED DETAIL AND NUMBER. DETAILS SHALL CLEARLY DEPICT ALL COMPONENTS, INCLUDING INSULATION MATERIALS, FRAMING AND ATTACHMENT OF THE DESIGN SO THAT THE ASSEMBLY CAN BE CONSTRUCTED AND INSPECTED ACCORDINGLY. POP RIVETS, SCREWS, OR OTHER ATTACHMENTS ARE NOT ACCEPTABLE UNLESS SPECIFICALLY DETAILED ON THE DRAWINGS AND APPROVED BY APPROVED TESTING AGENCY.
- b. METAL AND OTHER PANELS: METAL PANELS AND PANELS WEIGHING MORE THAN 1/2 PSF, OTHER THAN MINERAL FIBER ACOUSTICAL TILE, ARE TO BE POSITIVELY ATTACHED TO THE CEILING SUSPENSION RUNNERS.
- c. BUILDING EXIT WAYS: CEILINGS IN EXIT WAYS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 13.5.6.2.2(1) OF ASCE 7-05 AS AMENDED BY 2010 CBC SECTION 1615A.1.16. SPLICES OR INTERSECTION OF SUCH RUNNERS SHALL BE ATTACHED WITH THROUGH CONNECTORS SUCH AS POP RIVETS, SCREWS, PINS, PLATES WITH END TABS OR OTHER APPROVED CONNECTORS.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED


[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL0.03
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : GENERAL NOTES - PAGE 4 OF 4		

POWER ACTUATED FASTENER (PAF) GENERAL NOTES (INSTALLED IN CONCRETE FILLED METAL DECK OR CONC SLAB)

1. POWER ACTUATED FASTENER (PAF), POWDER DRIVEN FASTENERS (PDF), POWER DRIVEN PINS (PDP), SHOT PINS ALL REPRESENT THE SAME FASTENER AND WILL HEREAFTER BE REFERRED TO AS POWER ACTUATED FASTENERS (PAF).
2. ALLOWABLE STRENGTHS SHALL BE COMPARED TO ALLOWABLE STRESS DESIGN (ASD) LEVEL DEMAND IN ACCORDANCE WITH THE 2010 CBC SECTION 1605A.3.1.
3. ALLOWABLE STRENGTHS ARE FOR A SINGLE FASTENER WHICH MEET REQUIREMENTS PER SECTION BELOW AND TABLES ON CL1.2. THE ALLOWABLE STRENGTHS ARE BASED UPON THE LEAST OF THE ALLOWABLE STRENGTHS LISTED IN THE ICC ESRs 2269 & 1799.
4. MINIMUM CONCRETE STRENGTH $f'_c=2000$ PSI FOR NORMAL WEIGHT CONCRETE AND $f'_c=3000$ PSI FOR ALL LIGHT WEIGHT CONCRETE UNLESS NOTED OTHERWISE.
5. POWER ACTUATED FASTENER INSTALLED THROUGH LOW FLUTES OF THE METAL DECK SHALL MEET THE REQUIREMENTS OF THE INSTALLATION CRITERIA AND SECTION BELOW.
6. MINIMUM EDGE DISTANCE OF $1 \frac{1}{8}$ " FROM THE EDGE OF METAL DECK WEB AND 4" FROM THE EDGE OF THE DECK.
7. STEEL DECK TO BE A MINIMUM OF 20GA.
8. CONCRETE FILL DEPTH ABOVE THE TOP OF METAL DECK MUST BE A MINIMUM OF $3 \frac{1}{4}$ " AT LIGHT WEIGHT CONCRETE COMPOSITE METAL DECK.
9. PAF SHALL NOT BE USED TO RESIST SEISMIC SHEAR FORCES EXCEPT AT INTERIOR NON-LOAD BEARING, NON-SHEAR WALL PARTITION WALLS (AS PERMITTED BY 2010 CBC SECTION 1911A.1.1) AND COMPONENTS EXEMPT FROM CONSTRUCTION DOCUMENT REVIEW BY 2010 CBC SECTION 1615A.1.12 (NOT PERMITTED TO TAKE SEISMIC SHEAR BY ICC-ES AC70 FOR ANY OTHER CONDITIONS). PAF SHALL NOT BE USED TO CARRY SEISMIC TENSION LOADS (EXCEPT FOR VERTICAL SEISMIC LOAD PRODUCED BY SELF WEIGHT OF THE COMPONENTS) OR IN CRACKED CONCRETE UNLESS APPROVED FOR SUCH LOADING BY OSHPD.
10. PAF SHALL NOT BE USED IN PRE-STRESSED CONCRETE UNLESS NON-DESTRUCTIVE TESTING METHODS ARE USED TO LOCATE STRAND AND REINFORCEMENT PRIOR TO FASTENER INSTALLATION.
11. PAF INSTALLATION SHALL NOT NICK OR DAMAGE EXISTING CONCRETE REINFORCEMENT. SHOULD THIS OCCUR THE RDP IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY. PAF SHALL BE INSTALLED 1" CLEAR OF EXISTING REINFORCEMENT. THIS MAY REQUIRE NON-DESTRUCTIVE TESTING.
12. PAF SHALL BE INSTALLED PER CURRENT ICC-ES EVALUATION REPORTS (OR REPORTS FROM OTHER TESTING AGENCIES ACCEPTABLE TO OSHPD).
13. TESTING OF PAF SHALL BE PER 2010 CBC SECTION 1916A.7. MINIMUM CONCRETE SUBSTRATE THICKNESS IS THREE TIMES THE PAF PENETRATION INTO THE CONCRETE SUBSTRATE.
14. TESTING IS NOT REQUIRED OF PAF USED TO ATTACHED TRACKS OF INTERIOR NON-SHEAR WALL PARTITIONS FOR SHEAR ONLY WHERE THERE ARE AT LEAST THREE FASTENERS.
15. TOTAL ALLOWABLE LOADS IN TENSION, SHEAR OR TENSION SHEAR COMBINATIONS SHALL NOT EXCEED 90 LB AS PERMITTED BY EXCEPTION TO THE 2010 CBC SECTION 1615A.1.15.
16. REFER TO NOTE 6d ON CL0.00 FOR ADDITIONAL PAF REQUIREMENTS.

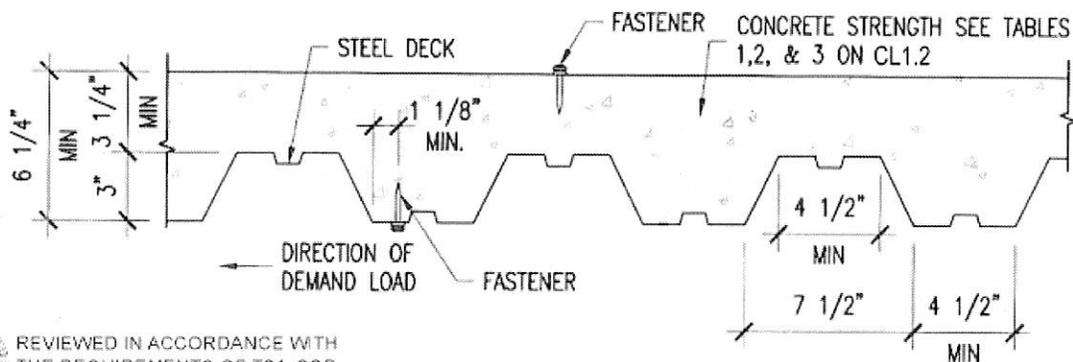

REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

SECTION - COMPOSITE DECK

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.1
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : POWER ACTUATED FASTENER (PAF) IN CONCRETE FILLED METAL DECK OR CONCRETE SLAB - PAGE 1 OF 2		

5/1/2013 12:16:30 AM

POWER ACTUATED FASTENER (PAF) ALLOWABLE STRENGTHS (INSTALLED IN CONCRETE FILLED METAL DECK OR CONC SLAB)

TABLE 1
POWER ACTUATED FASTENER INSTALLED IN SAND-LIGHTWEIGHT CONCRETE THROUGH METAL DECK (f'_c MIN=3000 PSI)

NOMINAL SHANK DIAMETER (IN)	MIN. EMBED (IN)	MIN. SPACING (IN)	MIN. EDGE DISTANCE (IN)	TENSION (LB) (SEE NOTE 15)	SHEAR (LB) (SEE NOTE 15)
0.145 MIN	1 1/4	4	4	90	90

TABLE 2
POWER ACTUATED FASTENER INSTALLED INTO STRUCTURAL SAND-LIGHTWEIGHT CONCRETE (f'_c MIN=3000 PSI)

NOMINAL SHANK DIAMETER (IN)	MIN. EMBED (IN)	MIN. SPACING (IN)	MIN. EDGE DISTANCE (IN)	TENSION (LB) (SEE NOTE 15)	SHEAR (LB) (SEE NOTE 15)
0.145 MIN	1 1/4	4	4	90	90

TABLE 3
POWER ACTUATED FASTENER INSTALLED INTO NORMAL-WEIGHT CONCRETE (f'_c MIN=2000 PSI)

NOMINAL SHANK DIAMETER (IN)	MIN. EMBED (IN)	MIN. SPACING (IN)	MIN. EDGE DISTANCE (IN)	TENSION (LB) (SEE NOTE 15)	SHEAR (LB) (SEE NOTE 15)
0.145 MIN	1 1/4	5.1	4	90	90



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.2
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : POWER ACTUATED FASTENER (PAF) IN CONCRETE FILLED METAL DECK OR CONCRETE SLAB - PAGE 2 OF 2		

POWER ACTUATED FASTENER (PAF) GENERAL NOTES (INSTALLED IN STEEL)

1. MINIMUM STEEL TENSILE STRENGTH $F_u=58$ KSI.
2. MINIMUM SPACING 1 INCH.
3. MINIMUM EDGE DISTANCE 1/2 INCH.
4. USE KNURLED SHANK.
5. POWER ACTUATED FASTENERS (PAF) SHALL BE INSTALLED PER CURRENT ICC-ESS EVALUATION REPORTS OR REPORTS FROM OTHER TESTING AGENCIES ACCEPTABLE TO OSHPD
6. SEE GENERAL NOTE 6d & 6e ON CL0.00 FOR PAF REQUIREMENTS & ATTACHMENT TO STEEL.
7. POWER ACTUATED FASTENER (PAF), POWDER DRIVEN FASTENERS (PDF), POWER DRIVEN PINS (PDP), SHOT PINS, ARE COMMON NOMINCLATURES THAT ALL REPRESENT THE SAME FASTENER DESCRIBED HERE IN.
8. ALLOWABLE STRENGTHS SHALL BE COMPARED TO ALLOWABLE STRESS DESIGN (ASD) LEVEL DEMAND IN ACCORDANCE WITH THE 2010 CBC SECTION 1605A.3.1.
9. ALLOWABLE STRENGTHS ARE FOR SINGLE FASTENERS, WHICH MEET THE REQUIREMENTS PER NOTES ABOVE. THE ALLOWABLE STRENGTHS ARE BASED UPON THE LEAST OF THE ALLOWABLE STRENGTHS LISTED IN THE ICC ESR5 2269, 1799 & 2138.
10. TOTAL ALLOWABLE TENSION, SHEAR OR TENSION SHEAR COMBINATION SHALL NOT EXCEED 250 LBS. AS REQUIRED BY THE 2010 CBC.

POWER ACTUATED FASTENER (PAF) ALLOWABLE STRENGTHS (INSTALLED IN STEEL)

NOMINAL SHANK DIAMETER (IN)	STEEL THICKNESS (IN)							
	3/16		1/4		3/8		1/2	
	TENSION (LB)	SHEAR (LB)	TENSION (LB)	SHEAR (LB)	TENSION (LB)	SHEAR (LB)	TENSION (LB)	SHEAR (LB)
0.145 MIN	155	250	230	250	250	250	190	220



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED


[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.3
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : POWER ACTUATED FASTENER (PAF) IN STEEL		

EXPANSION ANCHOR GENERAL NOTES

1. ALLOWABLE STRENGTHS SHALL BE COMPARED TO ALLOWABLE STRESS DESIGN (ASD) LEVEL DEMAND IN ACCORDANCE WITH THE 2010 CBC SECTION 1605A.3.1.
2. ALLOWABLE STRENGTHS ARE FOR SINGLE ANCHORS WHICH MEET MIN. REQUIREMENTS PER TABLE & SECTION BELOW.
3. MINIMUM CONCRETE STRENGTH $f'_c=3000$ PSI.
4. EXPANSION ANCHORS INSTALLED THROUGH UPPER OR LOWER FLUTES OF METAL DECK SHALL MEET THE REQUIREMENTS OF THE INSTALLATION CRITERIA AND SECTION BELOW.
5. STEEL DECK TO BE MIN. 20 GA. W-DECK.
6. MINIMUM CONCRETE FILL DEPTH ABOVE THE TOP OF METAL DECK PER SECTION AND INSTALLATION CRITERIA BELOW.
7. EXPANSION ANCHORS SHALL NOT BE USED IN PRE-STRESSED CONCRETE UNLESS NON-DESTRUCTIVE TESTING METHODS ARE USED TO LOCATE STRAND & REINFORCING PRIOR TO ANCHOR INSTALLATION.
8. EXPANSION ANCHOR INSTALLATION SHALL NOT NICK OR DAMAGE EXISTING REINFORCEMENT. SHOULD THIS OCCUR THE RDP IN RESPONSIBLE CHARGE SHALL BE NOTIFIED IMMEDIATELY. EXPANSION ANCHORS SHALL BE INSTALLED 1" CLEAR OF EXISTING REINFORCEMENT.
9. EXPANSION ANCHORS SHALL BE INSTALLED PER CURRENT ICC-ES EVALUATION REPORT OR REPORT FROM OTHER TESTING AGENCY ACCEPTABLE TO OSHPD.
10. TESTING OF EXPANSION ANCHORS SHALL BE PER 2010 CBC SECTION 1916A.7.
11. EXPANSION ANCHORS SHALL BE INSTALLED TO COMPLY W/ THE MINIMUM SLAB THICKNESS REQUIREMENTS ESTABLISHED BY THE ICC-ESR FOR THE SPECIFIED ANCHOR.
12. REFER TO NOTE 6c ON CL0.00 FOR ADDITIONAL EXPANSION ANCHOR REQUIREMENTS.
13. ALL VALUES IN TABLES ARE FOR CRACKED CONCRETE & INCLUDE 0.75 REDUCTION BASED ON ACI 318-08 D3.3.3 REQUIREMENTS. THE ALLOWABLE STRENGTHS ARE BASED UPON THE LEAST OF THE ALLOWABLE STRENGTHS CALCULATED USING THE ICC ESRs 1917, 2427 & 3037 AND USING AN α FACTOR OF 1.4.

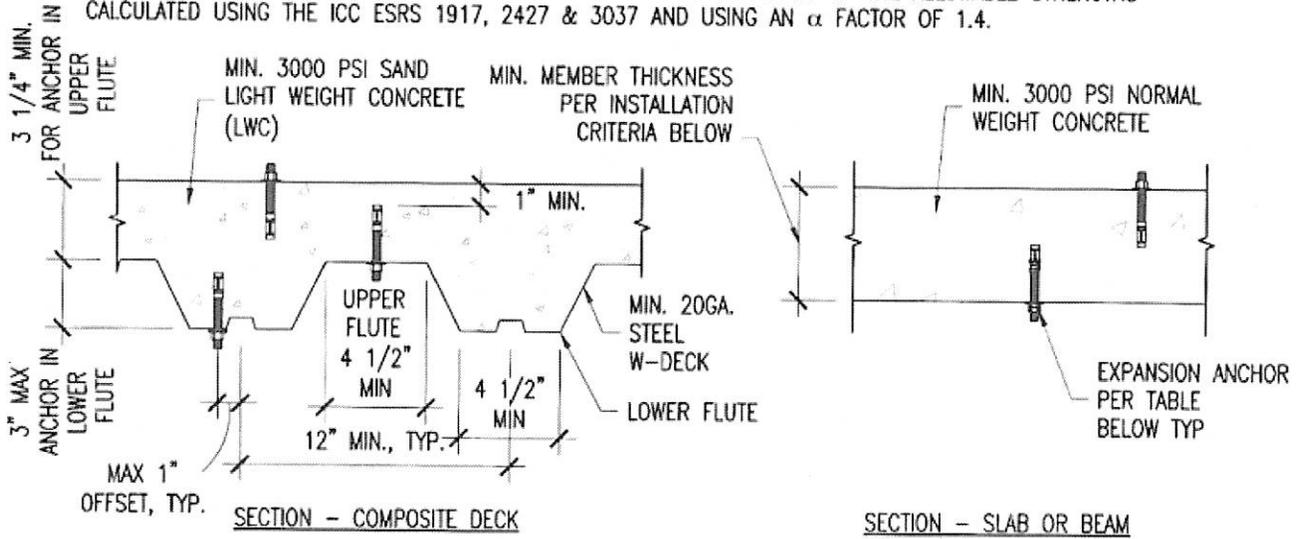

EXPANSION ANCHORS INSTALLATION CRITERIA

	NOMINAL ANCHOR DIAMETER (IN)				
	3/8	1/2	5/8	1	1 1/8
EFFECTIVE MIN. EMBEDMENT (IN)	2	2 1/4	3 1/4	3 1/8	4
MIN. MEMBER THICKNESS NWC SLAB OR BEAM ONLY (IN)	4.5	4.5	6	6	7 1/4
MIN. ANCHOR SPACING (3 x EMBED) (IN)	6 3/4	6 3/4	9 3/4	9 3/8	12
MIN. EDGE DISTANCE (IN)	6	7	7 1/2	6 1/2	8 3/4



REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24 CCR APPROVED

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC

Issue Date : 04/25/2013

OPD No:

Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS

Revision : Date :

Sheet Title : EXPANSION ANCHOR GENERAL NOTES

CL1.4a

EXPANSION ANCHOR ALLOWABLE STRENGTHS

TABLE 1

EXPANSION ANCHORS INSTALLED IN TO THE UNDERSIDE OF STRUCTURAL SAND-LIGHTWEIGHT CONCRETE (f'c MIN=3000 PSI) OVER METAL DECK

ANCHOR DIA. (IN)	EMBED (IN)	SHEAR (LB)	TENSION (LB)
3/8	2	467	508
1/2	2 1/4	643	508
1/2	3 1/4	1108	912
5/8	3 1/8	845	696
5/8	4	1919	1617

TABLE 2

EXPANSION ANCHORS INSTALLED IN TO THE TOP OF STRUCTURAL SAND-LIGHTWEIGHT CONCRETE (f'c MIN=3000 PSI) OVER METAL DECK

ANCHOR DIA. (IN)	EMBED (IN)	SHEAR (LB)	TENSION (LB)
3/8	2	593	520
1/2	2 1/4	593	550

TABLE 3

EXPANSION ANCHORS INSTALLED IN NORMAL WEIGHT CONCRETE (f'c MIN=3000 PSI)

ANCHOR DIA. (IN)	EMBED (IN)	SHEAR (LB)	TENSION (LB)
3/8	2	638	866
1/2	2 1/4	987	917
1/2	3 1/4	2046	1875
5/8	3 1/8	1887	1719
5/8	4	2793	2561



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.4b
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : EXPANSION ANCHOR ALLOWABLE STRENGTHS		

5/1/2013 12:16:36 AM

SHEET METAL SCREW (SMS) GENERAL NOTES

1. THE ALLOWABLE STRENGTHS ARE BASED UPON THE AISI S100-07/S2-10 AND ARE LIMITED BY ACTUAL TESTED STRENGTH OF THE SCREWS IN TENSION AND SHEAR.
2. THE ALLOWABLE STRENGTHS ARE BASED UPON THE LEAST OF THE AVERAGE TESTED TENSILE AND SHEAR STRENGTHS TABULATED FROM ICC ESR'S 1976, 2196, 1730, 1408, AND THE STEEL STUD MANUFACTURER'S ASSOCIATION (SSMA). FASTENER TYPES AND SIZES APPLY TO NON-PROPRIETARY FASTENER TYPES AND SIZES, AND DOES NOT ENDORSE A SPECIFIC MANUFACTURER. WHERE PROPRIETARY FASTENERS ARE SPECIFIED, NO EXCEPTIONS ARE TAKEN TO THE USE OF MANUFACTURER SPECIFIC VALUES THAT ARE BASED UPON THE AISI S100-07/S2-10, SECTION E4. ALL SCREW FASTENERS SHALL SATISFY ICC-ES AC118-ACCEPTANCE CRITERIA FOR SELF TAPPING SCREW FASTENERS.
3. TABLE 1 REPRESENTS ALLOWABLE TENSION AND SHEAR STRENGTHS FOR NON-PROPRIETARY SHEET METAL SCREWS FOR STEEL TO STEEL CONNECTIONS.
4. TABLE 2 AND 3 REPRESENT ALLOWABLE TENSION AND SHEAR STRENGTHS THAT INCORPORATE THE EFFECTS OF EITHER ONE OR TWO LAYERS OF 5/8" GYPSUM BOARD BETWEEN FASTENER HEAD AND CONNECTING STEEL MATERIAL.
5. IN ORDER TO USE THE VALUES IN TABLES 1, 2, AND 3, THE ATTACHMENTS SHALL BE DETAILED IN SUCH A WAY AS TO AVOID PRYING AND THE STUDS MUST BE STABILIZED WITH FULL-DEPTH BLOCKING WITH CONTINUOUS STRAPS ALONG THE FLANGES OR WITH BACKING BARS.
6. PENETRATION OF SCREWS THROUGH JOINED MATERIAL SHOULD NOT BE LESS THAN 3 EXPOSED THREADS.
7. STEEL THICKNESSES JOINED ARE ASSUMED TO BE THE SAME. IF DISSIMILAR THICKNESSES ARE BEING CONNECTED, THE VALUE FOR THE THINNER PART JOINED SHALL BE USED.
8. THE MINIMUM SPACING BETWEEN CENTERS OF FASTENERS SHALL NOT BE LESS THAN 3 X FASTENER DIAMETER. THE MINIMUM EDGE DISTANCE FROM THE CENTER OF A FASTENER TO THE EDGE OF ANY PART SHALL NOT BE LESS THAN 1.5 X FASTENER DIAMETER. WHERE THE END DISTANCE IS PARALLEL TO THE FORCE ON THE FASTENER, THE NOMINAL SHEAR STRENGTH SHALL BE LIMITED BY SECTION E4.3.2 OF THE AISI S100-07/S2-10.
9. GALVANIZED METAL STUDS, TRACK AND SHEET STEEL SHALL CONFORM TO ASTM A653 MATERIAL (OR OTHER EQUIVALENT ASTM LISTED MATERIALS IN THE AISI S100-07/S2-10, SECTION A2.1) WITH A MINIMUM YIELD STRENGTH OF 33 KSI FOR 43 MIL (18 GA) AND LIGHTER, AND MINIMUM YIELD STRENGTH OF 50 KSI FOR 54 MIL (16 GA) & HEAVIER.
10. WHERE VALUES ARE NOT GIVEN, SUCH COMBINATIONS OF SCREW SIZES & MATERIAL THICKNESS ARE NOT RECOMMENDED.
11. IF THE ATTACHMENT DETAILS RESULT IN PRYING WITH A MOMENT ARM NOT TO EXCEED 1 5/8", THE VALUES IN TABLE 4 MAY BE USED. IF THE ATTACHMENT DETAILS RESULT IN PRYING WITH A MOMENT ARM THAT EXCEEDS 1 5/8", THE REREGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE OF THE PROJECT SHALL DETERMINE THE ALLOWABLE VALUES AND SUBMIT SUBSTANTIATION FOR THEM TO OSHPD FOR REVIEW.
12. INTERACTION OF SHEAR AND TENSION SHALL BE BASED ON $T/T_{ALL} + V/V_{ALL} \leq 1.0$.
13. REFER TO NOTE 6a ON CLO.00 FOR ADDITIONAL SHEET METAL SCREW REQUIREMENTS.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.5
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SHEET METAL SCREW GENERAL NOTES		

SHEET METAL SCREW (SMS) ALLOWABLE STRENGTHS

TABLE 1

SHEET METAL SCREW ALLOWABLE STRENGTHS FOR STEEL TO STEEL CONNECTIONS.

		FASTENER SIZE									
F _y (KSI)	MIL (STEEL GA)	NO. 14		NO. 12		NO. 10		NO. 8		NO. 6	
		0.250 IN		0.216 IN		0.190 IN		0.164 IN		0.138 IN	
		SHEAR (LB)	TENSION (LB)								
50	97 (12)	704	275	525	205						
	68 (14)	704	275	525	205	405	159				
	54 (16)	613	261	525	205	405	159	303	118		
33	43 (18)	302	144	280	124	263	109	244	94	165	79
	33 (20)					177	84	164	72	151	61

NOTES:

1. SEE GENERAL NOTES ON CL1.5 FOR ADDITIONAL INFORMATION
2. WHERE ONE OR TWO LAYERS OF GYP BOARD OCCURS BETWEEN STEEL SURFACES, THE ALLOWABLE VALUES OF TABLE 2 & 3 SHALL BE USED.
3. ALLOWABLE STRENGTH VALUES DO NOT ACCOUNT FOR EFFECTS FROM PRYING. THE RDP IN RESPONSIBLE CHARGE OF THE PROJECT SHALL PROVIDE ADEQUATE BLOCKING/RESTRAINT TO PREVENT PRYING ACTION. WHERE PRYING OCCURS, THE VALUES AND CONSTRAINTS OF TABLE 4 SHALL BE USED.

TABLE 2 - NON-PRYING CONDITION

SHEET METAL SCREW ALLOWABLE STRENGTHS FOR STEEL TO STEEL CONNECTIONS WITH ONE LAYER OF 5/8" GYP BOARD BETWEEN STEEL SURFACES.

		FASTENER SIZE									
F _y (KSI)	MIL (STEEL GA)	NO. 14		NO. 12		NO. 10		NO. 8		NO. 6	
		0.250 IN		0.216 IN		0.190 IN		0.164 IN		0.138 IN	
		SHEAR (LB)	TENSION (LB)								
50	97 (12)	226	275	180	205						
	68 (14)	226	275	180	205	140	159				
	54 (16)	226	261	180	205	140	159	120	118		
33	43 (18)	226	144	180	124	140	109	120	94	60	79
	33 (20)					100	84	80	72	60	61

NOTES:

1. SEE GENERAL NOTES ON CL1.5 FOR ADDITIONAL INFORMATION
2. ALLOWABLE STRENGTH VALUES DO NOT ACCOUNT FOR EFFECTS FROM PRYING. RDP IN RESPONSIBLE CHARGE TO PROVIDE ADEQUATE BLOCKING/RESTRAINT TO PREVENT PRYING ACTION. WHERE PRYING OCCURS, THE VALUES AND CONSTRAINTS OF TABLE 4 SHALL BE USED.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR

APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.6
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SHEET METAL SCREW ALLOWABLE STRENGTHS - PAGES 1 OF 2		

5/1/2013 12:16:38 AM

SHEET METAL SCREW (SMS) ALLOWABLE STRENGTHS (CONTINUED)

TABLE 3 – NON-PRYING CONDITION

SHEET METAL SCREW ALLOWABLE STRENGTHS FOR STEEL TO STEEL CONNECTIONS WITH TWO LAYERS OF 5/8" GYP BOARD BETWEEN STEEL SURFACES.

F _y (KSI)	MIL (STEEL GA)	FASTENER SIZE									
		NO. 14		NO. 12		NO. 10		NO. 8		NO. 6	
		0.250 IN		0.216 IN		0.190 IN		0.164 IN		0.138 IN	
		SHEAR (LB)	TENSION (LB)								
50	97 (12)	166	275	130	205						
	68 (14)	166	275	130	205	100	159				
	54 (16)	166	261	130	205	100	159	80	118		
33	43 (18)	166	144	130	124	100	109	80	94	50	79
	33 (20)					70	84	50	72	40	61

NOTES:

- SEE GENERAL NOTES ON CL1.5 FOR ADDITIONAL INFORMATION
- ALLOWABLE STRENGTH VALUES DO NOT ACCOUNT FOR EFFECTS FROM PRYING. RDP IN RESPONSIBLE CHARGE TO PROVIDE ADEQUATE BLOCKING/RESTRAINT TO PREVENT PRYING ACTION. WHERE PRYING OCCURS, THE VALUES AND CONSTRAINTS OF TABLE 4 SHALL BE USED.


TABLE 4 – PRYING CONDITION (SEE DETAILS BELOW – STRUT CAN BE HORIZONTAL OR VERTICAL)

SHEET METAL SCREW ALLOWABLE STRENGTHS FOR STEEL TO STEEL CONNECTIONS WITH ONE OR TWO LAYERS OF 5/8" GYP BOARD BETWEEN STEEL SURFACES AND MAXIMUM PRYING MOMENT ARM OF 1 5/8".

F _y (KSI)	MIL (STEEL GA)	FASTENER SIZE									
		NO. 14		NO. 12		NO. 10		NO. 8		NO. 6	
		0.250 IN		0.216 IN		0.190 IN		0.164 IN		0.138 IN	
		SHEAR (LB)	TENSION (LB)								
50	97 (12)	40	275	30	205						
	68 (14)	40	275	30	205	25	159				
	54 (16)	40	261	30	205	25	159	20	118		
33	43 (18)	40	144	30	124	25	109	20	94	10	79
	33 (20)					15	84	15	72	10	61

NOTES:


- SEE GENERAL NOTES ON CL1.5 FOR ADDITIONAL INFORMATION
- THE ALLOWABLE STRENGTH VALUES LISTED IN TABLE 4 ARE BASED UPON A LIMITED TEST ASSEMBLY WHERE THE ORIGIN AND DIRECTION OF THE LOAD RESULTS IN PRYING UPON THE FASTENER. THE MAGNITUDE OF THIS PRYING EFFECT SHALL BE LIMITED TO A MOMENT ARM OF 1 5/8" FROM THE FASTENER.

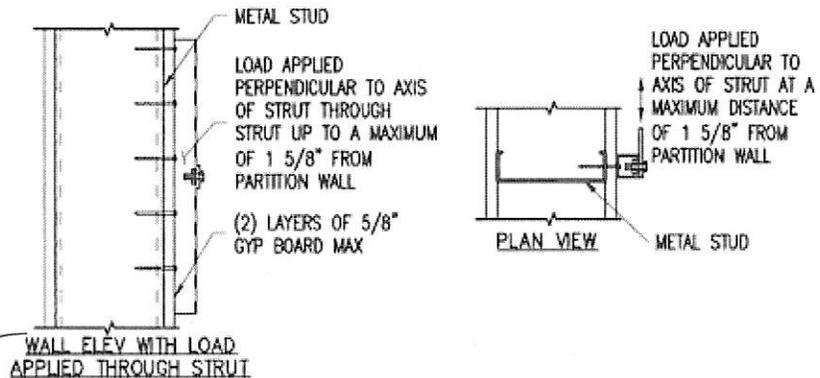

REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR
APPROVED

[Signature]
 Office of Statewide Health
 Planning & Development
 FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.7
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SHEET METAL SCREW ALLOWABLE STRENGTHS - PAGES 2 OF 2		

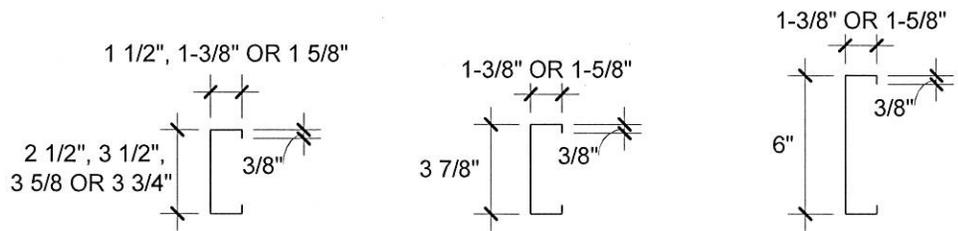

STRUCTURAL STUD ('S'-SECTIONS)

DESIGNATION THICKNESS (MILS)	REFERENCE ONLY GAUGE NO.
18	25
27	22
33	20
43	18
54	16
68	14
97	12
118	10

NOTE:

1. $F_y = 50\text{KSI}$ FOR 54 MIL (16GA) & THICKER SECTIONS, AND $F_y = 33\text{KSI}$ FOR SECTIONS UP TO & INCLUDING 43 MI (18GA).
2. SIZE AND THICKNESS ARE CONSIDERED MINIMUMS.
3. STRUCTURAL STUDS SHALL NOT BE PUNCHED UNLESS NOTED OTHERWISE.



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL1.8
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : METAL STUD PROFILES		

5/1/2013 12:16:39 AM

12 GA VERTICAL HANGERS AT 4'-0" O.C. EACH WAY (AT MAIN RUNNER WITH MINIMUM 3-TIGHT TURNS IN 3" AT BOTH ENDS, SEE


CL4.1

12 GA. BRACING WIRE W/MIN. 4-TIGHT TURNS IN 1 1/2" BOTH ENDS OF WIRE CONNECTED TO MAIN RUNNERS 90° APART, 4-TOTAL AT EACH COMPRESSION STRUT (U.O.N.) SEE

CL4.1

RIGID VERT. COMPRESSION STRUT, SEE DET.

CL3.1 OR CL3.2

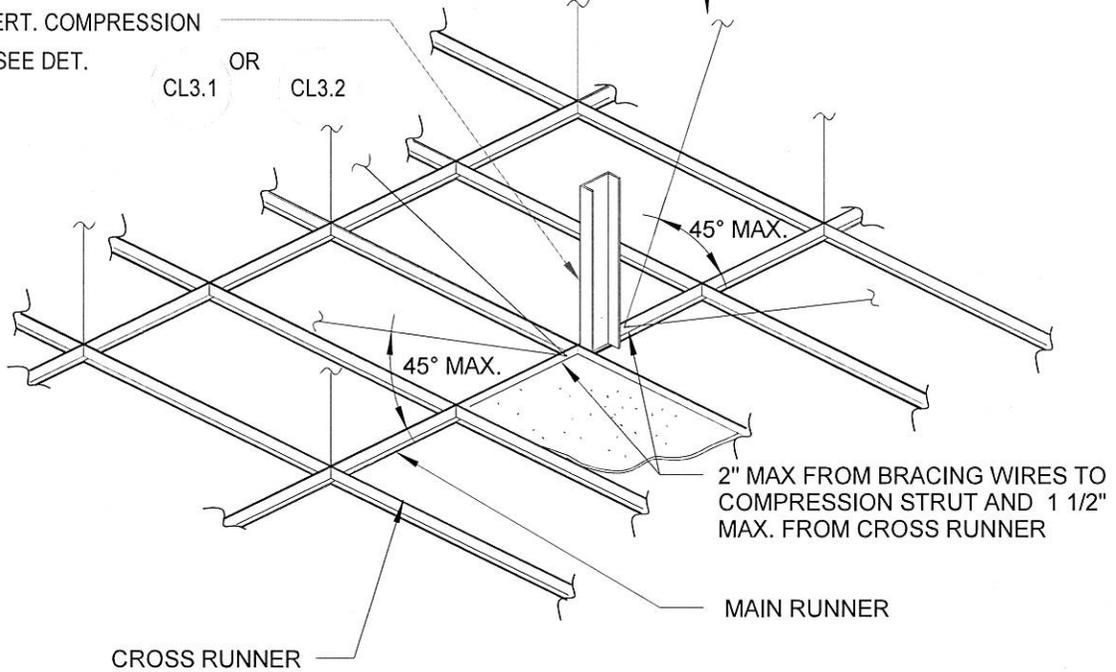

NOTES:

- 1. SEE SUSPENDED CEILING NOTES ON CL0.02
- 2. COMPRESSION STRUTS SHALL NOT REPLACE HANGER WIRES. ATTACH COMPRESSION STRUTS TO MAIN RUNNERS WITHIN 1 1/2" OF CROSS RUNNER
- 3. FOR CONDITIONS AT CORRIDOR SEE DRAWING NO. CL2.3




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.1
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED CEILING BRACING ASSEMBLY		

5/1/2013 12:16:39 AM

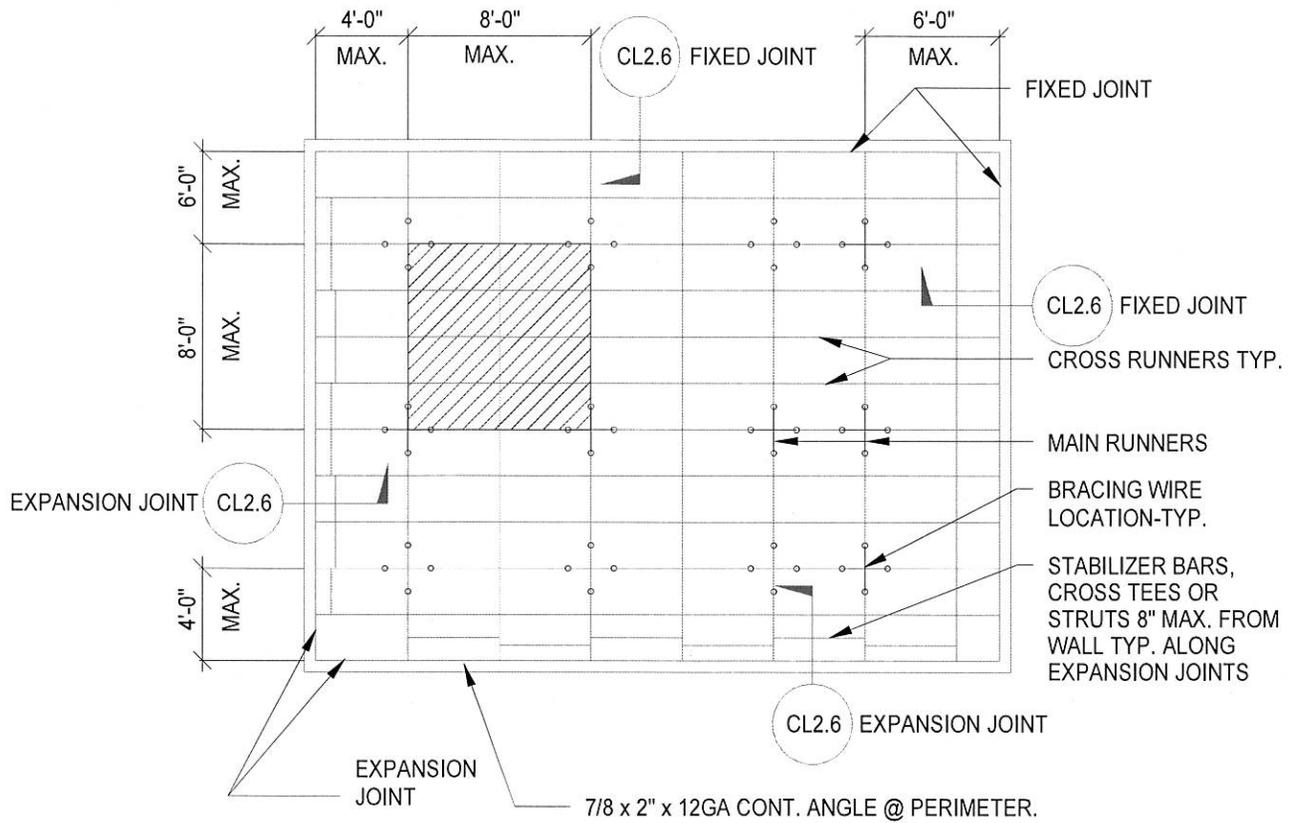

NOTE:

BRACING WIRES AND COMP. STRUT SHALL OCCUR AT EVERY 64 SQ. FT. MAX. IN ROOMS OVER 64 SQ. FT.




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten signature]

Office of Statewide Health
 Planning & Development
 FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No : CL2.2a
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : TYPICAL CEILING PLAN FOR $S_{DS} > 1.73$ AND $z/h \leq 1.0$		

5/1/2013 12:16:40 AM

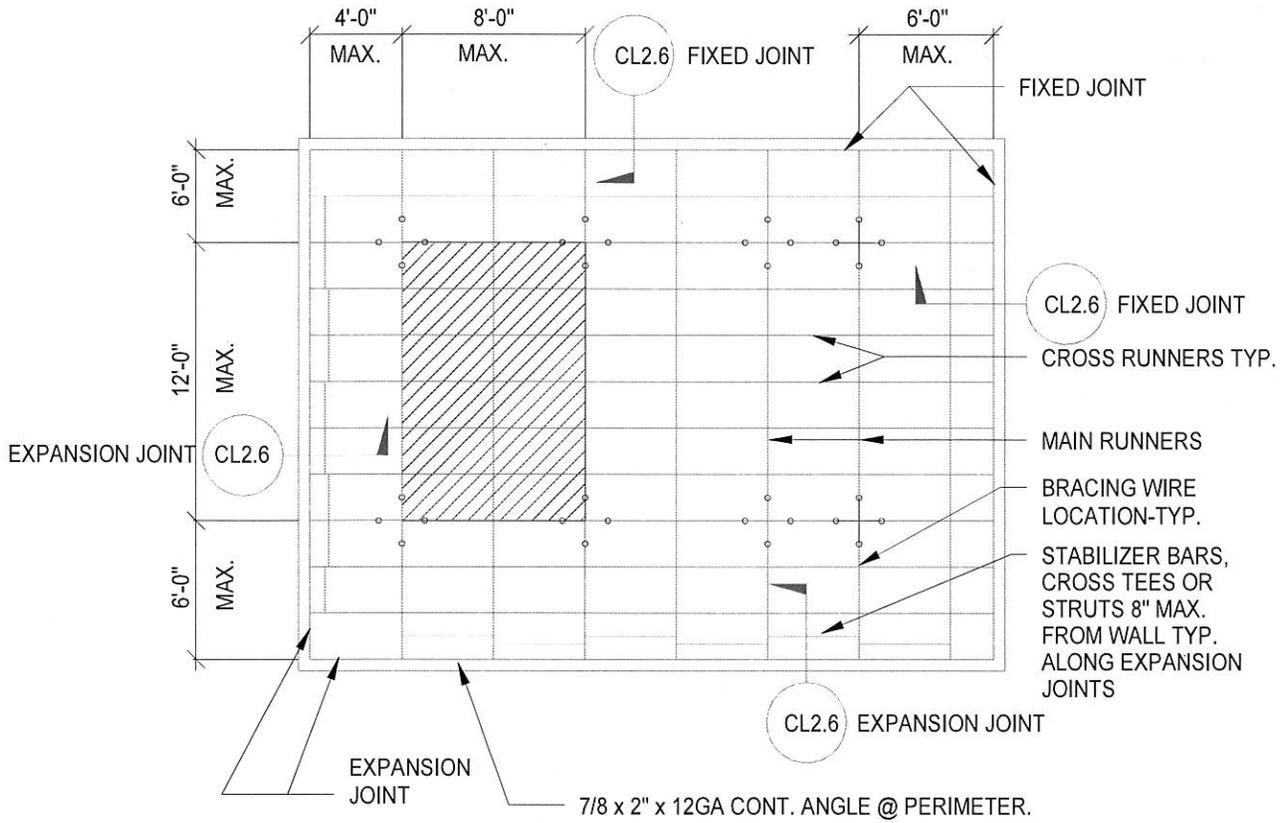

NOTE:

BRACING WIRES AND COMP. STRUT SHALL OCCUR AT EVERY 96 SQ. FT. MAX. IN ROOMS OVER 96 SQ. FT.




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.2b
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : TYPICAL CEILING PLAN FOR 1.15 < S _{DS} ≤ 1.73 AND z/h ≤ 1.0		

5/1/2013 12:16:41 AM

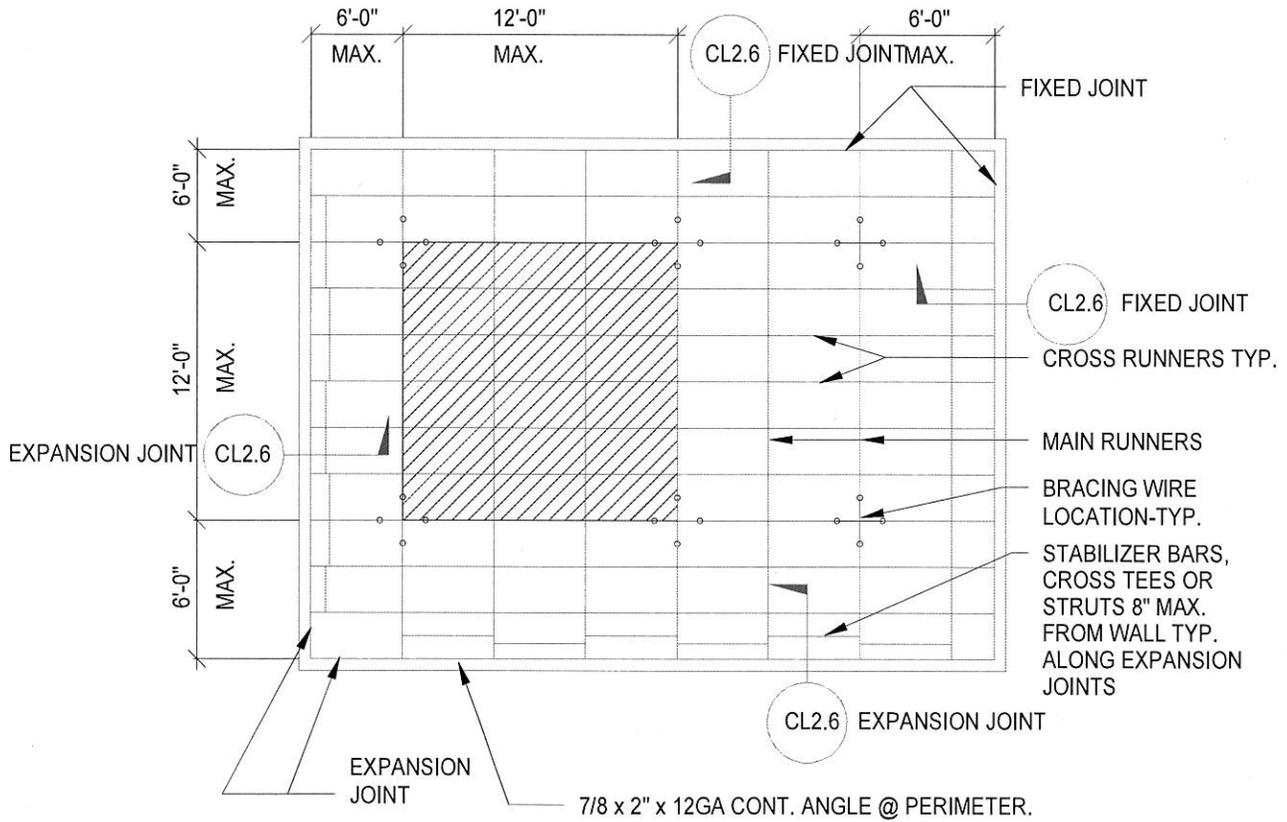

NOTE:

BRACING WIRES AND COMP. STRUT SHALL OCCUR AT EVERY 144 SQ. FT. MAX. IN ROOMS OVER 144 SQ. FT.




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

[Handwritten signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.2c
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : TYPICAL CEILING PLAN FOR $S_{DS} \leq 1.15$ AND $z/h \leq 1.0$		

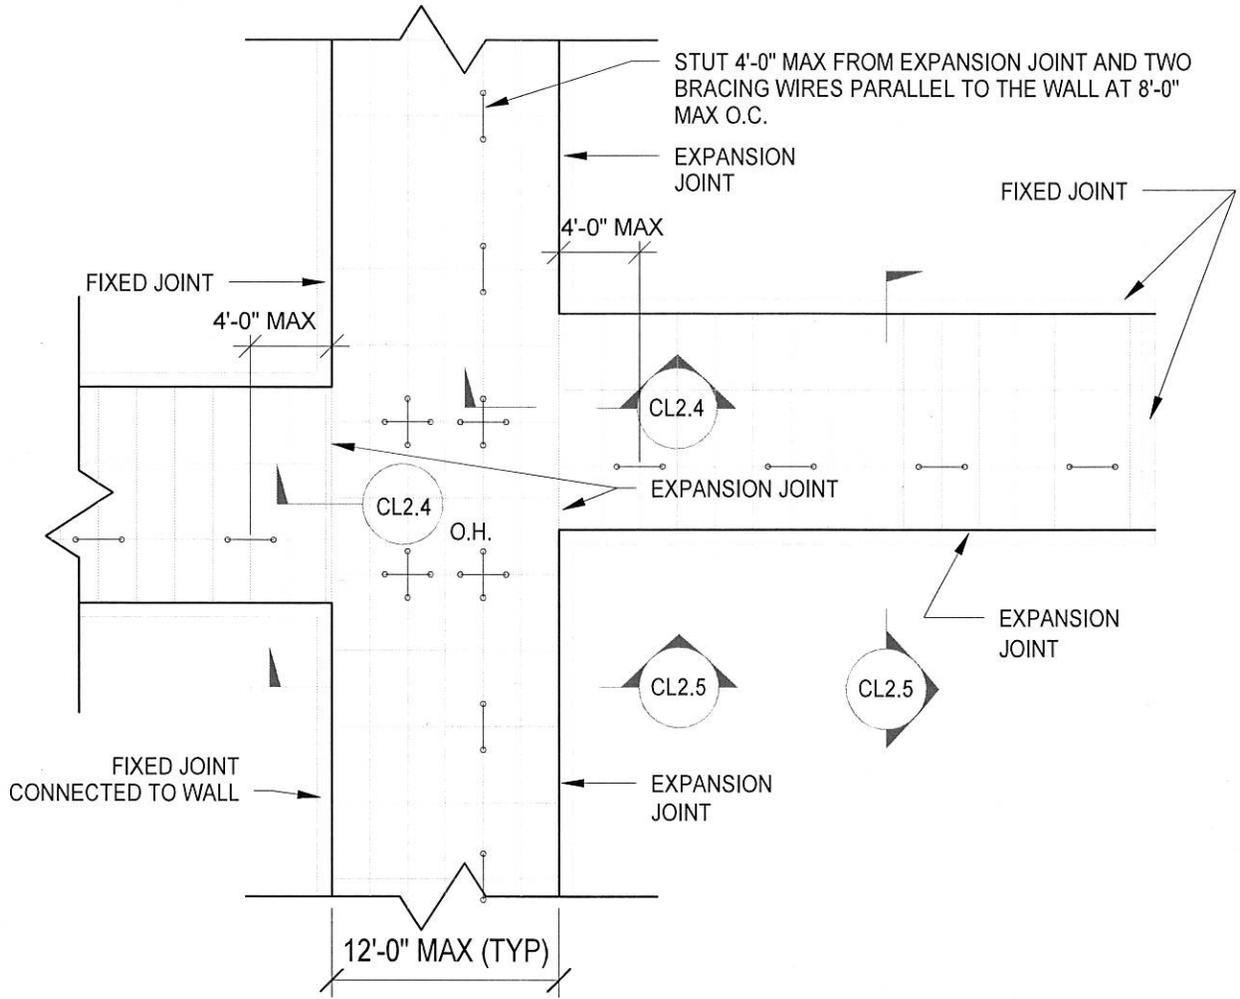

LOCATION OF EXPANSION/SLIP JOINTS IN CORRIDORS




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.3
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED ACOUSTICAL CEILING-CORRIDOR CEILING PLAN		

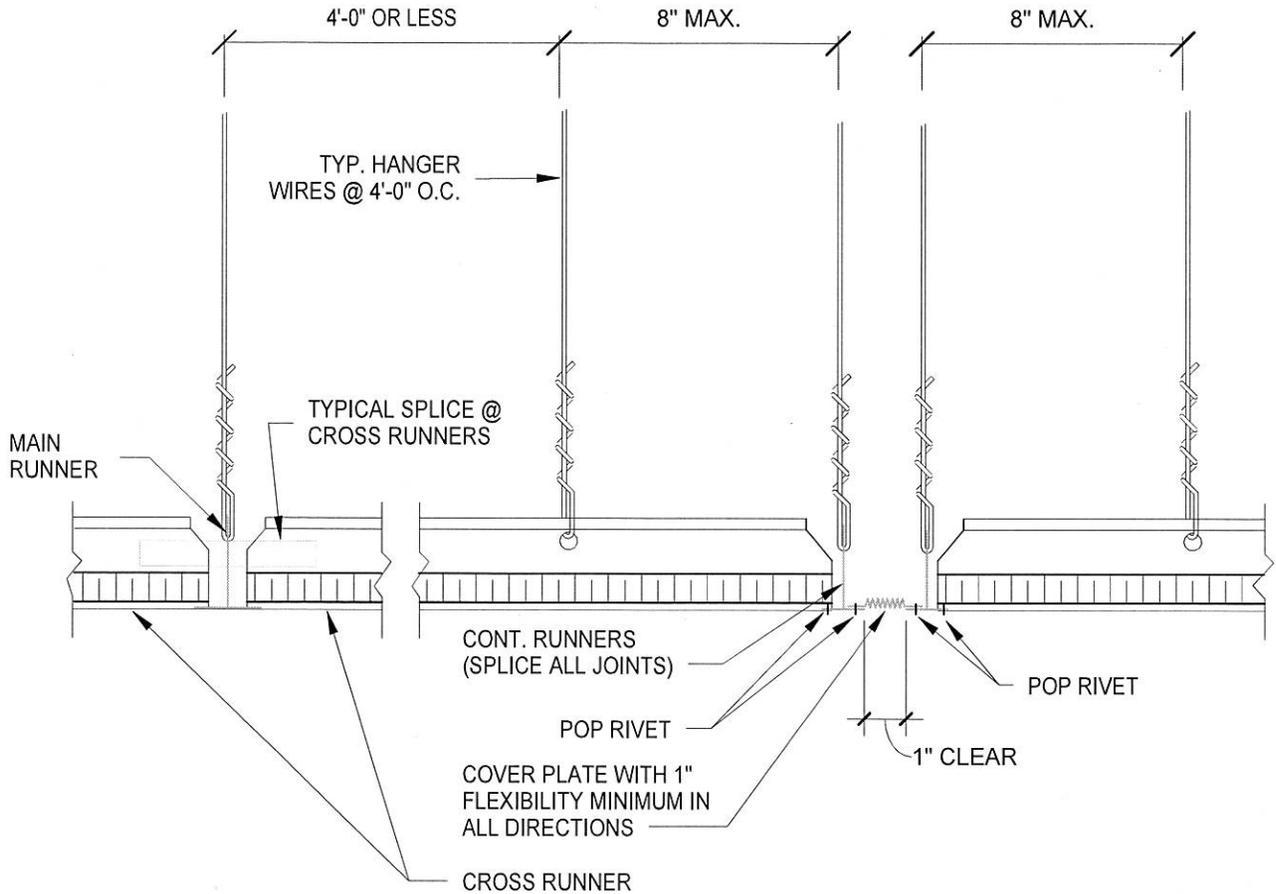

RUNNER SPLICE

EXPANSION JOINT

EXPANSION JOINT AT INTERSECTION OF CORRIDORS, JUNCTIONS OF CORRIDORS AND LOBBIES, SIMILAR AREAS AND CEILING OVER 2500 SFT




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.4
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED ACOUSTICAL CEILING - EXPANSION JOINT AT INTERSECTIONS		

5/1/2013 12:16:42 AM

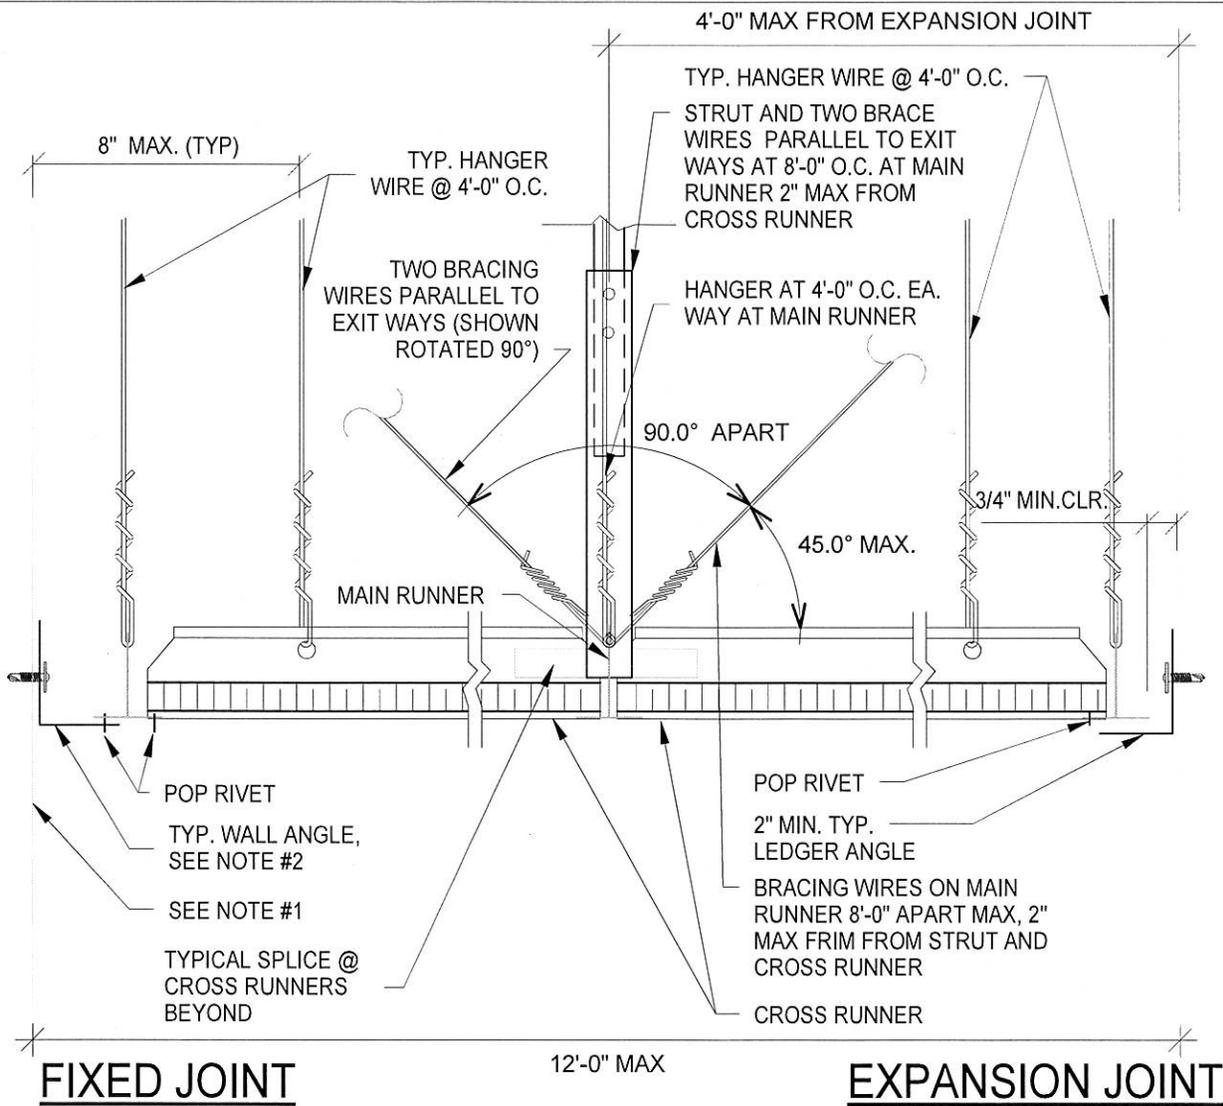

ACCEPTABLE EXITWAY DETAILS

NOTES:

1. PERIMETER WALLS SHALL BE DESIGNED TO CARRY TRIBUTARY LATERAL FORCES PARALLEL TO THE WALL AND THE ENTIRE LATERAL FORCES PERPENDICULAR TO THE WALL, RDP TO VERIFY. SEISMIC BRACING WIRES AND COMPRESSION STRUTS IN ACCORDANCE WITH PAGES CL2.2X SHALL BE PERMITTED IN LIEU OF DESIGNING PERIMETER WALLS FOR SEISMIC FORCES AND BRACING SYSTEM SHOWN ON PAGE CL2.3 AND THIS PAGE.

2. 2" STANDARD LEDGER ANGLE AT PERIMETER, RDP TO SPECIFY THICKNESS, CONNECTOR TYPE & SIZE (CONNECTION SHALL BE TO STRUCTURE OR THROUGH FINISH TO STRUCTURE WHERE FINISH IS APPLIED AND NOT TO FINISH)




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.5
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : TYPICAL CEILING SECTION AT EXITWAYS		


5/1/2013 12:16:43 AM

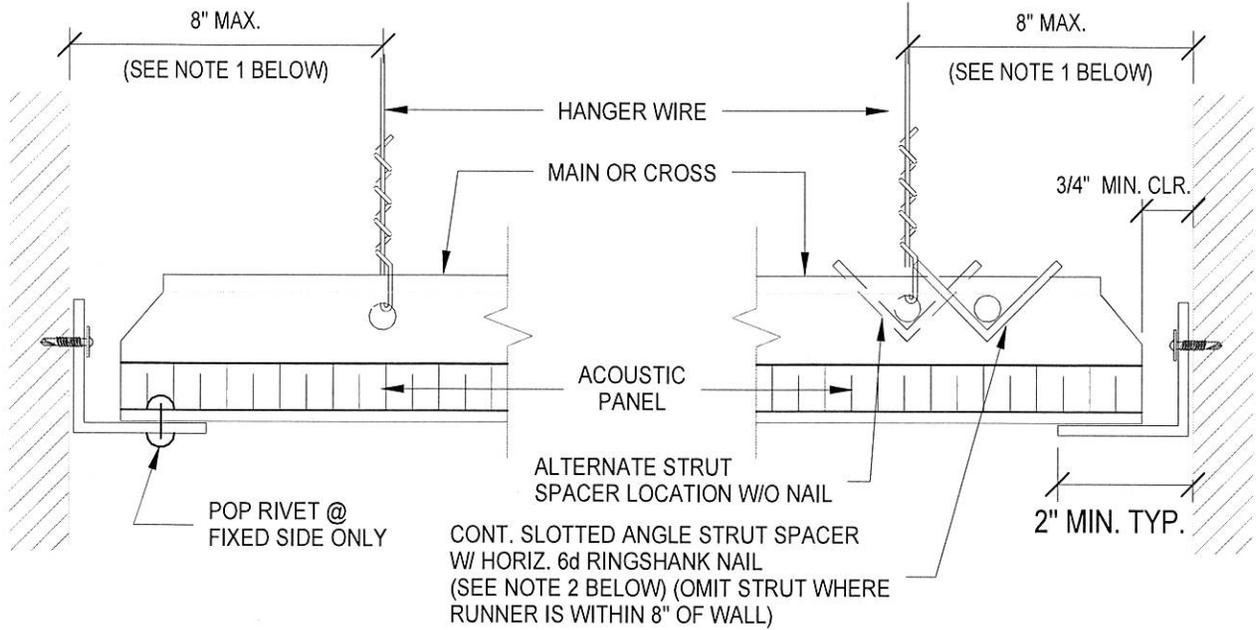

FIXED JOINT

EXPANSION JOINT

1. PROVIDE #12 GAGE HANGER WIRES AT THE ENDS OF ALL MAIN AND CROSS RUNNERS WITHIN EIGHT (8) INCHES OF THE SUPPORT OR WITHIN ONE-FOURTH (1/4) OF THE LENGTH OF THE END TEE, WHICHEVER IS LEAST, FOR THE PERIMETER OF THE CEILING AREA. PERIMETER WIRES ARE NOT REQUIRED WHEN THE LENGTH OF THE END TEE IS EIGHT (8) INCHES OR LESS.
2. NAILS AT ENDS OF HORIZONTAL STRUTS ARE TO BE PLACED WITH NAIL HEAD TOWARD CENTER LINE OF SPAN OF STRUT.
3. SPACERS MAY BE SLOTTED APPROVED ANGLES OR CHANNELS WITH "DIAMOND POINTS" OF SPRING STEEL WHICH SNAP TIGHT TO PREVENT MOVEMENT OF STRUT.

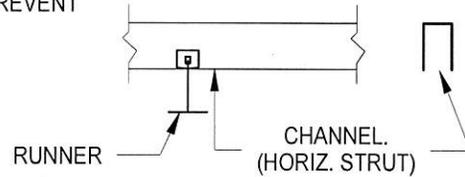

APPROVED SPACER




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : CEILING PERIMETER NOT AT EXITWAYS		
		CL2.6

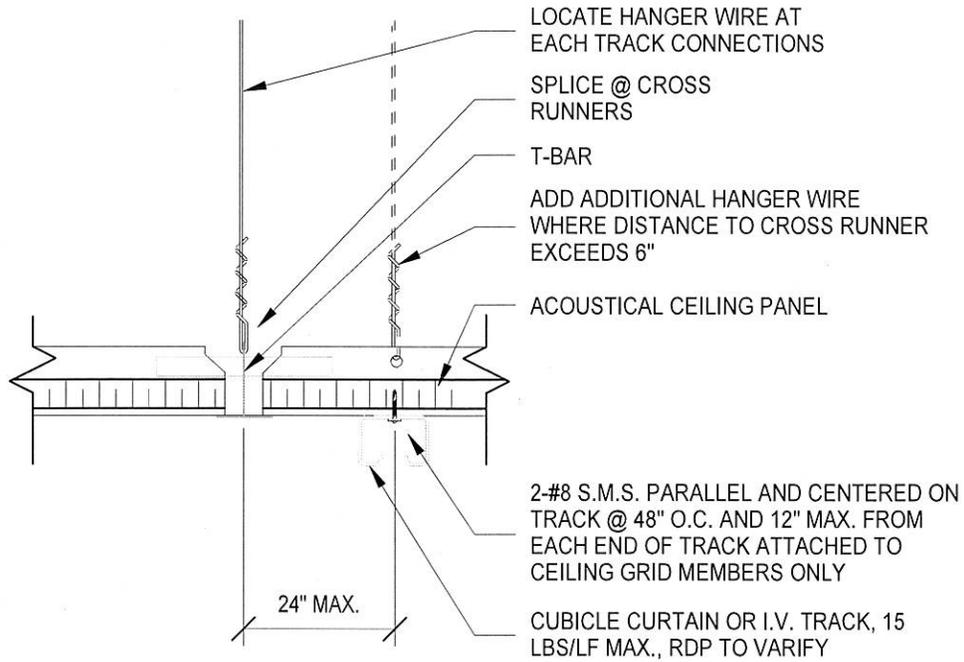

REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED


[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.7
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED ACOUSTICAL CEILING - CUBICLE CURTAIN I.V. TRACK		

NOTES:

1. SEE GENERAL NOTE #15 ON CL0.03 AND CL0.04

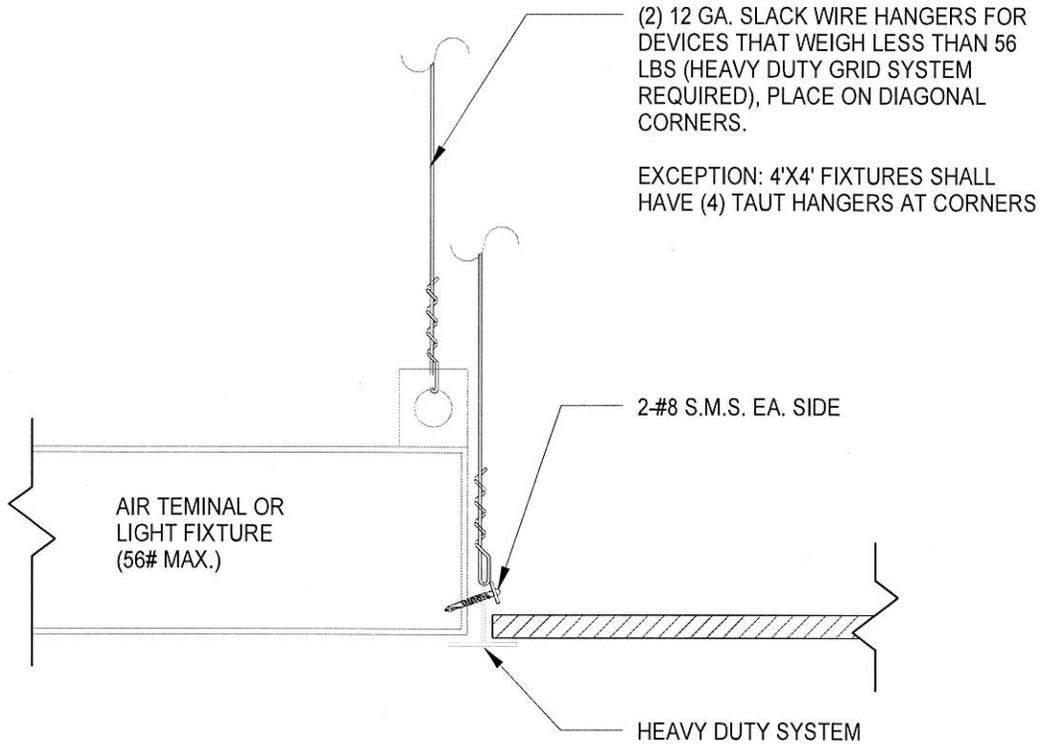


REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL2.8
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED ACOUSTICAL CEILING - LIGHT FIXTURES/ AIR TERMINAL SUPPORT DETAIL		

5/1/2013 12:16:44 AM

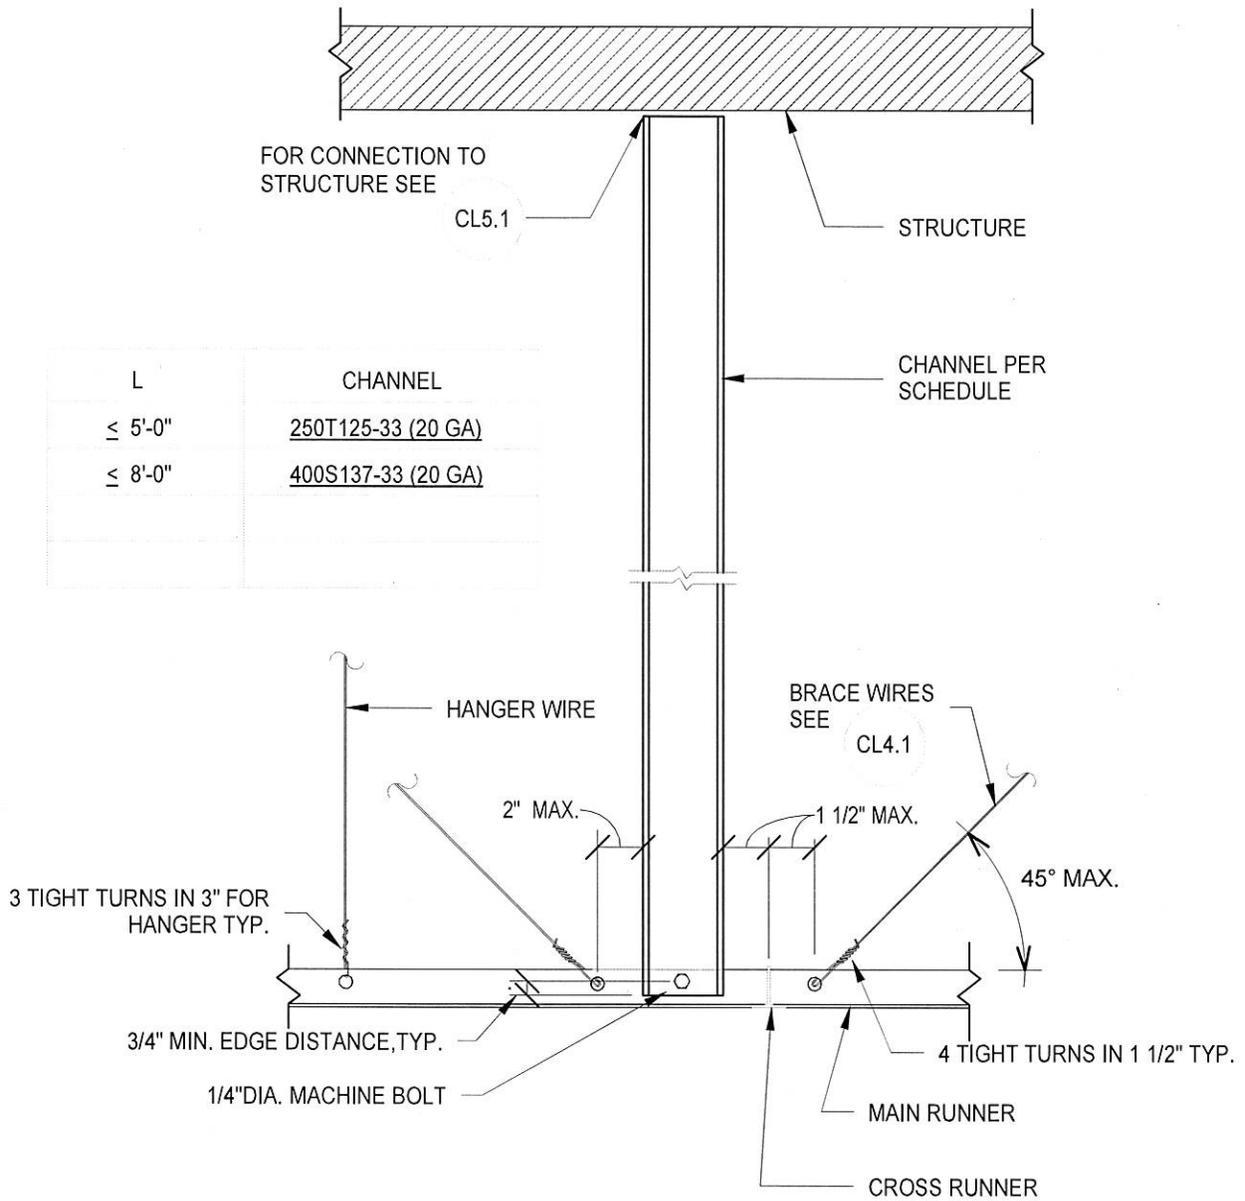

L	CHANNEL
≤ 5'-0"	<u>250T125-33 (20 GA)</u>
≤ 8'-0"	<u>400S137-33 (20 GA)</u>




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL3.1
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED ACOUSTICAL CEILING - CHANNEL TYPE COMPRESSION STRUT		

ELECTRICAL CONDUIT TUBE SCHEDULE

L	DIA.	"t"
4'-0"	3/4"	0.046"
5'-6"	1"	0.054"
7'-0"	1-1/4"	0.061"

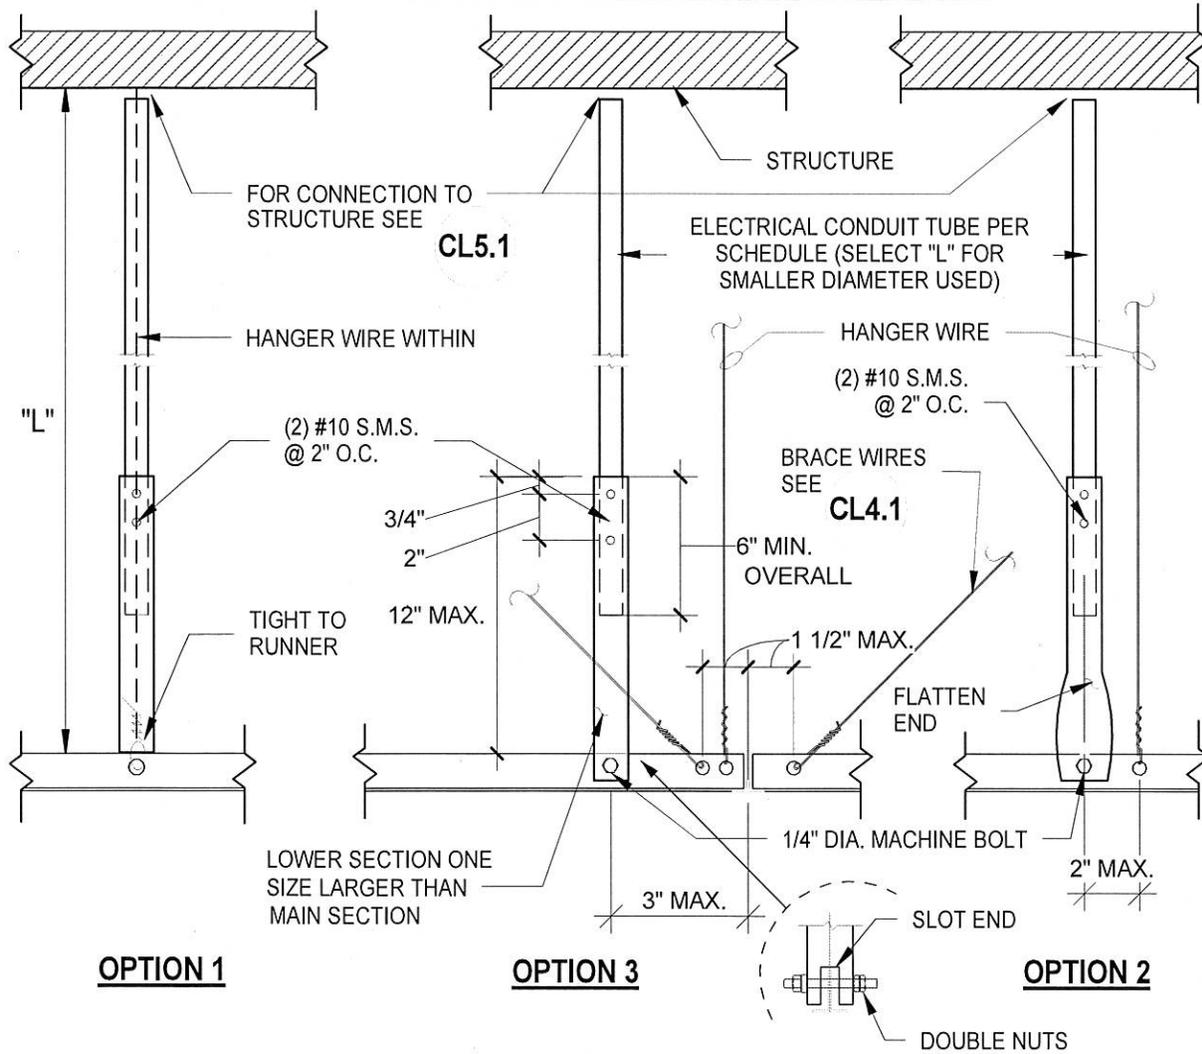


REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED


[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL3.2
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : SUSPENDED ACOUSTICAL CEILING - TUBE TYPE COMPRESSION STRUT		

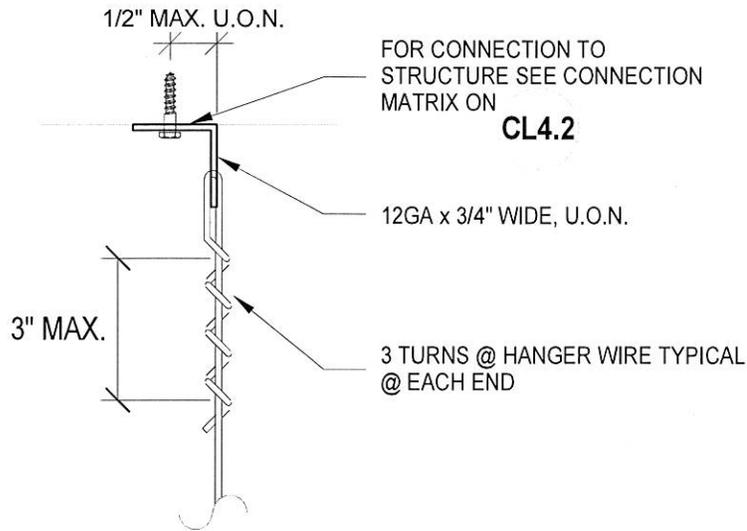

HANGER WIRE

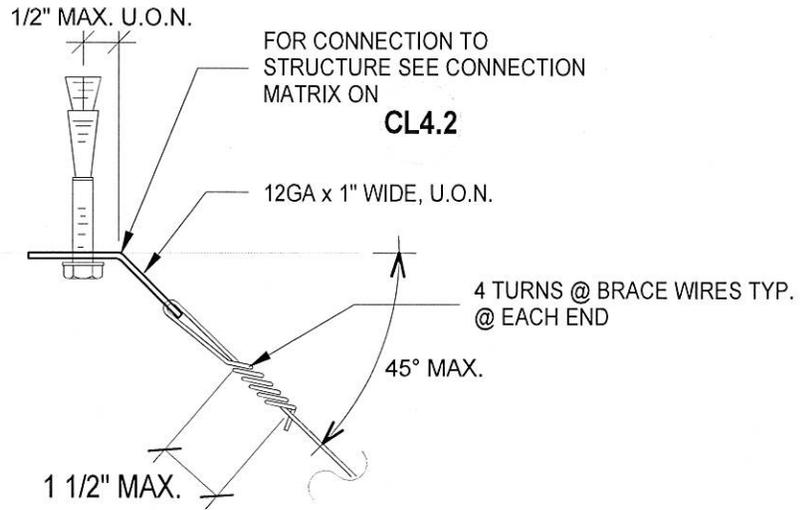

BRACING WIRE



REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.1
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER & BRACING WIRE CONNECTION - TYPICAL WIRE TURNS		


STRUCTURAL CONDITION OF FLOOR/ ROOF ABOVE SUSPENDED CEILING	APPLICABLE DETAIL
CONCRETE FILLED METAL DECK	CL4.3
CONCRETE FILLED METAL DECK AND STRUCTURE CONCRETE	CL4.4
CONCRETE SLAB, BEAM, OR JOIST	CL4.5
STRUCTURAL STEEL	CL4.6
SAWN TIMBER	CL4.7
METAL STUD WALL	CL4.8




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER & BRACING WIRE MATRIX		CL4.2

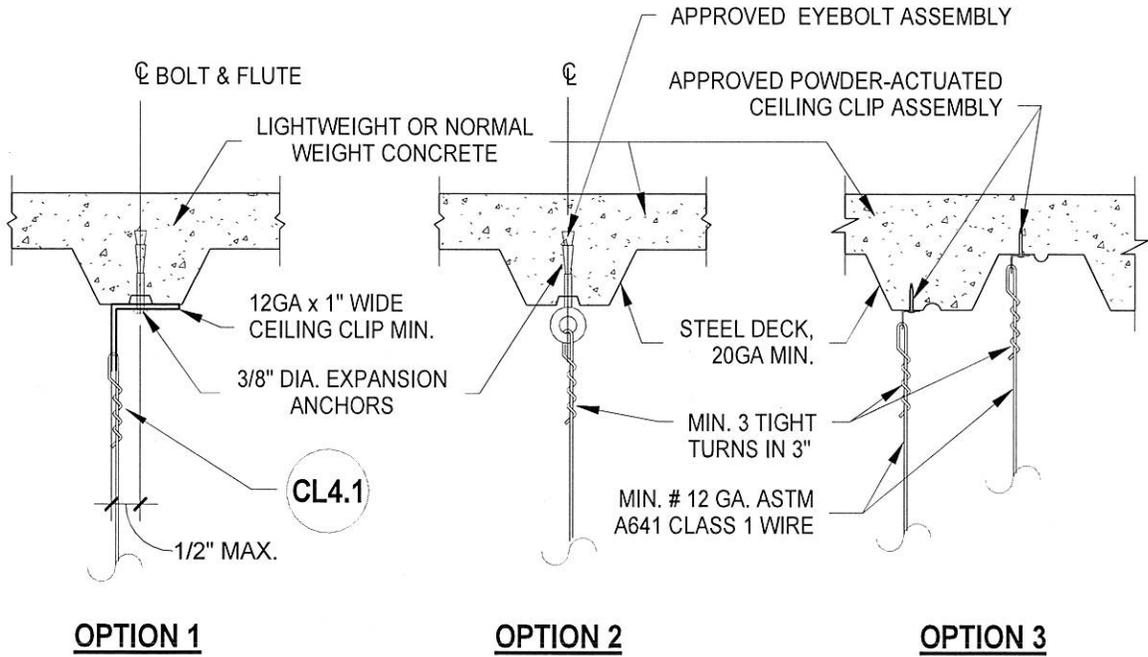

HANGER WIRE

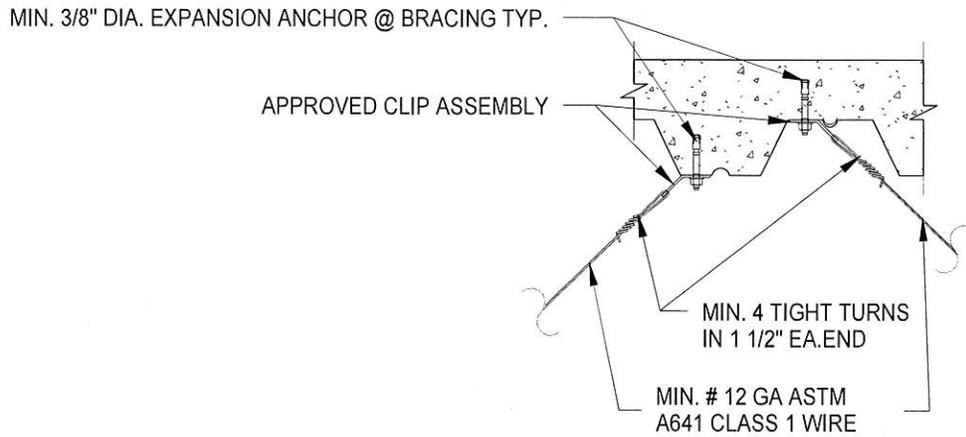

BRACING WIRE

- NOTES:
 1. LOAD TEST IN ACCORDANCE WITH GENERAL NOTE 14(g), PAGE CL0.03 SHALL BE REQUIRED
 2. REFER TO CL4.1 FOR ADDITIONAL DETAILS




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED


[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.3
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER AND BRACING WIRE CONNECTION TO CONCRETE FILLED METAL DECK		

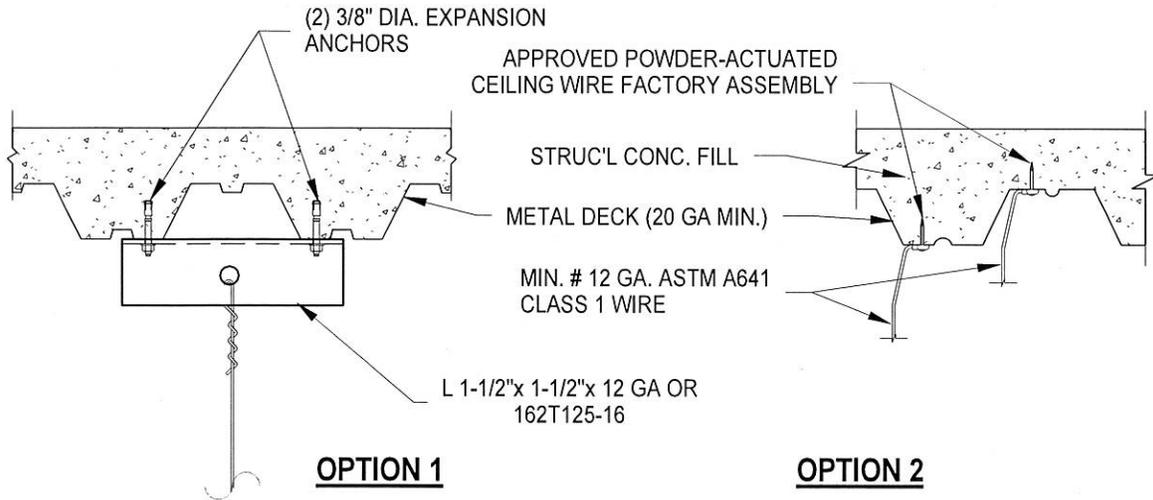

HANGER WIRE

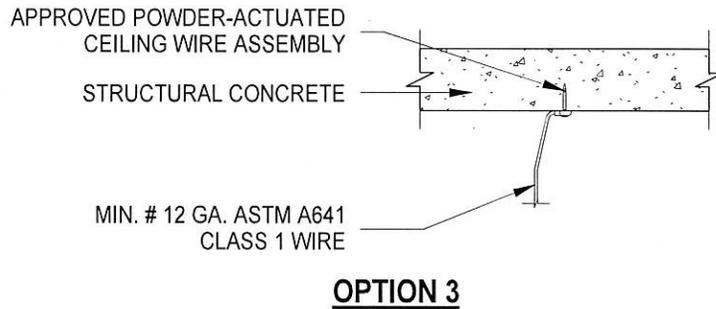

NOTES:

1. LOAD TEST IN ACCORDANCE WITH GENERAL NOTE 14 (g), PAGE CL0.03 SHALL BE REQUIRED
2. FOR HANGER WIRE OPTION 3: PRIOR TO INSTALLATION, REINFORCING/PRESTRESSING BAR LOCATIONS SHALL BE DETERMINED BY NON-DESTRUCTIVE TESTING
3. REFER TO CL4.1 FOR ADDITIONAL DETAILS




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED


[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.4
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER WIRE CONNECTION TO CONCRETE FILLED METAL DECK AND STRUCTURAL CONCRETE		

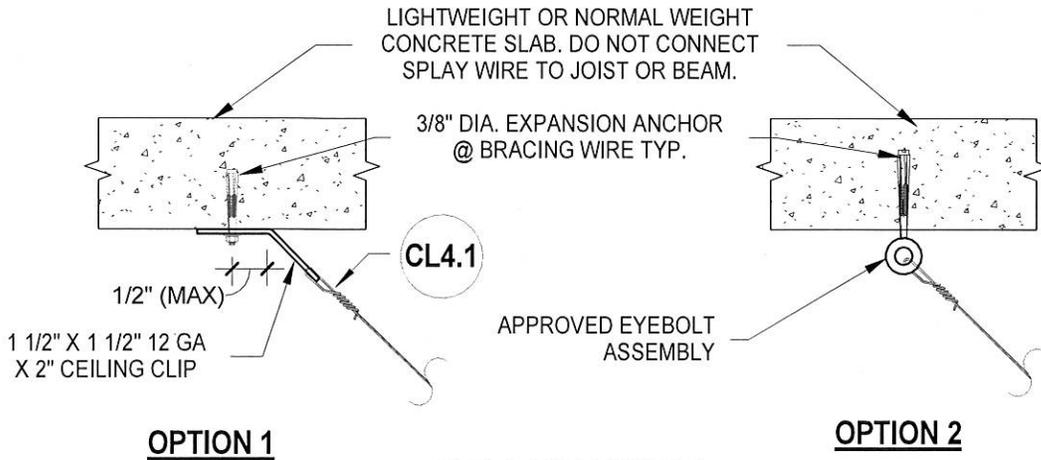


BRACE WIRE

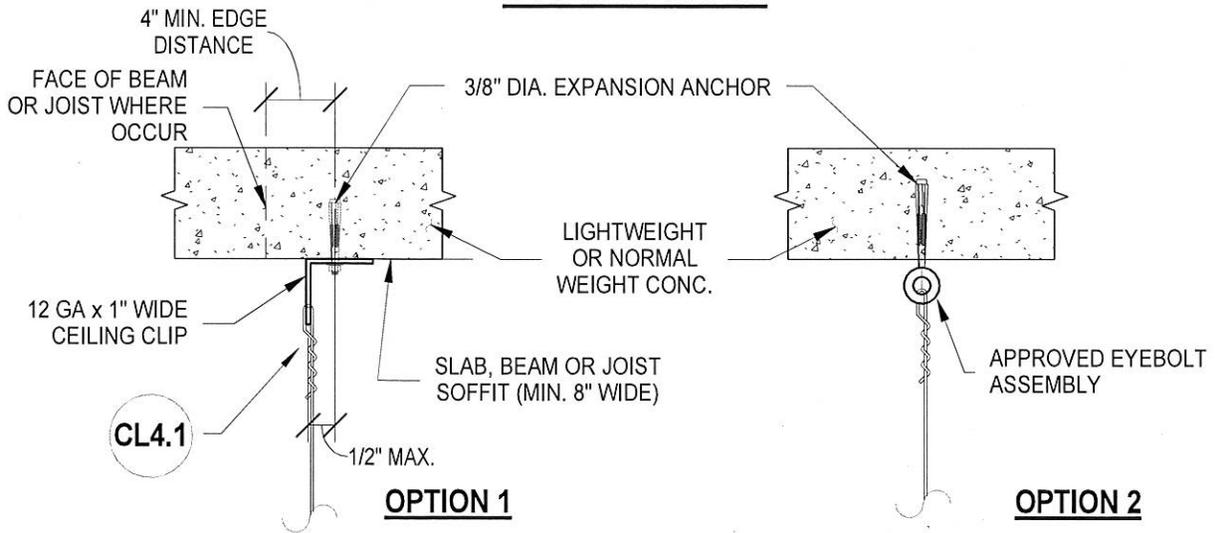

HANGER WIRE

NOTES:

1. LOAD TEST IN ACCORDANCE WITH GENERAL NOTE 14 (g), PAGE CL0.03 SHALL BE REQUIRED
2. FOR HANGER WIRE OPTION 3: PRIOR TO INSTALLATION, REINFORCING/PRESTRESSING BAR LOCATIONS SHALL BE DETERMINED BY NON-DESTRUCTIVE TESTING
3. REFER TO CL4.1 FOR ADDITIONAL DETAILS

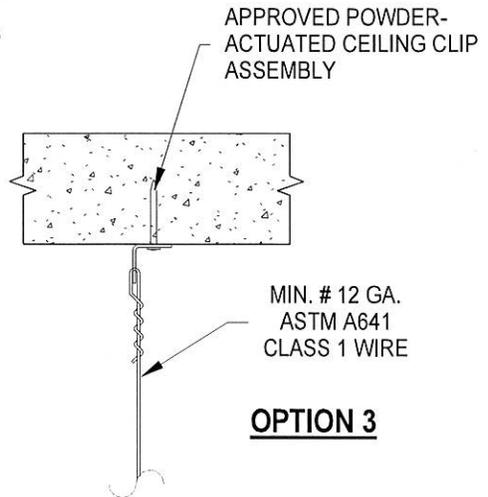


REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED


[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.5
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER & BRACING WIRE CONNECTION TO CONCRETE SLAB, BEAM, JOIST		

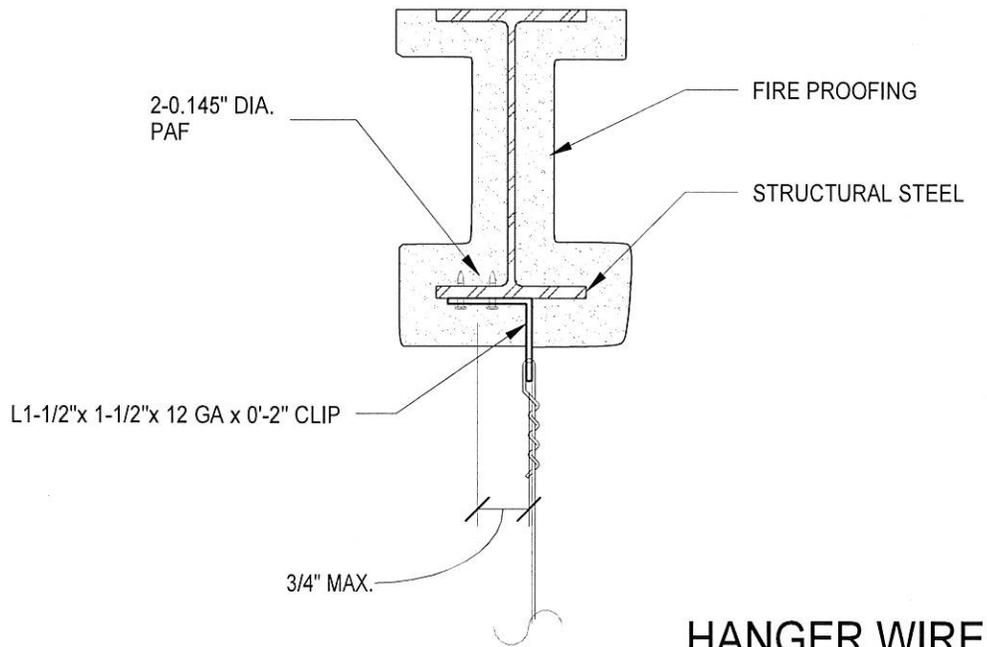

HANGER WIRE

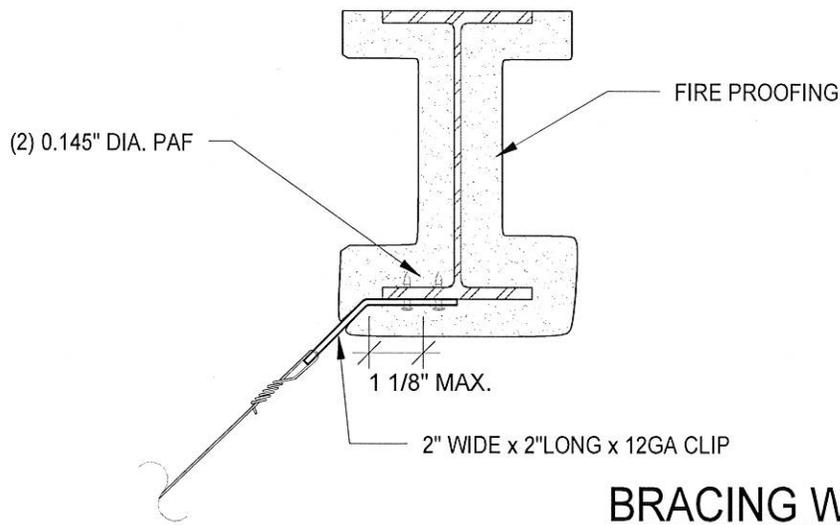

BRACING WIRE

NOTES :

1. BEAM FLANGE THICKNESS SHALL NOT BE LESS THAN 3/16" OR MORE THAN 3/8"

2. FRAMING MEMBERS SHALL BE DESIGNED TO CARRY THE CEILING LOADS, RDP TO VERIFY

3. RDP IN RESPONSIBLE CHARGE, I.O.R. AND CONTRACTOR SHALL VERIFY THAT NO PAF IS INSTALLED IN THE PROTECTED ZONE OF ANY STEEL MEMBER, SEE ANSI/AISC 341-05 SECTION 7.4





REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.6
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER & BRACING WIRE CONNECTION TO STRUCTURAL STEEL		

5/1/2013 12:16:48 AM

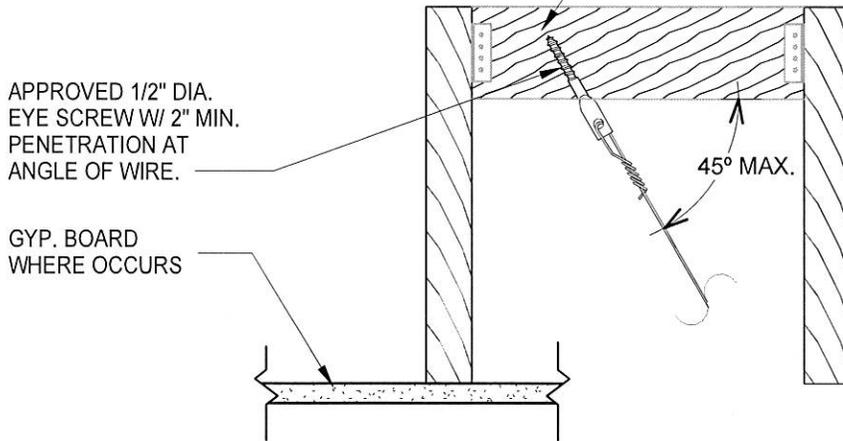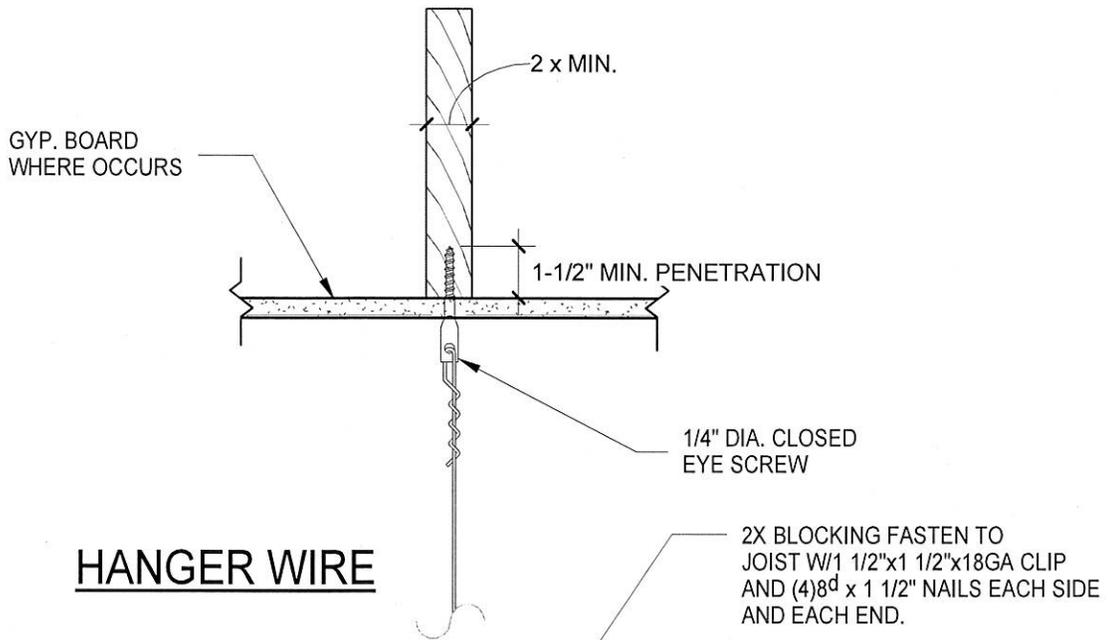


- NOTES:
1. FRAMING MEMBERS SHALL BE DESIGNED TO CARRY THE CEILING LOADS, RDP TO VERIFY
 2. RDP SHALL VERIFY THAT SCREWS AT THE BOTTOM FLANGE OF TRUSS IS ACCEPTABLE



REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.7
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER & BRACING WIRE CONNECTION TO SAWN TIMBER		

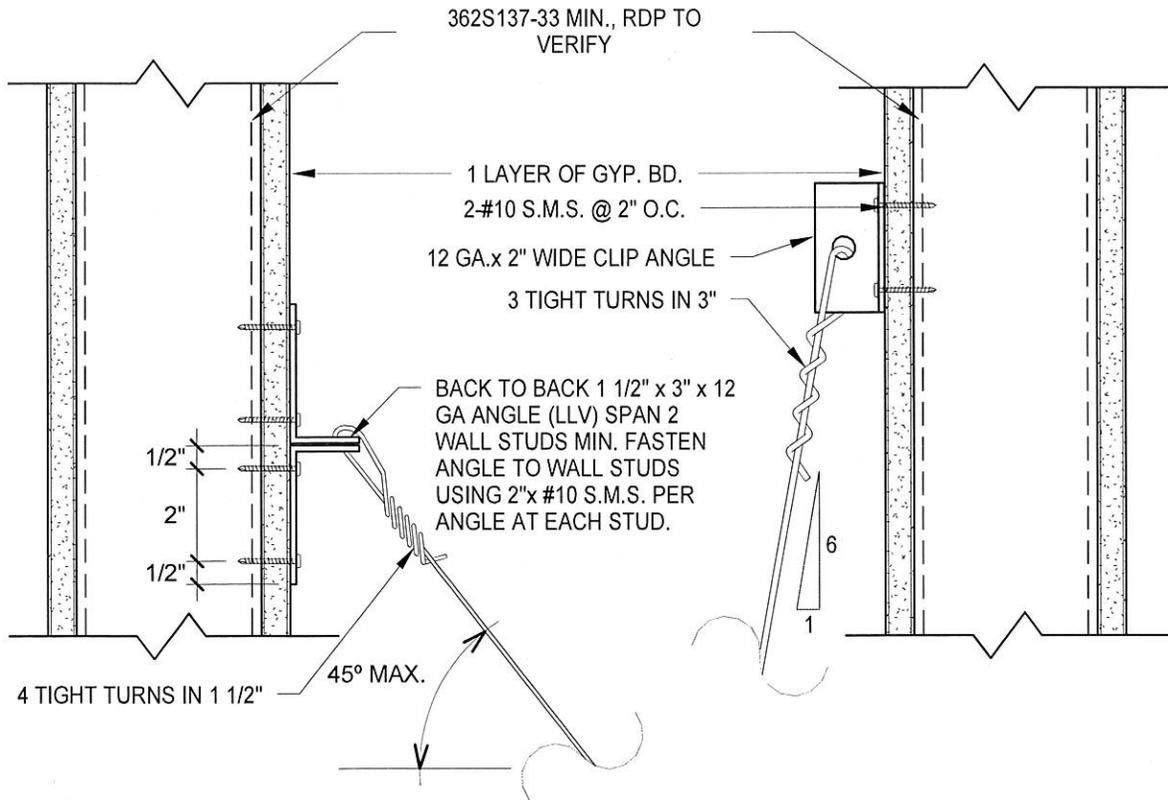

NOTE:
FRAMED WALLS SHALL BE DESIGNED TO CARRY THE
CEILING LOADS, RDP TO VERIFY.

BRACING WIRE

HANGER WIRE




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No.
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER AND BRACING WIRE CONNECTION TO METAL STUD WALL FRAMING		
		CL4.8

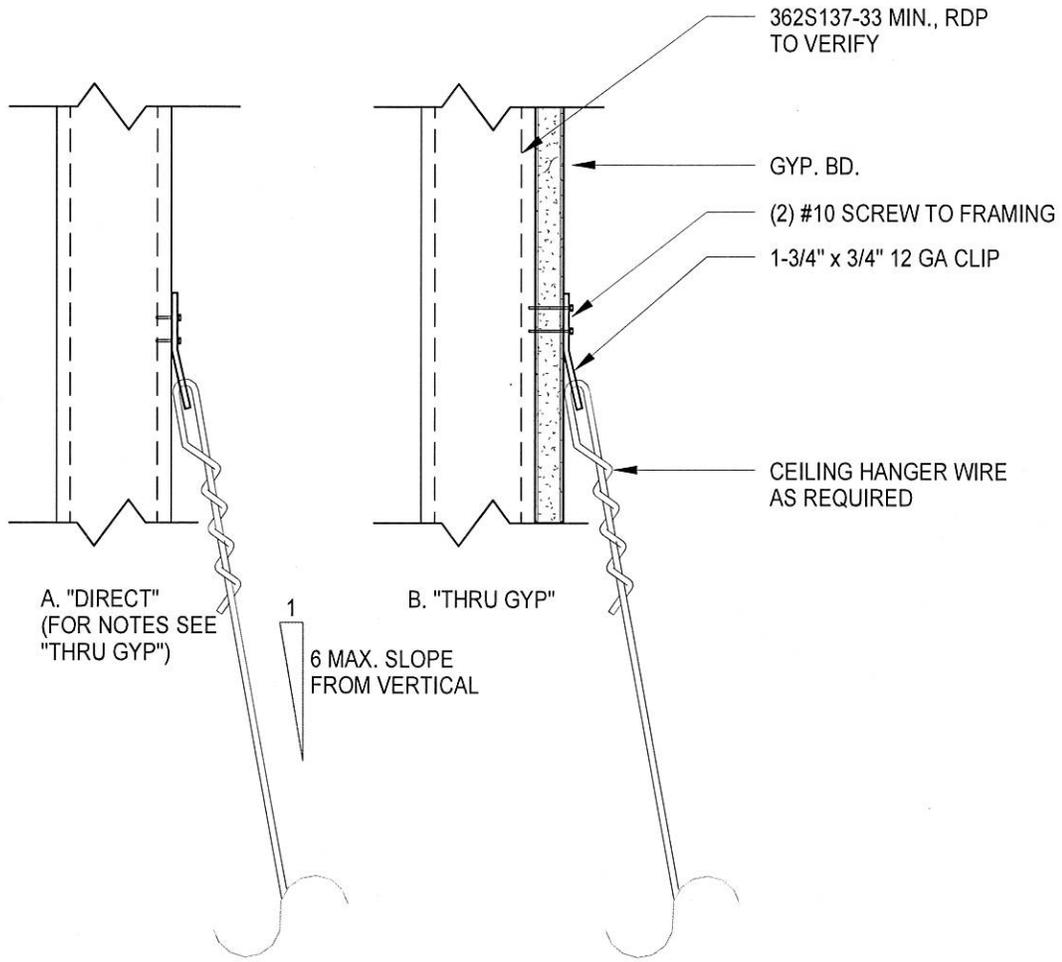

- NOTES:
1. THIS IS APPLIED FOR PERIMETER WIRE ATTACHEMENT OR WHERE OBSTRUCTION PREVENTS ATTACHEMENT TO STRUCTURE ABOVE
 2. RDP SHALL DESIGN FRAMING WALL TO CARRY THE CEILING LOAD

HANGER WIRE




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	CL4.9
Sheet Title : HANGER WIRE CONNECTION TO METAL STUD WALL FRAMING		

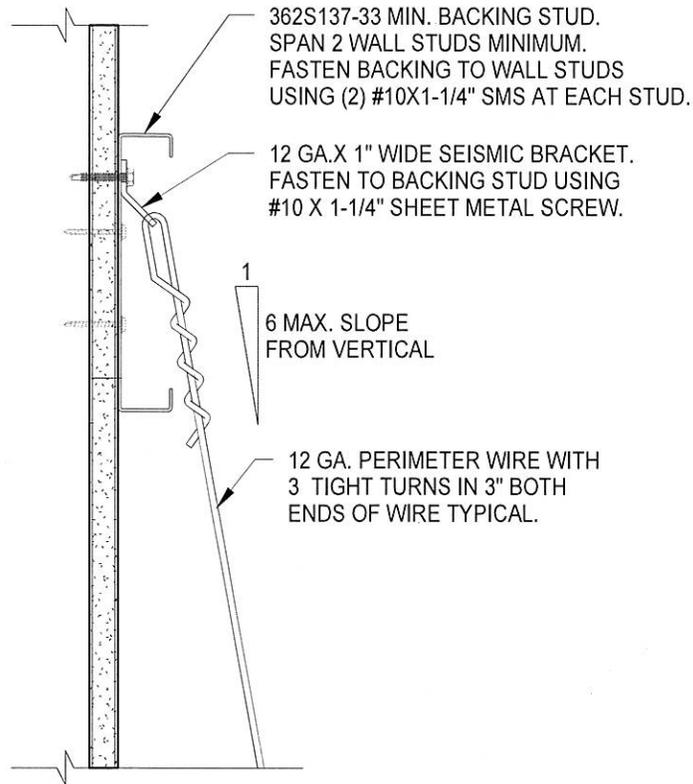

NOTES:

1. THIS IS APPLIED FOR PERIMETER WIRE ATTACHEMENT OR WHERE OBSTRUCTION PREVENTS ATTACHMENT TO STRUCTURE ABOVE, AND IS BETWEEN WALL STUDS
2. RDP SHALL DESIGN FRAMING WALL TO CARRY THE CEILING LOADS

HANGER WIRE



REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED .

[Handwritten Signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL4.10
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : HANGER WIRE CONNECTION TO METAL STUD WALL FRAMING		

STRUCTURAL CONDITION OF FLOOR / ROOF ABOVE SUSPENDED CEILING	APPLICABLE DETAIL
CONCRETE FILLED METAL DECK	CL5.2
NOT USED	CL5.3
CONCRETE SLAB, BEAM, OR JOIST	CL5.4
STRUCTURAL STEEL	CL5.5
SAWN TIMBER WITH GYPSUM BOARD	CL5.6
SAWN TIMBER WITHOUT GYPSUM BOARD	CL5.7




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION


Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : COMPRESSION STRUT CONNECTION - CONNECTION MATRIX		CL5.1

5/1/2013 12:16:50 AM

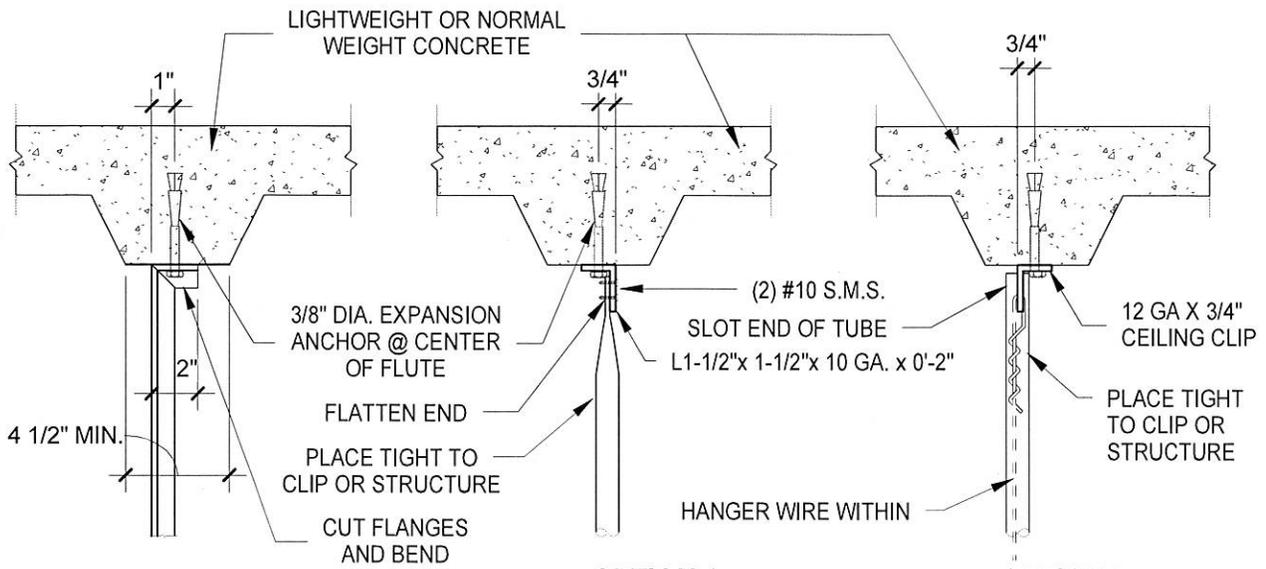

CHANNEL STRUT

TUBE STRUT

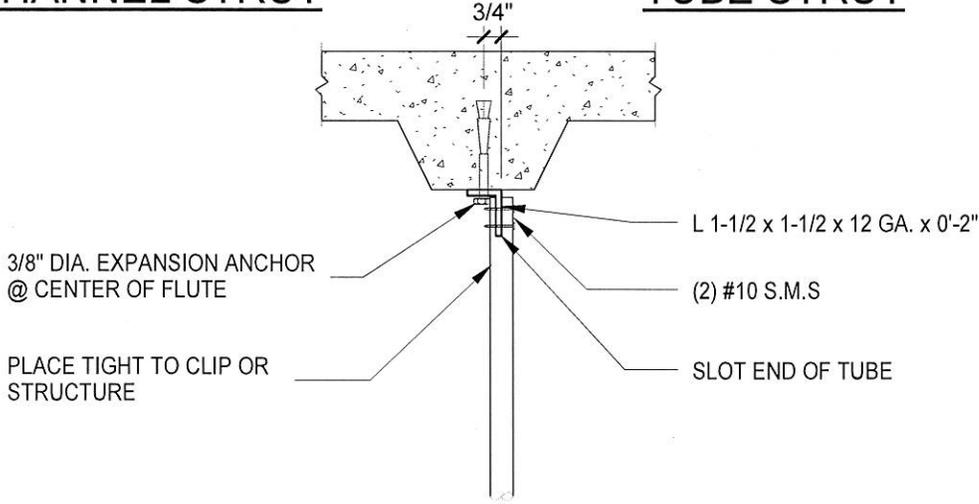

OPTION 3

TUBE STRUT




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION


Code : 2010 CBC	Issue Date : 04/25/2013	OPD No.
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : COMPRESSION STRUT CONNECTION TO CONCRETE FILLED METAL DECK		
		CL5.2

5/1/2013 12:16:50 AM

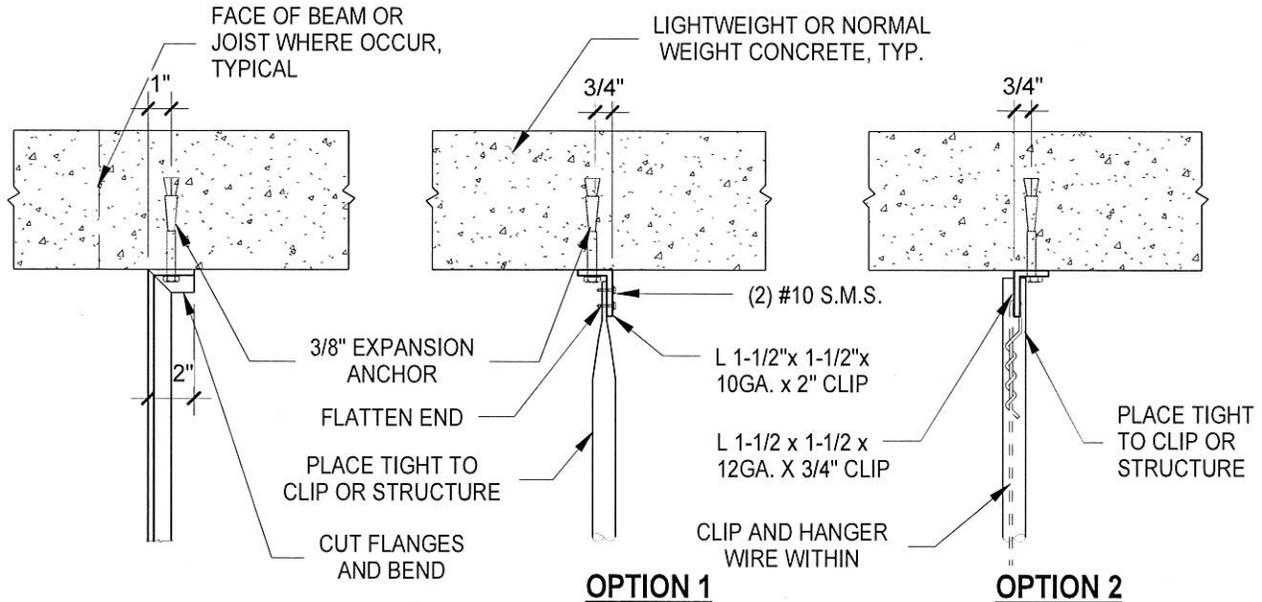

CHANNEL STRUT

TUBE STRUT

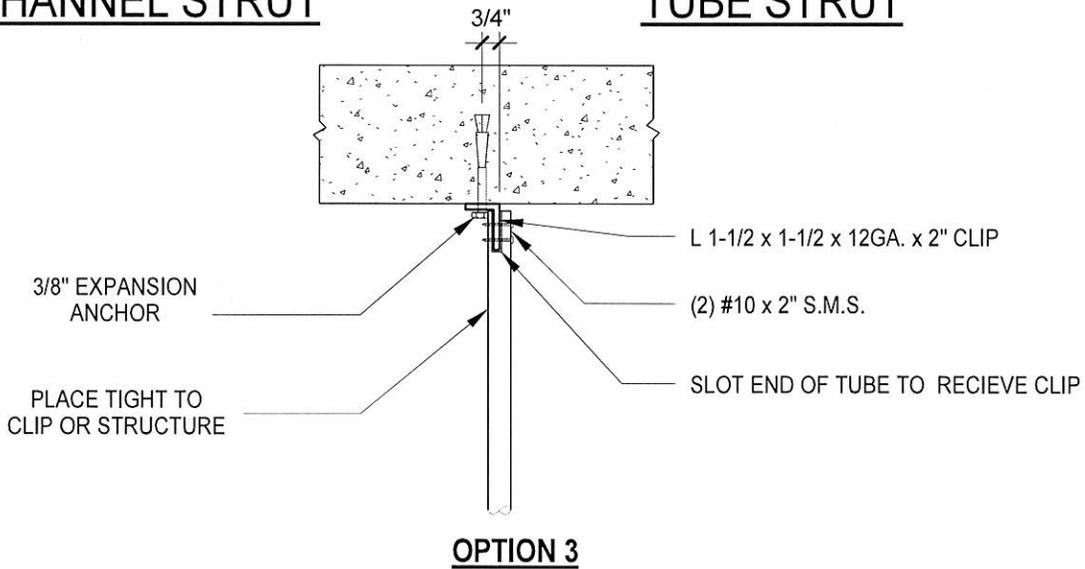

TUBE STRUT




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten Signature]


Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL5.4
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : COMPRESSION STRUT CONNECTION TO CONCRETE SLAB, BEAM, JOIST SOFFIT		

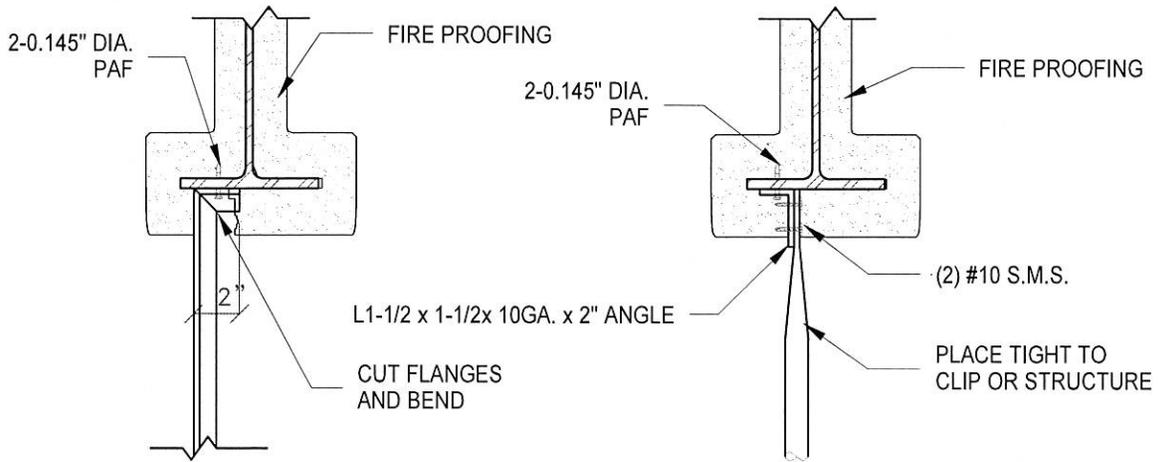

CHANNEL STRUT

OPTION 1

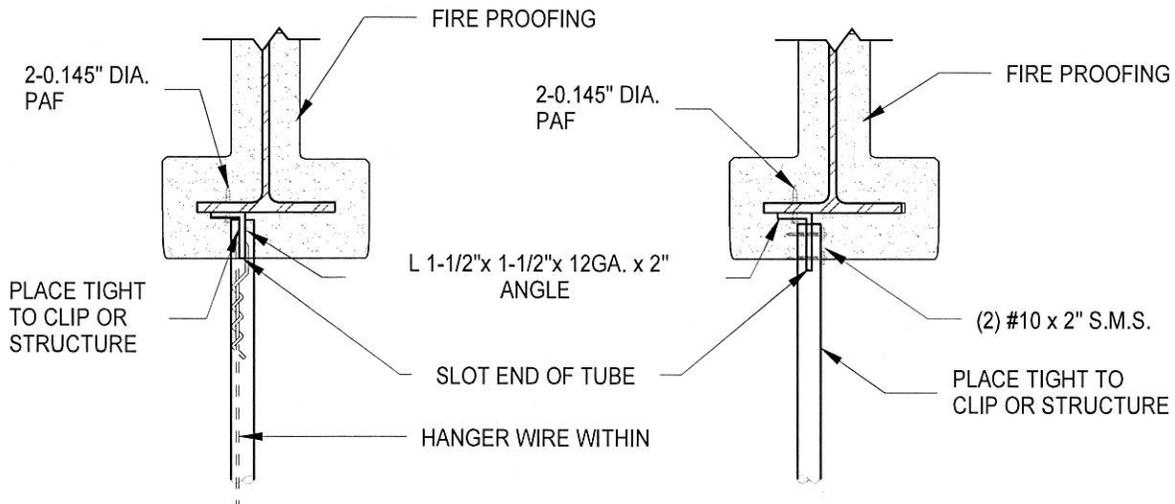

OPTION 2

OPTION 3

TUBE STRUT

NOTES:

1. STRUCTURAL STEEL MEMBER SHALL HAVE A MINIMUM FLANGE THICKNESS OF 3/16" AND MAXIMUM OF 3/8"

2. FRAMING MEMBERS MUST BE DESIGNED TO CARRY THE CEILING LOADS, RDP TO VERIFY

3. RDP IN RESPONSIBLE CHARGE, I.O.R. AND CONTRACTOR SHALL VERIFY THAT NO PAF IS INSTALLED IN THE PROTECTED ZONE OF ANY STEEL MEMBER, SEE ANSI/AISC 341-05 SECTION 7.4

4. SEE PAGES CL5.2 AND CL5.4 FOR ADDITIONAL INFORMATION




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

[Handwritten signature]


Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : COMPRESSION STRUT CONNECTION TO STRUCTURAL STEEL		
		CL5.5

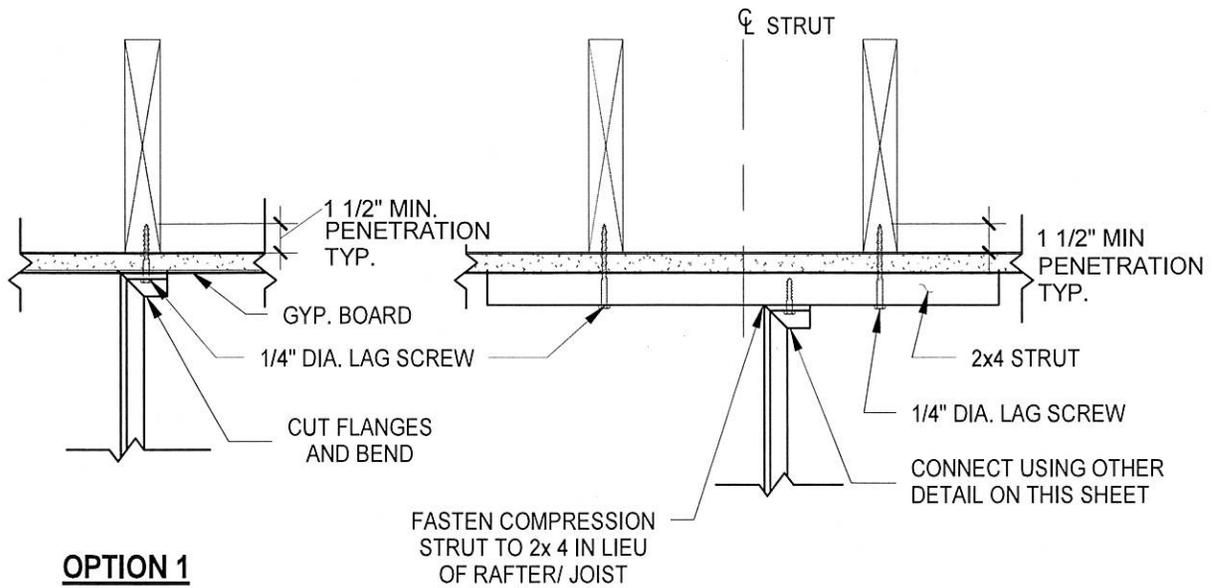

CHANNEL STRUT

CHANNEL STRUT

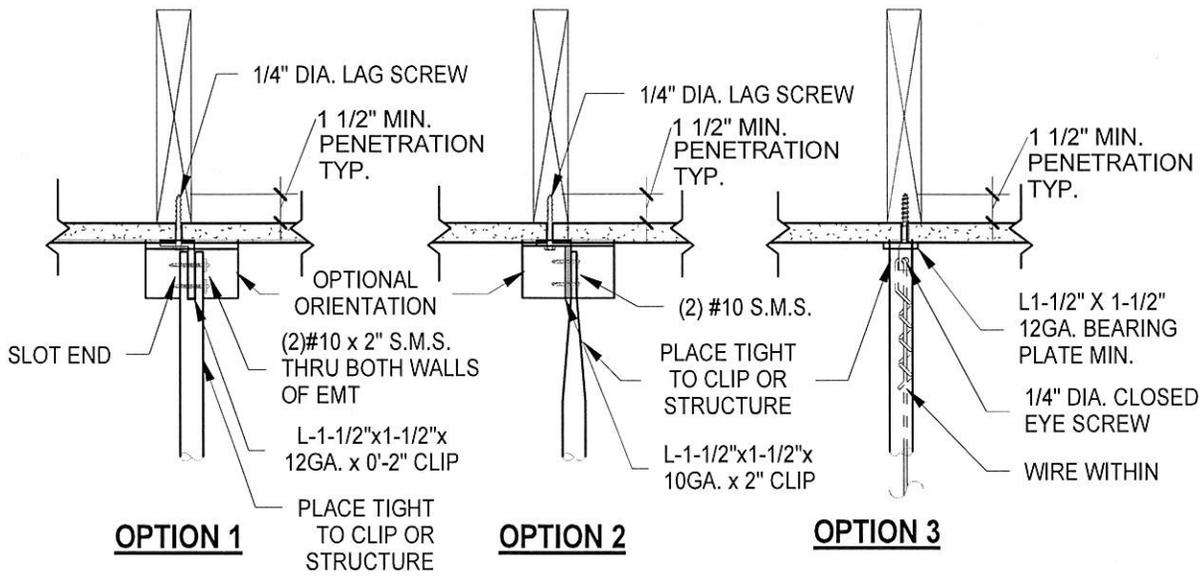

TUBE STRUT




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION


- NOTES:
1. FRAMING MEMBERS MUST BE DESIGNED TO CARRY THE CEILING LOADS, RDP TO VERIFY.
 2. RDP SHALL VERIFY THAT SCREWS AT THE BOTTOM FLANGE OF TRUSS IS ACCEPTABLE
 3. SEE PAGES CL5.2 AND CL5.4 FOR ADDITIONAL INFORMATION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : COMPRESSION STRUT CONNECTION TO SAWN TIMBER WITH GYPSUM BOARD		
		CL5.6

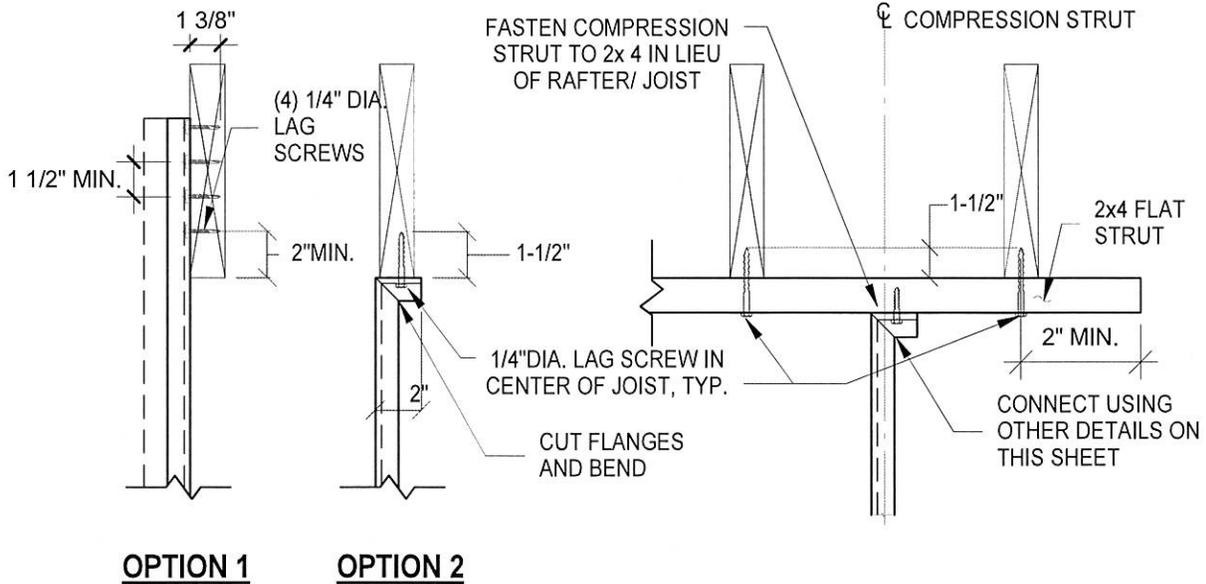

CHANNEL STRUT

CHANNEL STRUT

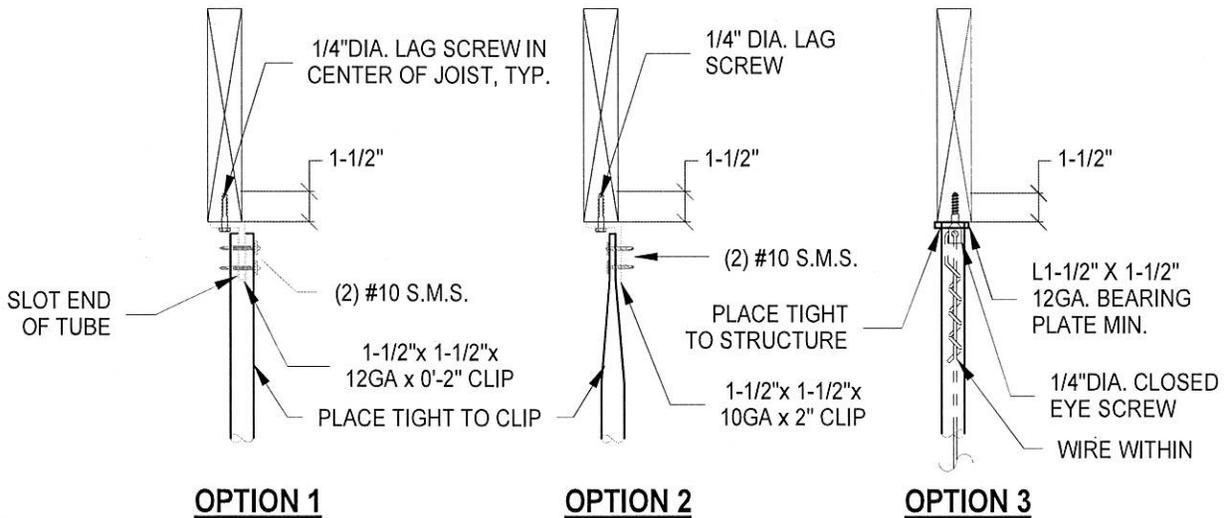

TUBE STRUT

NOTES:


1. FRAMING MEMBERS MUST BE DESIGNED TO CARRY THE CEILING LOADS, RDP TO VERIFY.
2. RDP SHALL VERIFY THAT SCREWS AT THE BOTTOM FLANGE OF TRUSS IS ACCEPTABLE
3. SEE PAGES CL5.2 CL5.4 AND CL5.6 FOR ADDITIONAL INFORMATION




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24. CCR
APPROVED

[Handwritten Signature]
Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : COMPRESSION STRUT CONNECTION TO SAWN TIMBER WITHOUT GYPSUM BOARD		
		CL5.7

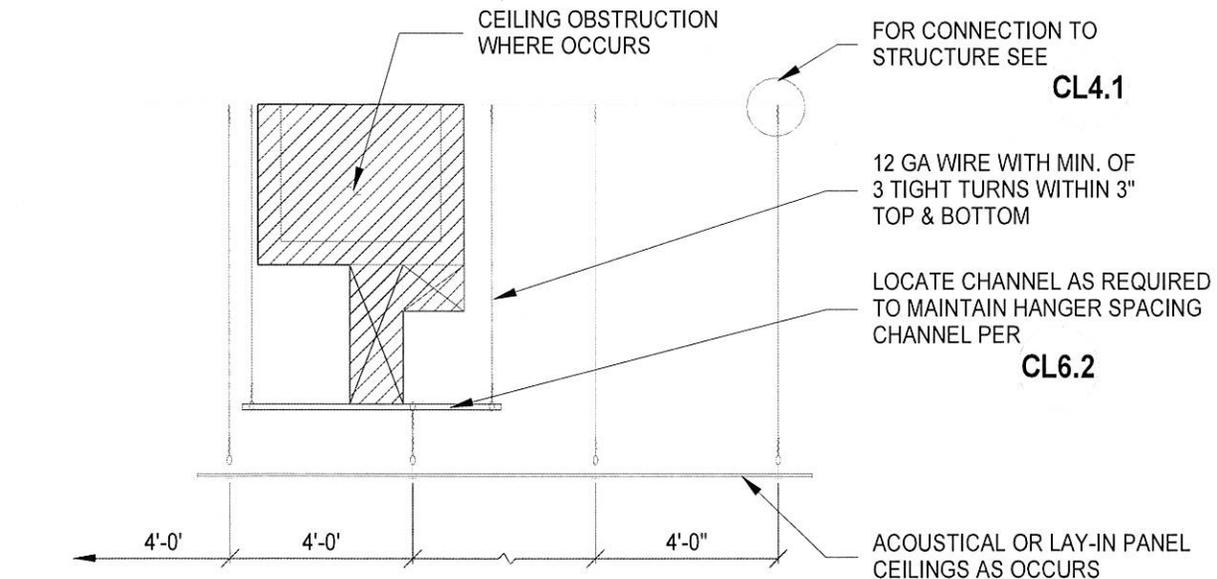

TRAPEZE SUPPORT

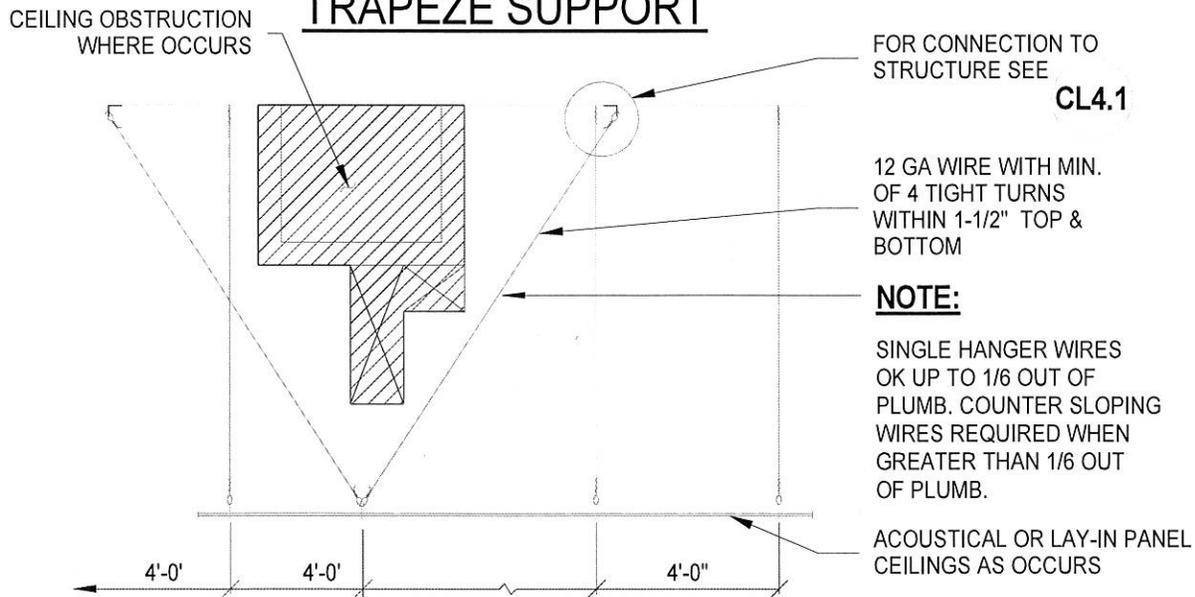

COUNTER SLOPING WIRES





REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-COUNTER SLOPING WIRES AND TRAPEZE CONDITION		
		CL6.1

5/1/2013 12:16:53 AM

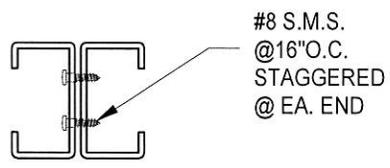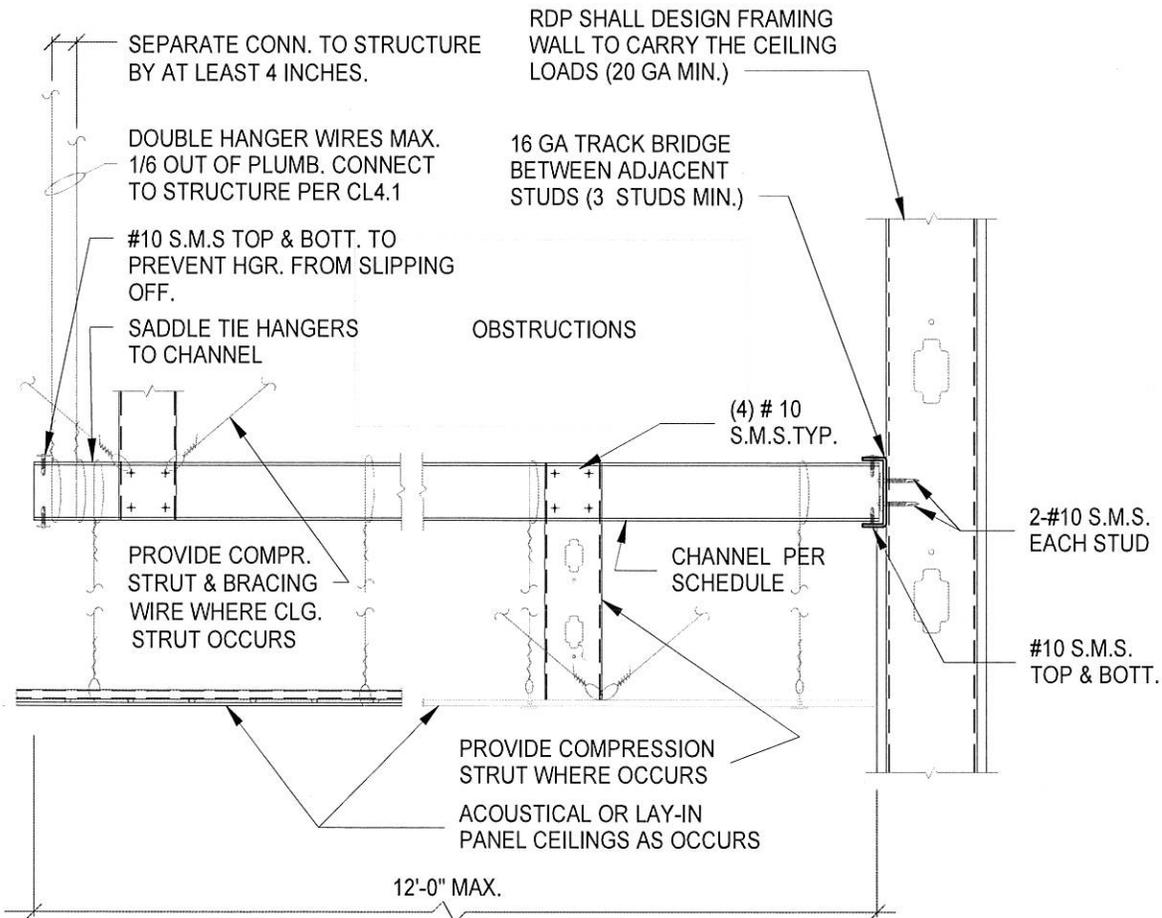

DBL. SECTION

WALL WHERE OCCURS

SPAN	SECTION
4'-0"	250S137-33
6'-0"	250S137-54
8'-0"	400S137-54
10'-0"	400S162-54
12'-0"	2 - 400S200-54




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No:
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-BRIDGE AT LARGE OFFSET CONDITION		
		CL6.2

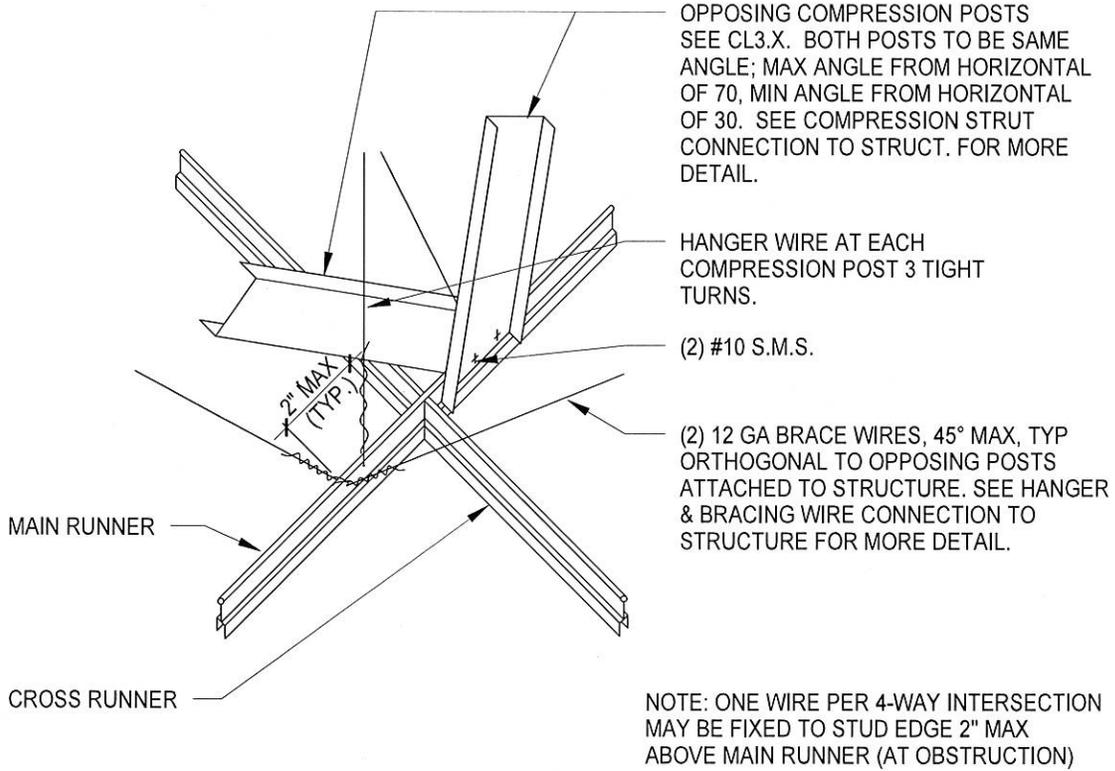

OPPOSING COMPRESSION POST FOR ACOUSTICAL CEILING




REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24, CCR APPROVED

[Handwritten Signature]

Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL6.3
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-COUNTER SLOPING COMPRESSION STRUTS		

5/1/2013 12:16:53 AM

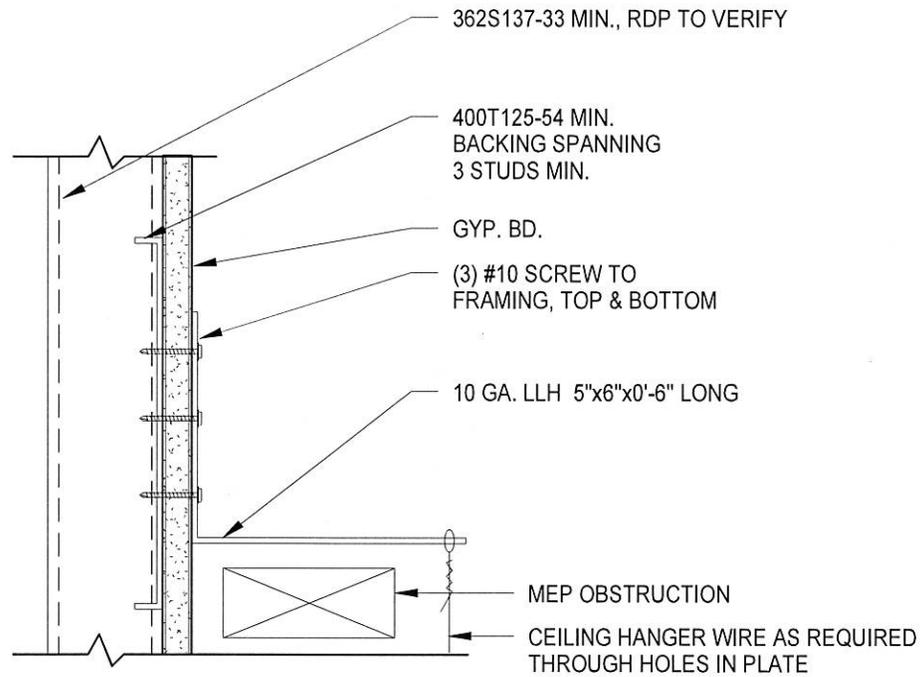

NOTE:
 AT LOCATIONS WHERE IN-WALL BACKING IS NOT PROVIDED, INSTALL 600T125-54 SPANNING 3 STUDS MIN. ON THE OUTSIDE OF GYP. BD, FASTEN TO WALL STUD USING (3) #10 S.M.S. AT EACH STUD.

EXTENDED CLIP AT OBSTRUCTIONS

WHEN OBSTRUCTIONS OCCURRED BOTH AT THE WALL AND ABOVE THE GRID AT THE PERIMETER HANGER WIRE.




REVIEWED IN ACCORDANCE WITH
 THE REQUIREMENTS OF T24, CCR
 APPROVED


[Handwritten Signature]

Office of Statewide Health
 Planning & Development
 FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL6.4
Section Title : SPECIAL DETAILS OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-PERIMETER CONDITION		

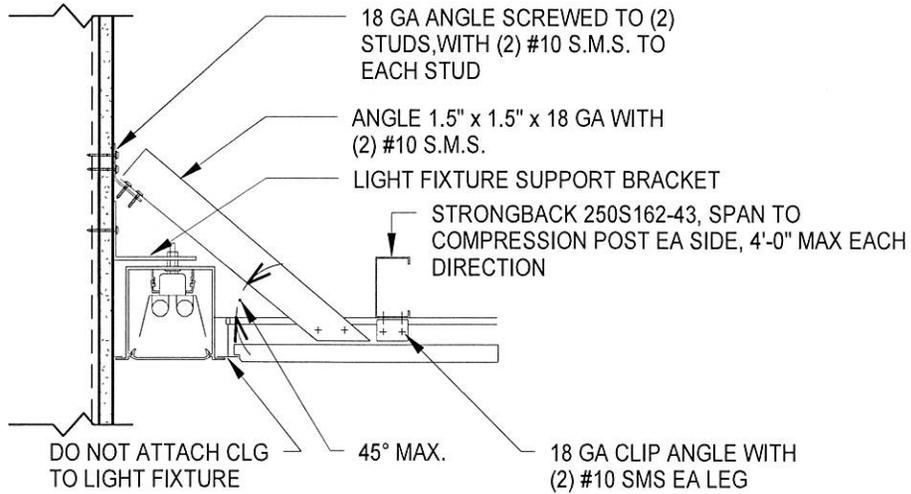

LOCATIONS WITHOUT CROSS JOISTS

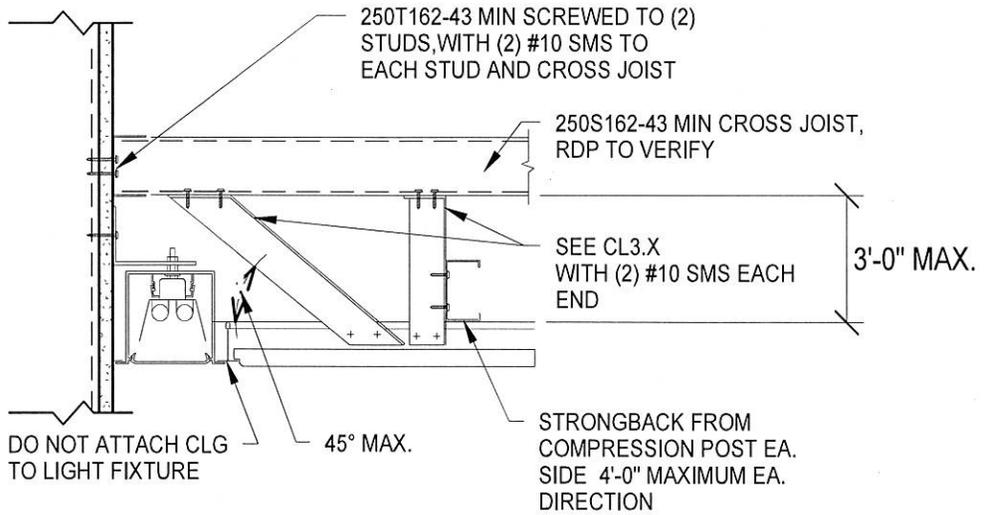

LOCATIONS WITHOUT CROSS JOISTS



REVIEWED IN ACCORDANCE WITH THE REQUIREMENTS OF T24. CCR APPROVED

[Handwritten signature]


Office of Statewide Health Planning & Development FACILITIES DEVELOPMENT DIVISION

NOTES:

1. RDP SHALL DESIGN CROSS JOIST, STRONGBACK, COMPRESSION POST AND SUPPORTING WALL
2. DETAILS IN THIS PAGE ARE ONLY PERMITTED AT THE FIXED END OF THE CEILING AND ARE NOT PERMITTED AT THE EXPANSION JOINT

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL6.5
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-RECESSED LIGHT AT PERIMETER		

5/1/2013 12:16:54 AM

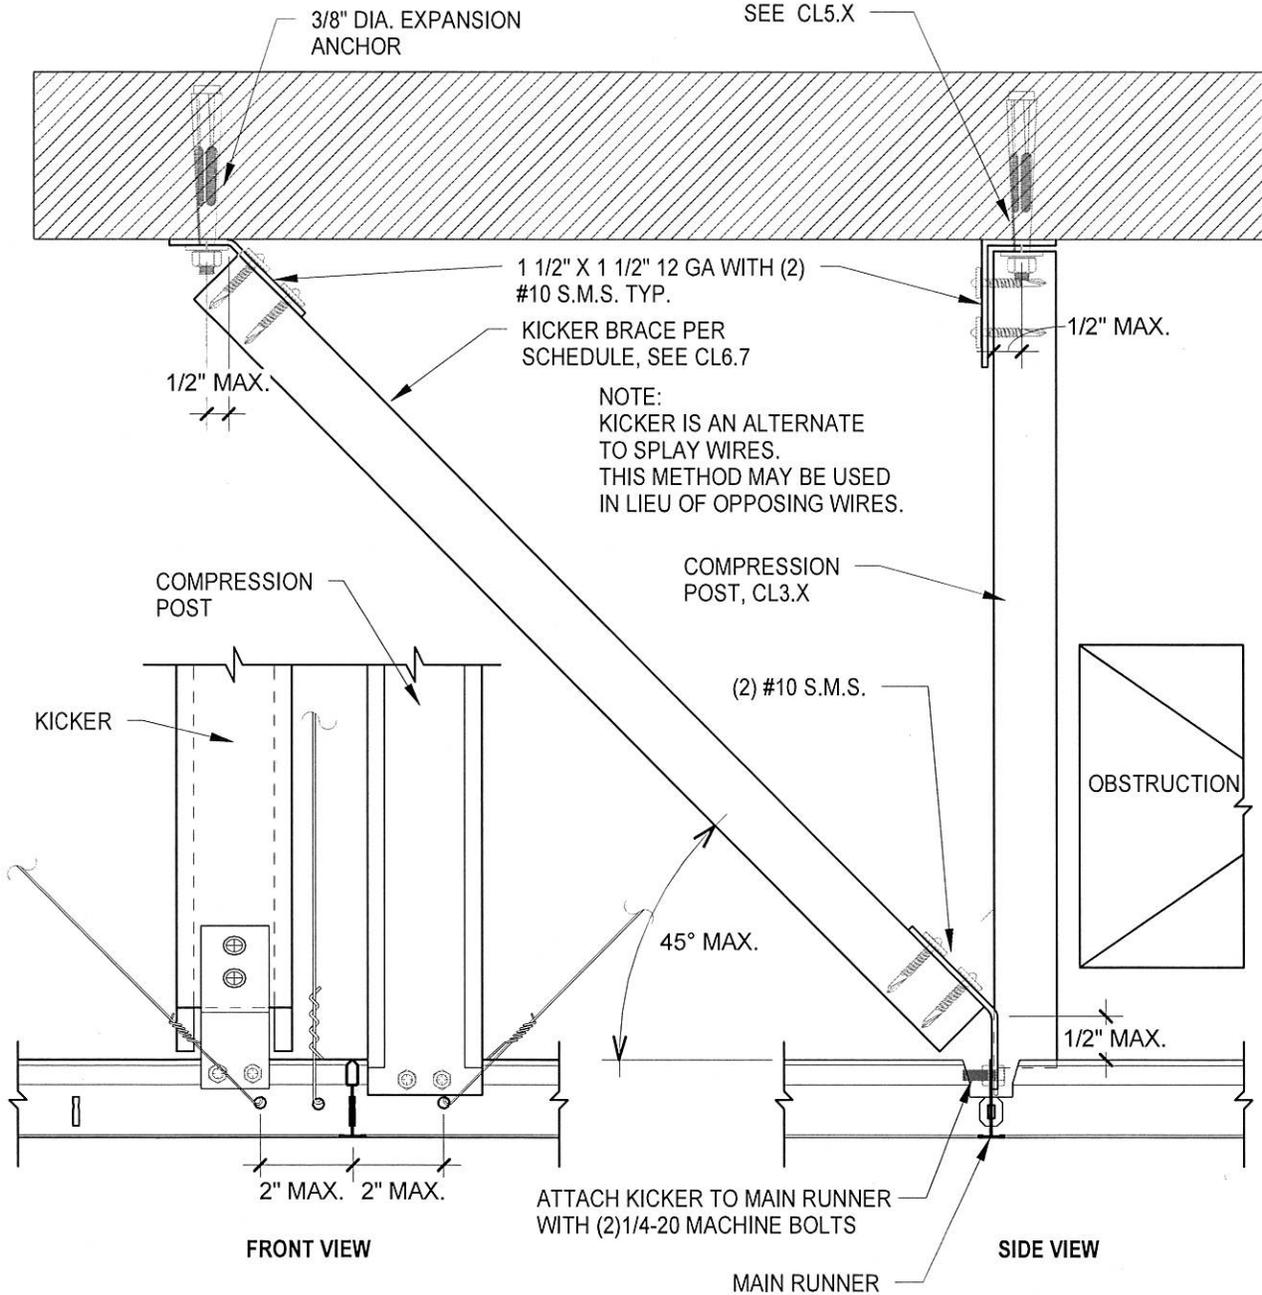

**T-BAR CEILING - WIRE
OBSTRUCTION DETAIL W/STUD
BRACE, LESS BRACING WIRES,
TO DECK.**




REVIEWED IN ACCORDANCE WITH
THE REQUIREMENTS OF T24, CCR
APPROVED

[Handwritten signature]

Office of Statewide Health
Planning & Development
FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL6.6
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-STUD BRACE TO OVERHEAD		

5/1/2013 12:16:55 AM

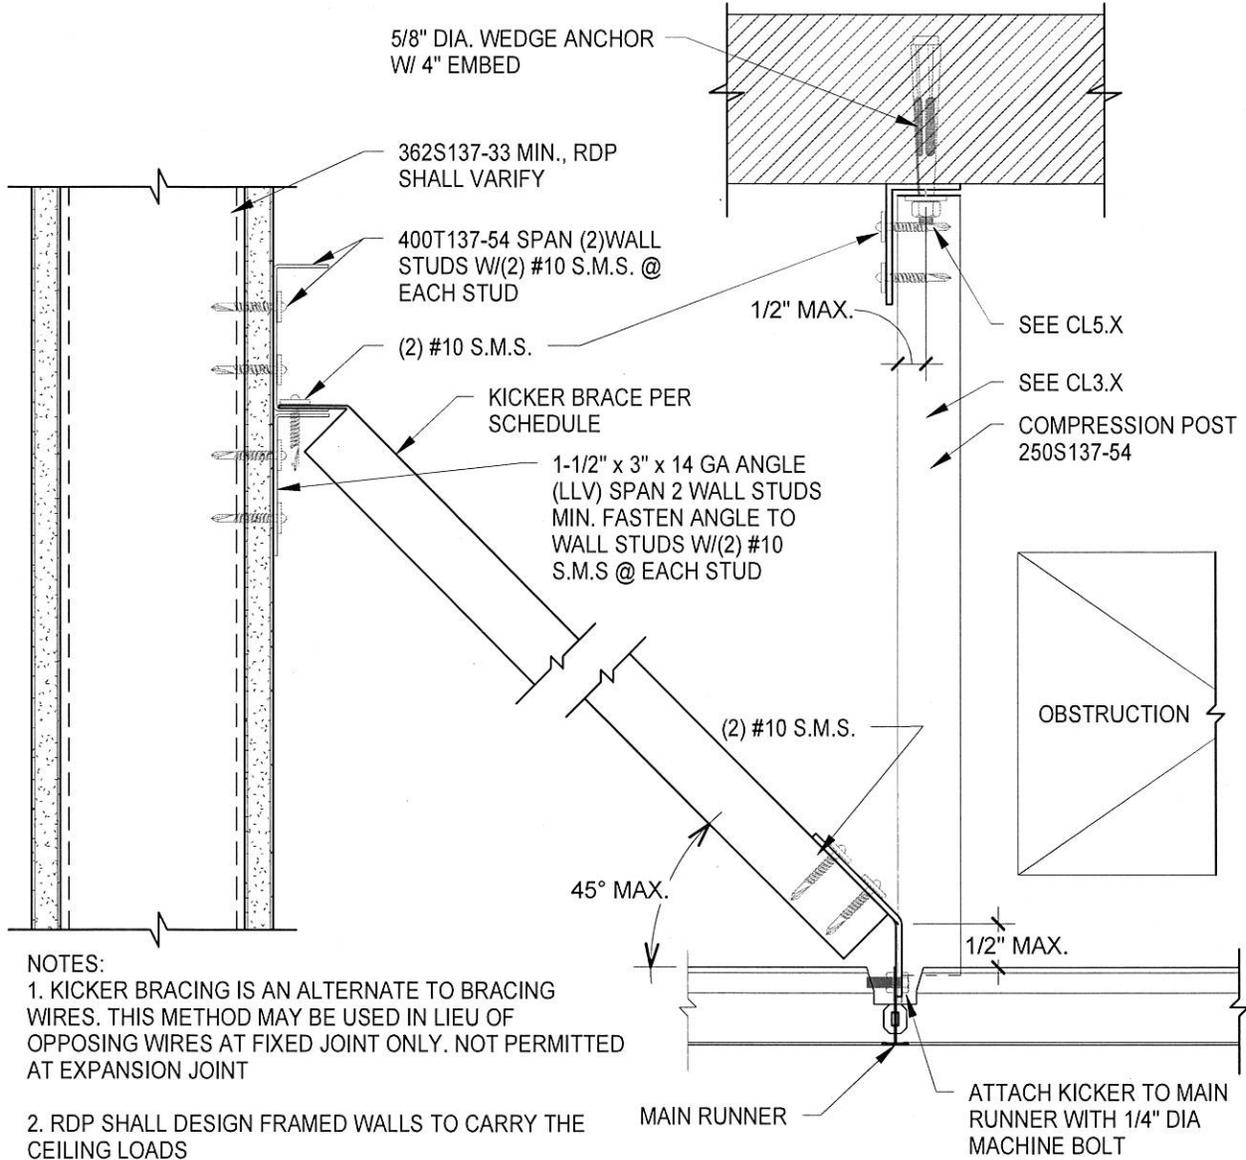


- NOTES:**
1. KICKER BRACING IS AN ALTERNATE TO BRACING WIRES. THIS METHOD MAY BE USED IN LIEU OF OPPOSING WIRES AT FIXED JOINT ONLY. NOT PERMITTED AT EXPANSION JOINT
 2. RDP SHALL DESIGN FRAMED WALLS TO CARRY THE CEILING LOADS

KICKER SCHEDULE			
	SPAN	MATERIAL	SSMA
≤	4'-0"	18 GA	250S137-43
≤	8'-0"	18 GA	400S162-43
≤	14'-0"	16 GA	400S162-54

SIDE VIEW

T-BAR CEILING - WIRE
OBSTRUCTION DETAIL W/STUD
BRACE, LESS BRACING WIRES,
TO WALL


 REVIEWED IN ACCORDANCE WITH
 THE REQUIREMENTS OF T24, CCR
 APPROVED

 Office of Statewide Health
 Planning & Development
 FACILITIES DEVELOPMENT DIVISION

Code : 2010 CBC	Issue Date : 04/25/2013	OPD No: CL6.7
Section Title : OSHPD STANDARD SUSPENDED CEILING DETAILS	Revision : Date :	
Sheet Title : OBSTRUCTION-STUD BRACE TO WALL		