



OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT
FACILITIES DEVELOPMENT DIVISION

**APPLICATION FOR OSHPD SPECIAL SEISMIC
CERTIFICATION PREAPPROVAL (OSP)**

OFFICE USE ONLY

APPLICATION #: OSP – 0403 – 10

OSHPD Special Seismic Certification Preapproval (OSP)

Type: New Renewal

Manufacturer Information

Manufacturer: GE Energy

Manufacturer's Technical Representative: William Elliott

Mailing Address: 7000 W. Bert Kouns Industrial Loop, Shreveport, LA 71129

Telephone: (318) 683-5291

Email: William.elliottjr@ge.com

Product Information

Product Name: GE Network Transformer

Product Type: Liquid Filled Transformer

Product Model Number: See Attachments

(List all unique product identification numbers and/or part numbers)

General Description: Floor mounted

Mounting Description: Rigid floor mounted - welded

Applicant Information

Applicant Company Name: W.E. Gundy & Associates, Inc.

Contact Person: David Gundy, PE

Mailing Address: 250 Bobwhite Ct, Suite 100, Boise, ID 83706

Telephone: (208) 342-5898 Ext. 113

Email: dgundy@wegai.com

I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2013.

Signature of Applicant: 


Date: 6/12/2014

Title: Vice President

Company Name: W.E. Gundy & Associates, Inc.

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY
OSH-FD-759 (REV 6/14/13)



osHPD

Page 1 of 3



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT
FACILITIES DEVELOPMENT DIVISION**

California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)

Company Name: W.E. Gundy & Associates, Inc.

Name: Travis Soppe, SE California License Number: S6115

Mailing Address: 250 Bobwhite Ct, Suite 100, Boise, ID 83706

Telephone: (208) 342-5898 Ext. 115 Email: tsoppe@wegai.com

Supports and Attachments Preapproval

- Supports and attachments are preapproved under OPM- _____
(Separate application for OSHPD Preapproval of Manufacturer's Certification (OPM) of Supports and attachments is required)
- Supports and attachments are not preapproved

Certification Method

- Testing in accordance with: ICC-ES AC156
- Other (Please Specify): _____
- _____
- _____

Testing Laboratory


Company Name: Clark Testing Laboratory

Contact Name: John R. Antenucci

Mailing Address: 1801 Route 51, Jefferson Hills, Pennsylvania 15025

Telephone: (412) 387-1004 Email: jrantenucci@clarktesting.com

Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dvnamic Needs





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT
FACILITIES DEVELOPMENT DIVISION**

Seismic Parameters

Design in accordance with ASCE 7-10 Chapter 13: Yes No

Design Basis of Equipment or Components (F_p/W_p) = 1.125

S_{DS} (Design spectral response acceleration at short period, g) = 2.50

a_p (In-structure equipment or component amplification factor) = 1.0

R_p (Equipment or component response modification factor) = 2.5

Ω_0 (System overstrength factor) = 2.5

I_p (Importance factor) = 1.5

z/h (Height factor ratio) = 0.0

Equipment or Component Natural Frequencies (Hz) = See Attachments

Overall dimensions and weight (or range thereof) = See Attachments

Equipment or Components @ grade designed in accordance with ASCE 7-10 Chapter 15: Yes No

Design Basis of Equipment or Components (V/W) = _____

S_{DS} (Design spectral response acceleration at short period, g) = _____

S_{D1} (Design spectral response acceleration at 1 second period, g) = _____

R (Response modification coefficient) = _____

Ω_0 (System overstrength factor) = _____

C_d (Deflection amplification factor) = _____

I_p (Importance factor) = 1.5

Height to Center of Gravity above base = _____

Equipment or Component Natural Frequencies (Hz) = _____

Overall dimensions and weight (or range thereof) = _____

Tank(s) designed in accordance with ASME BPVC, 2010: Yes No

List of Attachments Supporting Special Seismic Certification

Test Report(s) Drawings Calculations Manufacturer's Catalog

Other(s) (Please Specify): _____

OSHPD Approval (For Office Use Only) – Approval Expires on December 31, 2019

Signature:  Date: March 9, 2015

Print Name: Timothy J. Piland Title: SSE

Special Seismic Certification Valid Up to : S_{DS} (g) = 2.50 z/h = 0

Condition of Approval (if applicable): _____



**GE NETWORK TRANSFORMERS
CERTIFIED PRODUCT LINE MATRIX**



ID Number	Power Rating (kVA)	HV Rating (kV)	Main Tank Width (in)	Main Tank Depth (in)	Main Tank Height (in)	Max Oil Weight (lbs)	Maximum Service Weight (lbs)	Representative UUT
NS40G41AC7B1MB	500	12	69.1	38.7	61.3	1680	7780	UUT 2
NS41G41AC7B1MA	750	12	69.5	46.9	70.3	2150	9350	interpolated
NS41G41CL7B1MA	750	12	66.1	46.9	70.3	2120	9020	interpolated
NS41T08AL7B1MA	750	34.5	66.1	50.7	70.3	2280	10030	interpolated
NS42G41CL7B1MA	1000	12	73.1	49.8	72.3	2620	11120	interpolated
NS42H11CD1X9MA	1000	13.75	90.1	54.3	79.4	3225	12900	UUT-3
NS42T08AL7B1MA	1000	34.5	73.1	45.7	84.3	3300	12100	interpolated
NS44G41CL7B1MA	1500	12	82.8	53.9	77.3	3170	15620	interpolated
NS44T08AL7B1MA	1500	34.5	92.8	57.0	88.3	5340	19340	interpolated
NS46G41CL7B1MA	2000	12	96.9	63.8	79.3	4500	21200	interpolated
NS46T08AL7BMA	2000	34.5	92.8	56.9	88.3	5030	22400	UUT 1

**GE NETWORK TRANSFORMER PRODUCT LINE
CERTIFIED SUBCOMPONENT MATRIX**



Subcomponent ID Number	Manufacturer	Width/ Diameter (in)	Depth (in)	Height (in)	Bolted/ Welded	Weight (lbs)	UUT
------------------------	--------------	-------------------------	------------	-------------	-------------------	--------------	-----

HV Bushing (*1)

1900K502P39	Elastimold (K1601-PC-S1-R)	2.6		4.4	Welded	1.0	UUT 1
1900K502P40	Elastimold (L1601-PC-S1-R)	2.6		4.4	Welded	1.2	UUT 2
1900K502P43	Elastimold (K1601-PC-T1-R)	2.6		10.9	Welded	2.0	interpolated
1900K502P49	Elastimold (L1601-PC-T1-R)	2.6		10.9	Welded	2.0	interpolated
1900K544P21	Elastimold (600T1)	4.5		14.9	Welded	4.0	UUT3
1900K544P24	Elastimold (K600T1)	4.5		14.9	Welded	4.0	interpolated
7904A108G01	Piedmont (402408-K01)	3.8		11.4	Bolted	4.5	UUT3

Bushings are tapered cylindrical shape, "width" = max. diameter, "height" = length

LV Bushing (*1)

7800K089G01	OLG	4.0		7.5	Welded	5.2	UUT 1
7800K090G01	OLG	4.5		8.1	Welded	9.3	UUT 2 & 3

Bushings are cylindrical shape, with 4.0" diameter, 7.5" long

Neutral Bushing

7804B090P06	EPC (10-090-099)	4.0	0.5	13.1	Bolted	13.8	UUT 1 & 2
7804B090P12	EPC (10-110-104E07T-01)	6.0	6	21.4	Bolted	38.6	UUT 3

Panel Radiators

7634B560G31 & 32	General Electric	61.0	1.12	43.0	Welded	506	UUT 1
	General Electric	58.0	1.12	50.0	Welded		interpolated
7634B810G05	General Electric	65.0	1.12	55.0	Welded	708	UUT 3
	General Electric	65.0	1.12	64.0	Welded		interpolated
	General Electric	58.0	1.12	53.0	Welded		interpolated
	General Electric	74.0	1.12	57.0	Welded		interpolated
	General Electric	84.0	1.12	69.0	Welded		interpolated
	General Electric	88.0	1.12	60.0	Welded		interpolated
7634B735G18 & 22	General Electric	84.0	1.12	69.0	Welded	1074	UUT 2

Weights are per panel

Thermometer (*1)

9530K001G01	Qualitrol (150-002-01)	4.20		7.1	Screwed	5.2	UUT 1 - 3
-------------	------------------------	------	--	-----	---------	-----	-----------

Circular dial-faced gauge 4.22" diameter, 5.50" stem screws into flange on tank, 7.12" total length


**GE NETWORK TRANSFORMER PRODUCT LINE
CERTIFIED SUBCOMPONENT MATRIX**



Subcomponent ID Number	Manufacturer	Width/ Diameter (in)	Depth (in)	Height (in)	Bolted/ Welded	Weight (lbs)	UUT
Grounding Switch							
8504B111P51	Huaming (2HM2060.4051.51)	19.10	11.30	17.45	Screwed	88.0	UUT 3
Pressure Sensor (*1)							
8730A001P30	Qualitrol (TRN-013-1)	1.1		3.8	Screwed	3.7	UUT 1 & 2
Sensor is cylindrical with 1.07" diameter, 3.78" tall, screws into 0.25" NPT threads on cover, 16 foot cable							
Liquid Level Gauge (*1)							
8731A010P21	Qualitrol (030-048-01)	3.0		0.8	Welded/ Bolted	1.0	UUT 1 - 3
Liquid Level Gauge has circular dial-face, "width" = diameter, "height" = thickness (of dial). Internal drive assembly is welded inside tank, and dial-face is bolted onto flange on exterior of tank.							
Notes: (*N = note number applicable to section) 1) Non-square parts have notes below them defining the dimensions to be a diameter, thickness, etc. 2) Series of parts with approximately (very close) weights & dimensions have been generalized as "Pxx", "Gxx", etc. to indicate the whole part family conforms. For exmple, see the Transformer Grounding Switches							

UUT-1**UNIT UNDER TEST (UUT)
SUMMARY SHEET**

Mounting Details: Floor mounted with 6 - 8" Long 3/8" Fillet Welds, 1 at each end and 1 at the center of each I-beam with 4 - 1" Long 3/8" End Return Fillet Weld at the outside of each end of each I-beam

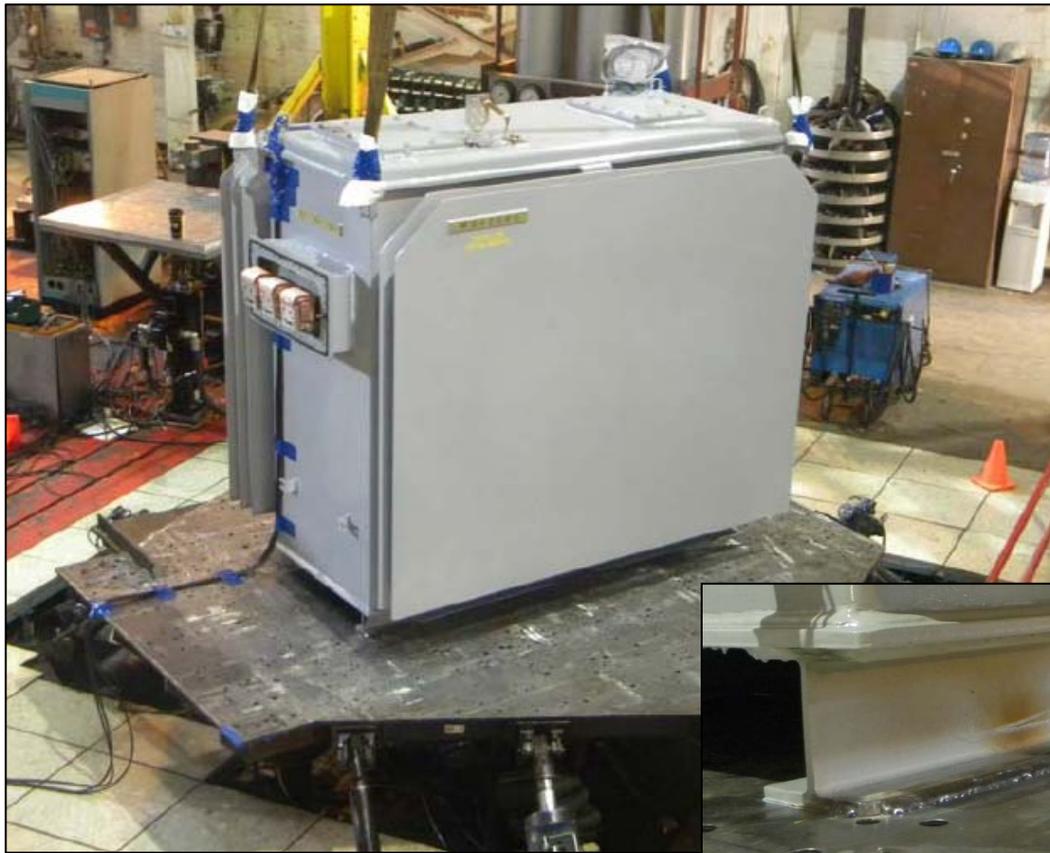

Manufacturer: GE Energy

Product Line: Network Transformer Product Line

Identification Number: M262663 (SR# Q780562-UKF)

UUT Function: 34.5kV Submersible Distribution Power Transformer

UUT Description: The unit is a standalone unit constructed of an oil filled steel main tank supported by steel wideflange beams, internal core and coils, and attached components.

UUT Component Description: The unit contains a lead Core with copper Coils and is fitted with Elastimold (K600T1) HV Bushings, OLG LV Bushings, EPC (10-090-099) Neutral Bushings, GE Panel Radiators, Qualitrol (150-002-01) Thermometer, Qualitrol (TRN-013-1) Pressure Sensor, Qualitrol (030-048-01) Liquid Level Gage.

UUT PROPERTIES

Weight (lb)	Dimensions (inches)			Natural Frequency (Hz)		
	Unit Width	Unit Depth	Unit Height	FB	SS	V
22,400	92.8	56.9	88.3	14.6	8.1	19

SEISMIC TEST PARAMETERS

Test Criteria	S_{DS}	z/h	I_p	A_{FLX-H}	A_{RIG-H}	A_{FLX-V}	A_{RIG-V}
ICC-ES AC156 2012	2.50g	0.0	1.5	2.50g	1.00g	1.68g	0.67g

Note: The Transformer was tested full of oil and maintained structural integrity and functionality after the ICC-ES AC156 test.

UUT-2

UNIT UNDER TEST (UUT) SUMMARY SHEET



Mounting Details: Floor mounted with 6 - 8" Long 3/8" Fillet Welds, 1 at each end and 1 at the center of each I-beam with 4 - 1" Long 3/8" End Return Fillet Weld at the outside of each end of each I-beam



Manufacturer: GE Energy

Product Line: Network Transformer Product Line

Identification Number: M262665 (SR# Q780573-UKF)

UUT Function: 12kV Submersible Distribution Power Transformer

UUT Description: The unit is a standalone unit constructed of an oil filled steel main tank supported by steel wideflange beams, internal core and coils, and attached components.

UUT Component Description: The unit contains a lead Core with aluminum Coils and is fitted with Elastimold (K1601-PC-SI-R) HV Bushings, OLG LV Bushings, EPC (10-090-099) Neutral Bushings, GE Panel Radiators, Qualitrol (150-002-01) Thermometer, Qualitrol (TRN-013-1) Pressure Sensor, Qualitrol (030-048-01) Liquid Level Gage.

UUT PROPERTIES

Weight (lb)	Dimensions (inches)			Natural Frequency (Hz)		
	Unit Width	Unit Depth	Unit Height	FB	SS	V
7,780	69.1	38.7	61.3	23.7	26.6	>33

SEISMIC TEST PARAMETERS

Test Criteria	S _{DS}	z / h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
ICC-ES AC156 2012	2.50g	0.0	1.5	2.50g	1.00g	1.68g	0.67g

Note: The Transformer was tested full of oil and maintained structural integrity and functionality after the ICC-ES AC156 test.

UUT-3

UNIT UNDER TEST (UUT) SUMMARY SHEET



Mounting Details: Floor mounted with 6 - 8" Long 3/8" Fillet Welds, 1 at each end and 1 at the center of each I-beam with 4 - 1" Long 3/8" End Return Fillet Weld at the outside of each end of each I-beam



Manufacturer: GE Energy

Product Line: Network Transformer Product Line

Identification Number: NS42H11CD1X9MA (SR #Q783328-UKG)

UUT Function: 13.75kV Submersible Distribution Power Transformer

UUT Description: The unit is a standalone unit constructed of an oil filled steel main tank supported by steel wideflange beams, internal core and coils, and attached components.

UUT Component Description: The unit contains a silicon-steel Core with copper & aluminum Coils and is fitted with Elastimold (K600T1) HV Bushings, OLG LV Bushings, GE Panel Radiators, Qualitrol (150-002-01) Thermometer, Qualitrol (030-048-01) Liquid Level Gage.

UUT PROPERTIES

Weight (lb)	Dimensions (inches)			Natural Frequency (Hz)		
	Unit Width	Unit Depth	Unit Height	FB	SS	V
12,900	90.1	54.3	79.4	14.8	20.5	>33Hz

SEISMIC TEST PARAMETERS

Test Criteria	S _{DS}	z / h	I _p	A _{FLX-H}	A _{RIG-H}	A _{FLX-V}	A _{RIG-V}
ICC-ES AC156 2012	2.50g	0.0	1.5	2.50g	1.00g	1.68g	0.67g

Note: The Transformer was tested full of oil and maintained structural integrity and functionality after the ICC-ES AC156 test.