



OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION

APPLICATION FOR OSHPD PREAPPROVAL  
OF MANUFACTURER'S CERTIFICATION (OPM)

OFFICE USE ONLY

APPLICATION #: OPM-0261-13

OSHPD Preapproval of Manufacturer's Certification (OPM)

Type: ☒ New ☐ Renewal ☐ Update to Pre-CBC 2013 OPA Number: \_\_\_\_\_

Manufacturer Information

Manufacturer: Chatsworth Products, Inc.

Manufacturer's Technical Representative: Brandi Oldt

Mailing Address: 3004 South Austin Ave., Georgetown, TX. 78626

Telephone: (800) 834-4969

Email: BOldt@chatsworth.com

Product Information

Product Name: Universal & Standard Racks

Product Type: Instrumentation Cabinet

OPM-0261-13

Product Model Number: 46353-X03, 46353-X05, 46353-X15, 55053-X03

General Description: Telecommunication Rack

DATE: 04/18/2016

Applicant Information

Applicant Company Name: EASE Co.

Contact Person: Jonathan Roberson, S.E.

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709

Telephone: (909) 606-7622

Email: J.Roberson@EASECo.com

I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2013.

Signature of Applicant: \_\_\_\_\_

Date: 8/28/15

Title: Principal Engineer

Company Name: EASE Co.

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY  
OSH-FD-700 (REV 1/24/13)

osHPD

Page 1 of 2



**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**Registered Design Professional Preparing Engineering Recommendations**

Company

Name: EASE Co.

Name: Jonathan Roberson, S.E.

California License Number: S4197

Mailing Address: 5877 Pine Ave. Suite 210, Chino Hills, CA. 91709

Telephone: 909-606-7667

Email: J.Roberson@EASECo.com

**OSHPD Special Seismic Certification Preapproval (OSP)**

- ☐ Special Seismic Certification is preapproved under OSP-  
(Separate application for OSP is required)
- ☒ Special Seismic Certification is not preapproved

**Certification Method(s)**

- ☐ Testing in accordance with: ☐ ICC-ES AC156 ☐ FM 1950-10
- ☐ Other\* (Please Specify): \_\_\_\_\_

\*Use of test criteria other than those adopted by the California Building Standards Code, 2013 (CBSC 2013) for component supports and attachments are not permitted. For distribution system, interior partition wall, and suspended ceiling seismic bracings, test criteria other than those adopted in the CBSC 2013 may be used when approved by OSHPD prior to testing.

- ☒ Analysis
- ☐ Experience Data
- ☐ Combination of Testing, Analysis, and/or Experience Data (Please Specify): \_\_\_\_\_

**List of Attachments Supporting the Manufacturer's Certification**

- ☐ Test Report ☒ Drawings ☒ Calculations ☐ Manufacturer's Catalog
- ☐ Other(s) (Please Specify): \_\_\_\_\_

**OFFICE USE ONLY – OSHPD APPROVAL VALID FOR CBC 2013 ONLY**

Signature: William Staehlin Date: 04-18-2016

Print Name: William Staehlin

Title: SSE

Condition of Approval (if applicable): \_\_\_\_\_

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"

STATE OF CALIFORNIA – HEALTH AND HUMAN SERVICES AGENCY  
OSH-FD-700 (REV 1/24/13)

oshpd

Page 2 of 2



**EQUIPMENT ANCHORAGE  
& SEISMIC ENGINEERING**

5877 Pine Ave, Ste. 210  
Chino Hills, CA. 91709  
Phn: (909) 606-7622

Office of Statewide Health Planning and Development  
**PREAPPROVAL OF MANUFACTURER'S CERTIFICATION**  
**OPM-0261-13**

**THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE**

MANUFACTURER: **CHATWORTH PRODUCTS INC.**  
EQUIPMENT NAME: **STANDARD & UNIVERSAL RACKS**

Sheet: 1 of 15

Date: 3/23/16

**GENERAL NOTES**

1. THIS OSHPD PREAPPROVAL OF MANUFACTURER'S CERTIFICATION (OPM) IS BASED ON THE 2013 CBC. THE DEMANDS (DESIGN FORCES) FOR USE WITH THIS OPM SHALL BE BASED ON THE 2013 CBC
2. THIS DOCUMENT MAY ONLY BE USED WITH THE EXPRESS WRITTEN CONSENT OF THE MANUFACTURER LISTED ABOVE FOR THE SPECIFIC PROJECT SITE AND INSTALLATION LOCATION. THIS DOCUMENT IS INVALID WITHOUT SUCH CONSENT.
3. THIS PREAPPROVAL CONFORMS TO THE 2013 CALIFORNIA BUILDING CODE WHERE  $S_{ds}$  IS NOT GREATER THAN 1.55, 1.90 & 2.20. SEE DETAIL FOR APPLICABILITY
4. FORCES PER ASCE 7-10 SECTION 13.3.1, EQUATIONS 13.3-1, 13.3-2 & 13.3-3,  
WHERE  $S_{ds} = 1.55$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h = 0$  AT CONCRETE SLAB. SEE FOLLOWING SHEETS FOR  $\Omega_o$   
WHERE  $S_{ds} = 1.90$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h = 0$  AT CONCRETE SLAB. SEE FOLLOWING SHEETS FOR  $\Omega_o$   
WHERE  $S_{ds} = 2.20$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 2.5$ ,  $z/h \leq 1$  AT CONCRETE SLAB ON METAL DECK.  
SEE FOLLOWING SHEETS FOR  $\Omega_o$
5. THIS PREAPPROVAL COVERS ONLY THE SUPPORTS AND ATTACHMENTS OF THE EQUIPMENT TO THE STRUCTURE.
6. ALL DESIGN FORCES SHOWN ON THE DRAWINGS ARE FACTORED LOADS THAT SHALL BE USED FOR STRENGTH DESIGN.
7. CONCRETE SLAB ON METAL DECK DETAIL VALID FOR DEMANDS SHOWN AT ANY ELEVATION IN THE BUILDING. (i.e.  $z/h \leq 1$ )
8. CONCRETE SLAB ON GRADE DETAIL VALID FOR DEMANDS SHOWN AT ANY ELEVATION BELOW GRADE. (i.e.  $z/h = 0$ )
9. **RESPONSIBILITIES OF THE STRUCTURAL ENGINEER OF RECORD OF THE BUILDING**
  - A. PROVIDE SUPPORTING STRUCTURE TO SUPPORT WEIGHTS AND FORCES SHOWN IN ADDITION TO ALL OTHER LOADS.
  - B. VERIFY THAT THE INSTALLATION IS IN CONFORMANCE WITH THE 2013 CBC AND WITH THE DETAILS, MATERIAL AND GAGE OF THE UNIT WHERE ATTACHMENTS ARE MADE AGREE WITH THE INFORMATION SHOWN ON THE PREAPPROVAL DOCUMENTS.
  - C. VERIFY THAT PROJECT SPECIFIC VALUES OF  $S_{ds}$  &  $z/h$  RESULT IN SEISMIC FORCES ( $E_h$ ,  $E_v$ ) THAT DO NOT EXCEED THE VALUES ON THE DETAILS.
  - D. VERIFY THAT THE CONCRETE SLAB TO WHICH THE EQUIPMENT IS ANCHORED MEETS THE REQUIREMENTS OF THE APPLICABLE ICC ESR.
  - E. VERIFY THAT THE ANCHORS ARE AN ADEQUATE DISTANCE FROM ANY SLAB EDGES OR OPENINGS (SEE TYPICAL DETAIL ON SHEET 2).
  - F. VERIFY THAT ALL NEW OR EXISTING ANCHORS ARE AN ADEQUATE DISTANCE FROM THE UNIT ATTACHMENTS AND CHECK FOR INTERACTION WHERE OTHER ANCHORS ARE WITHIN 18" OR  $6h_{ef}$  FROM THIS UNIT'S ANCHORS.



## CHATWORTH PRODUCTS INC.

## STANDARD &amp; UNIVERSAL RACKS

DES. J. ROBERSON

JOB NO. 11-1453

DATE 3/23/16

SHEET

2

OF 15 SHEETS

## 10. EXPANSION ANCHORS:

- A. ATTACHMENT IS TO BE MADE WITH THE ANCHORS LISTED BELOW AND INSTALLED AS DESCRIBED IN THE CORRESPONDING ICC REPORT.

Anchor Diameter	Concrete Type	Min. f'c (psi)	Anchor Type	ICC Report No.	Min. Embed.	Min. Spacing	Min. Edge Dist.	Min. Conc. Thickness	Torque Test	Direct Tension
3/8"	Sand Light Weight	3000	Hilti Kwik Bolt TZ	ESR-1917	2"	N/A	N/A	See Sheet 13 of 15	25 FT-LB	1186 lb
5/8"	Normal Weight	3000	Hilti Kwik Bolt TZ	ESR-1917	4"	11.5"	24"	6"	60 FT-LB	4445 lb

- B. THIS PREAPPROVAL ALLOWS FOR UP TO A MAXIMUM OF 2 ADJACENT CONCRETE SLAB EDGES, 24" AWAY MINIMUM (i.e. - CORNER). SEE ADJACENT DETAIL FOR ADDITIONAL MINIMUM ALLOWABLE CONCRETE EDGE DISTANCES.

- C. TESTING OF EXPANSION ANCHORS PER 2013 CBC, 1913A.7: TESTING SHALL BE DONE IN THE PRESENCE OF THE SPECIAL INSPECTOR AND A REPORT OF THE TEST RESULTS SHALL BE SUBMITTED TO OSHPD

- (i) AFTER AT LEAST 24 HOURS HAVE ELAPSED SINCE INSTALLATION, DIRECT PULL TENSION TEST OR TORQUE TEST AT LEAST 50% OF THE ANCHORS.

- (ii) ACCEPTANCE CRITERIA:

- DIRECT TENSION TEST: THE ANCHOR SHOULD HAVE NO OBSERVABLE MOVEMENT AT THE TEST LOAD. A PRACTICAL WAY TO DETERMINE OBSERVABLE MOVEMENT IS THAT THE WASHER BECOMES LOOSE.
- TORQUE TEST: THE APPLICABLE TORQUE MUST BE ACHIEVED WITHIN THE FOLLOWING LIMITS: WEDGE TYPE : 1/2 TURN OF THE NUT


- (iii) IF ANY ANCHOR FAILS, TEST ALL ANCHORS.

- D. AVOID DAMAGING EXISTING STEEL REINFORCING IN CONCRETE SLAB WHEN INSTALLING CONCRETE EXPANSION ANCHORS.


- E. PROVIDE FOR FULL THREAD ENGAGEMENT OF NUT & WASHER.

## 11. BOLTS THROUGH CONCRETE ON METAL DECK

- A. BOLTS SHALL BE TORQUED BY 3/4 TURN OF THE NUTS AFTER THE SNUG TIGHT (THE SNUG-TIGHT CONDITION IS DEFINED AS THE TIGHTNESS REQUIRED TO BRING THE CONNECTED PLIES INTO FIRM CONTACT) CONDITION IS ACHIEVED, UNLESS OTHERWISE NOTED.
- B. THROUGH BOLT HOLES SHALL BE 1/16" LARGER THAN BOLT SIZE (HOLE SIZE = BOLT SIZE + 1/16) FOR CONCRETE.
- C. THROUGH-BOLTS IN CONCRETE SHALL RECEIVE SPECIAL INSPECTION AND TESTING (THROUGH BOLTS WITH STEEL TO STEEL CONNECTION IN TENSION DO NOT REQUIRE TENSION TESTING) IN ACCORDANCE WITH REQUIREMENTS FOR POST-INSTALLED ANCHORS.

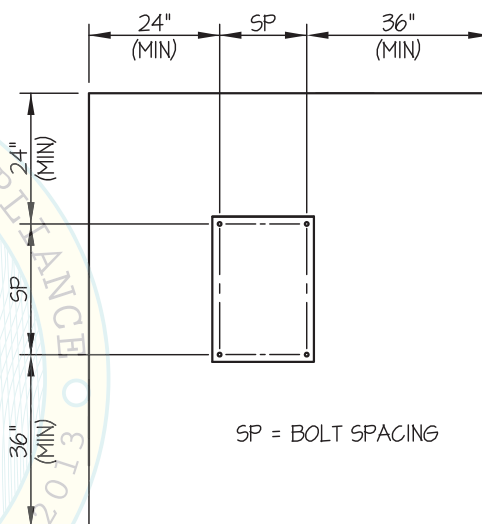

TYPICAL CONCRETE EDGE DETAIL

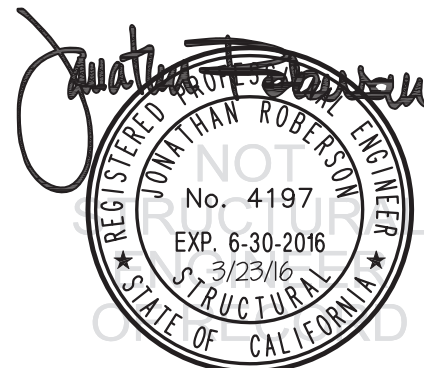

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**


SHEET

**3**

OF **15** SHEETS


SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

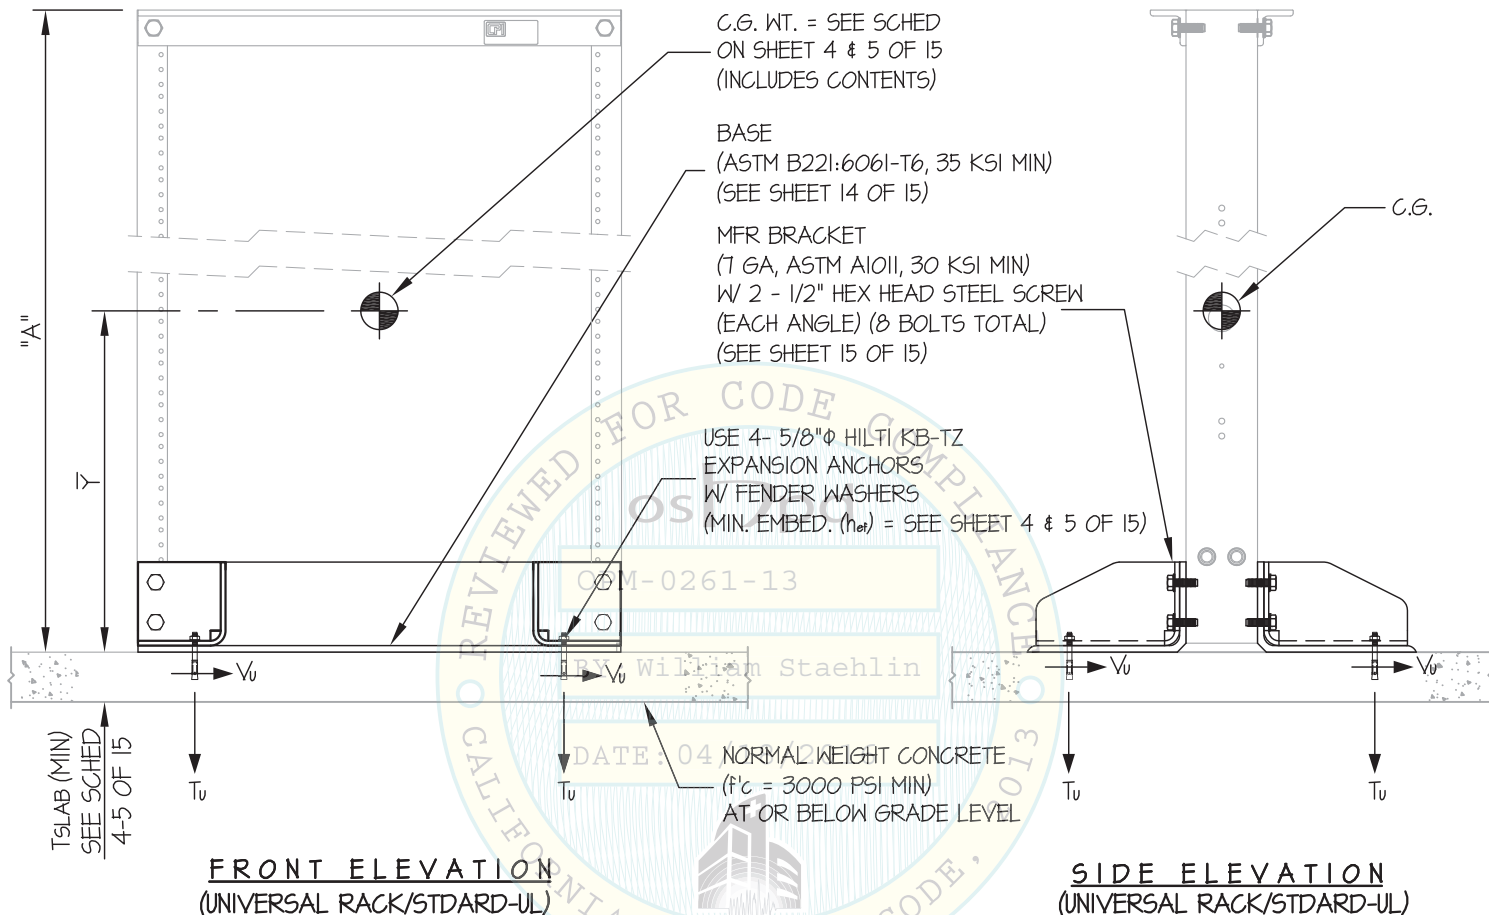

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10.**  
STRENGTH DESIGN IS USED. ( $a_p = 2.5$ ,  $l_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_o = 2.5$ ,  $z/h = 0$ )
- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THESE CALCULATIONS ENCOMPASS ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEET 1 AND 2.

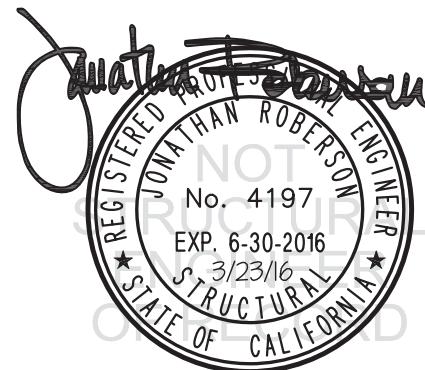

### CHATWORTH PRODUCTS INC.

### STANDARD & UNIVERSAL RACKS

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET


**4**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS


MAX  $S_{Ds} \leq 1.55$

CONCRETE SLAB

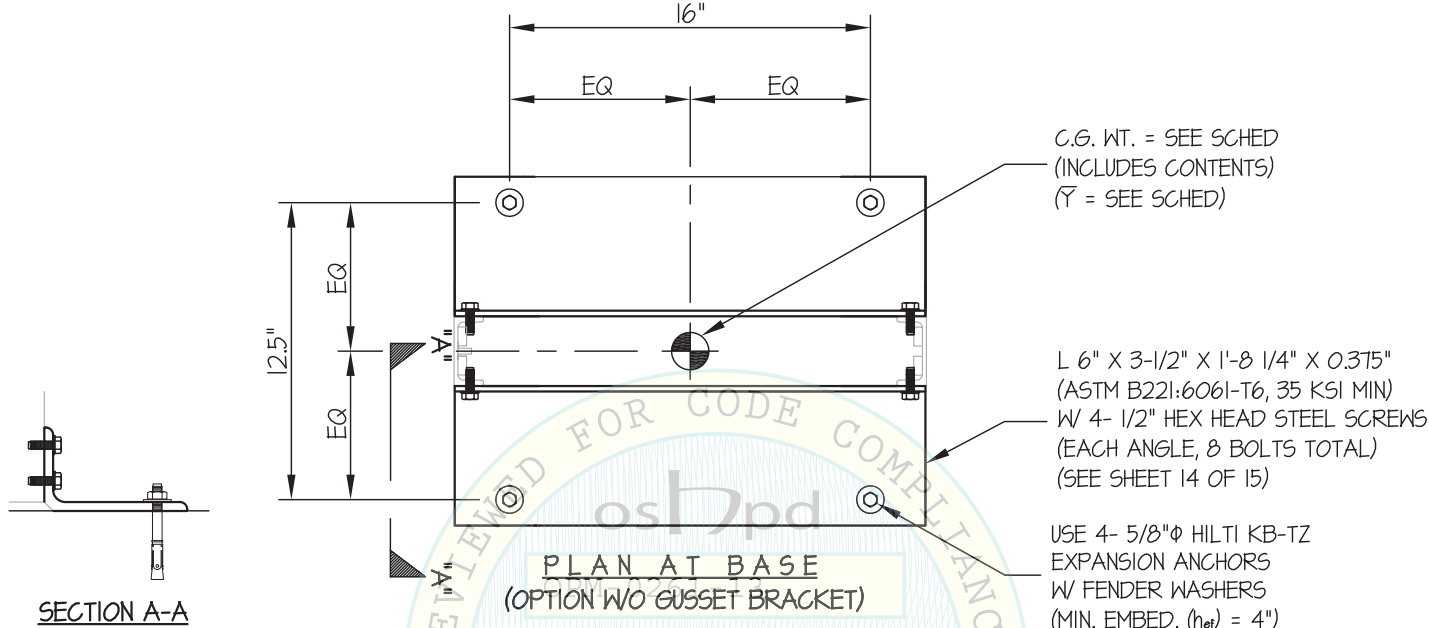

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	BOLT DIA (in.)	BOLT QTY	EFF EMBED (in.)	SLAB THK (in.)	* $T_u$ (lb.)	* $V_u$ (lb.)
46353-X03 / 48353-X03	164	36	84	44	5/8	4	4	6	2745	71
46353-X05 / 48353-X05	144	37	90	47	5/8	4	4	6	2589	63
46353-X15 / 48353-X15	124	39	96	50	5/8	4	4	6	2383	54

\* (VALUES INCLUDE  $\Omega_u$ )

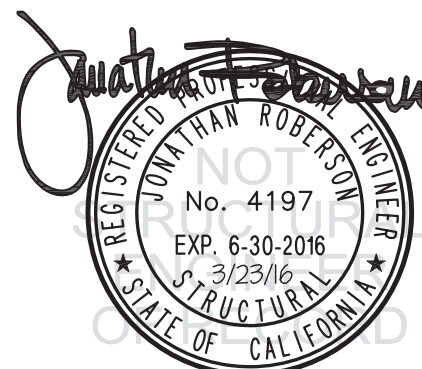

### CHATWORTH PRODUCTS INC.

### STANDARD & UNIVERSAL RACKS

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET


**5**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

1.55 < MAX  $S_{Ds}$  ≤ 2.20

CONCRETE SLAB

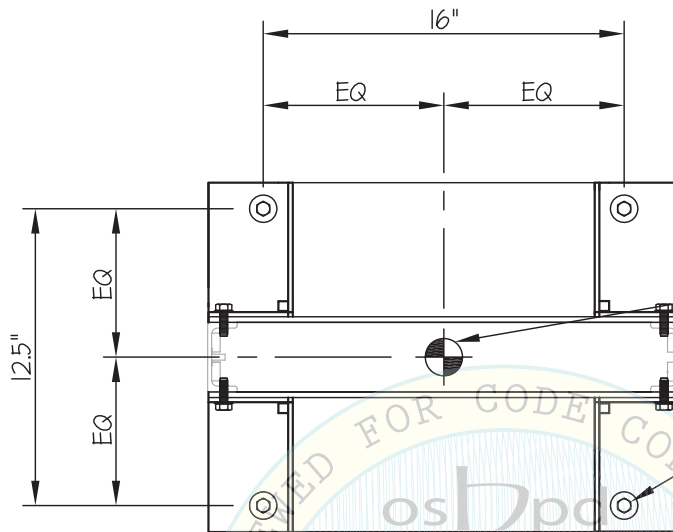

MFR GUSSET BRACKET  
(1 GA, ASTM A1011, 30 KSI MIN)  
W/ 2 - 1/2" HEX HEAD STEEL SCREW  
(EACH ANGLE) (8 BOLTS TOTAL)  
(SEE SHEET 15 OF 15)

C.G. WT. = SEE SCHED  
(INCLUDES CONTENTS)  
(Y = SEE SCHED)


USE 4- 5/8"Ø HILTI KB-TZ  
EXPANSION ANCHORS  
W/ FENDER WASHERS  
(MIN. EMBED. ( $h_{ef}$ ) = 4")

BASE  
(ASTM B221:6061-T6, 35 KSI MIN)  
(SEE SHEET 14 OF 15)

**PLAN AT BASE**  
(OPTION W/ GUSSET BRACKET)

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	BOLT DIA (in.)	BOLT QTY	EFF EMBED (in.)	SLAB THK (in.)	* $T_u$ (lb.)	* $V_u$ (lb.)
46353-X03 / 48353-X03	339	44	84	44	5/8	4	4	6	1787	210
46353-X05 / 48353-X05	157	45	90	47	5/8	4	4	6	886	97
46353-X15 / 48353-X15	129	47	96	50	5/8	4	4	6	775	80

\* (VALUES INCLUDE  $\Omega$ )

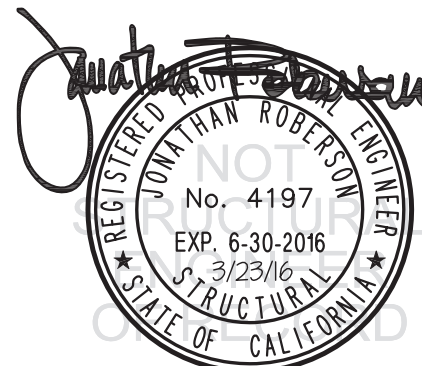

### CHATWORTH PRODUCTS INC.

### STANDARD & UNIVERSAL RACKS

DES. J. ROBERSON

JOB NO. 11-1453

DATE 3/23/16


SHEET

6

OF 15 SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB

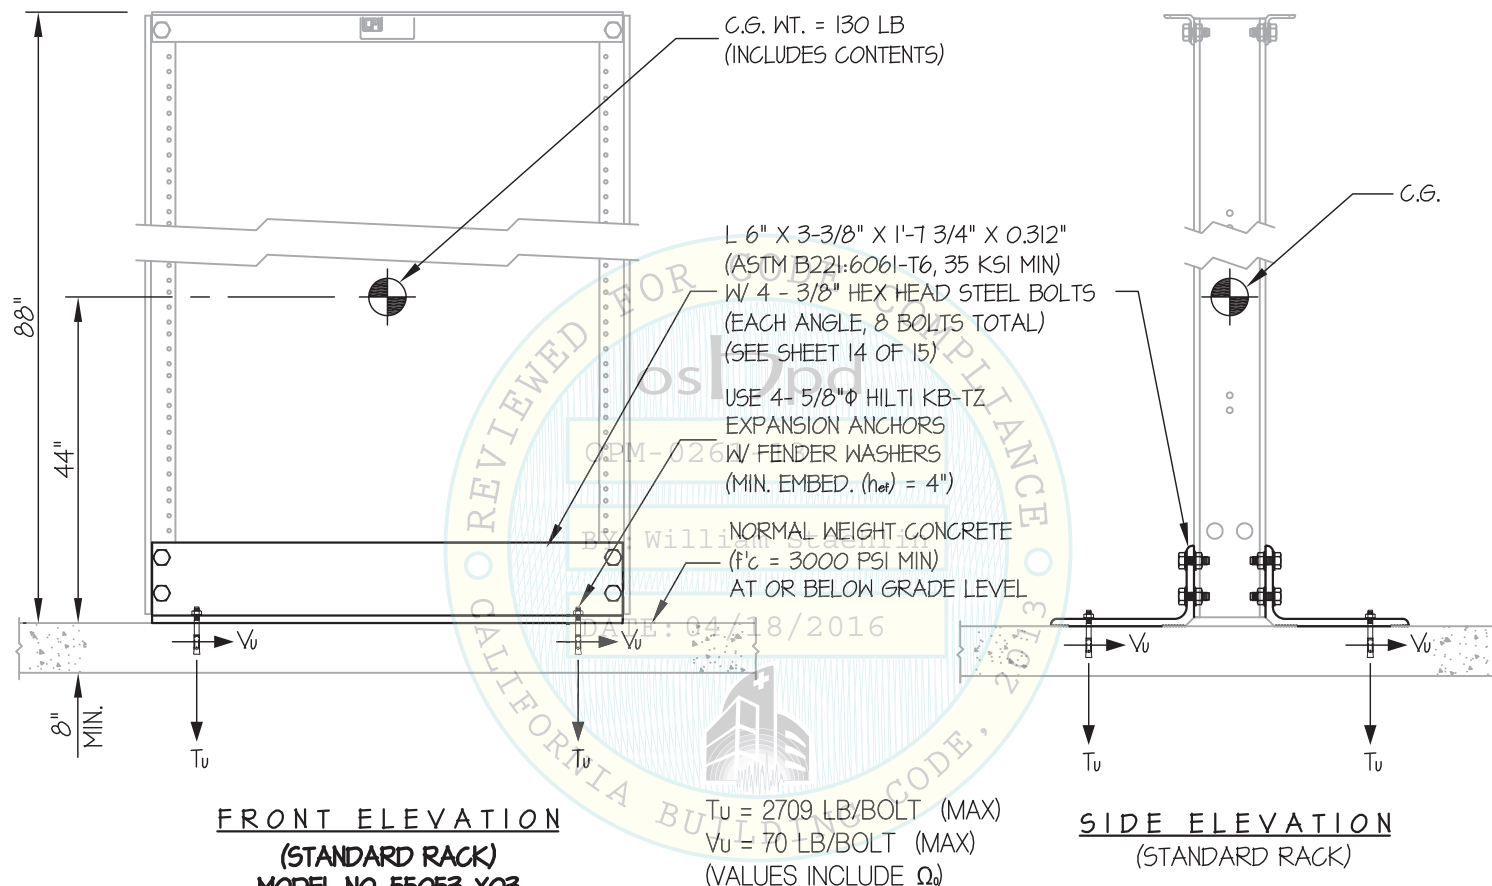

#### NOTES:

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10.


STRENGTH DESIGN IS USED. (Sds = 1.90, ap = 2.5, lp = 1.5, Rp = 6.0, Ωo = 2.5, z/h = 0)

HORIZONTAL FORCE (Eh) = 0.855 Wp

HORIZONTAL FORCE (Emh) = 2.14 Wp (FOR CONCRETE ANCHORAGE)

VERTICAL FORCE (Ev) = 0.38 Wp

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEET 1 AND 2.

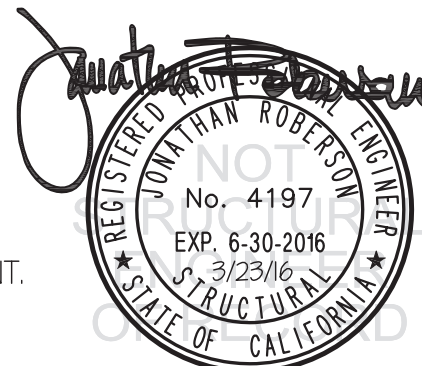

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET


**7**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

MAX  $S_{ds} \leq 1.90$

CONCRETE SLAB

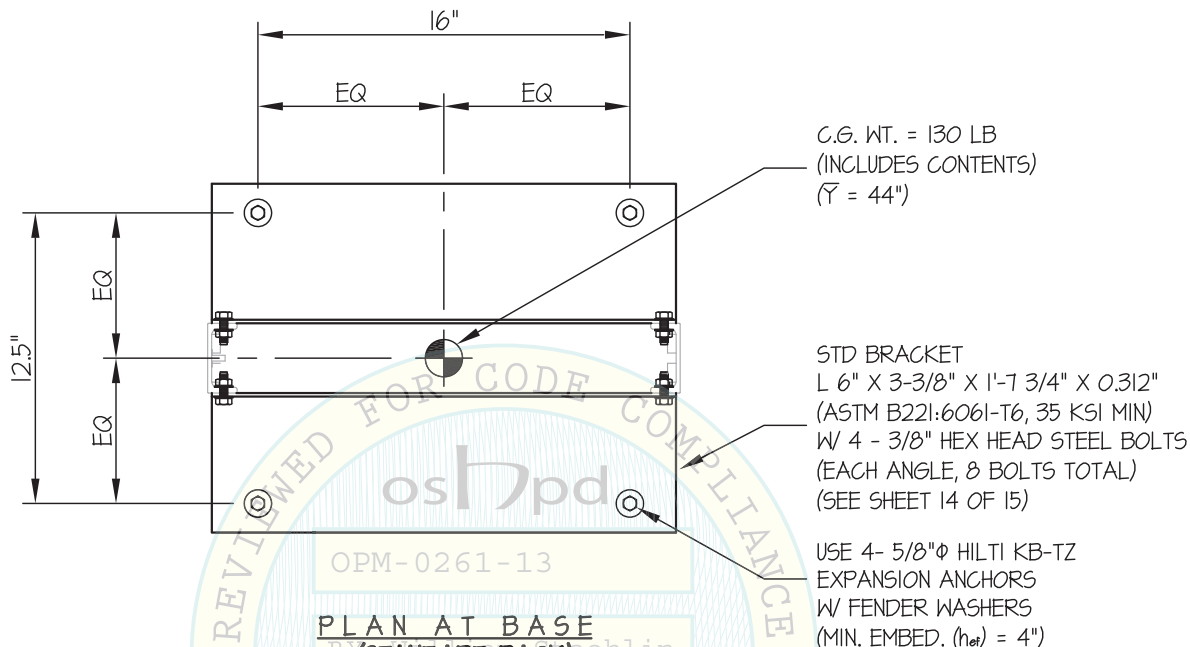

OPM-0261-13



PLAN AT BASE

(STANDARD RACK)

MODEL NO. 55053-X03

EQUIPMENT WT = 25 LB

DATE: 04/18/2016

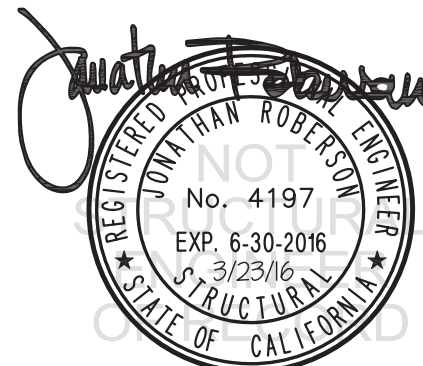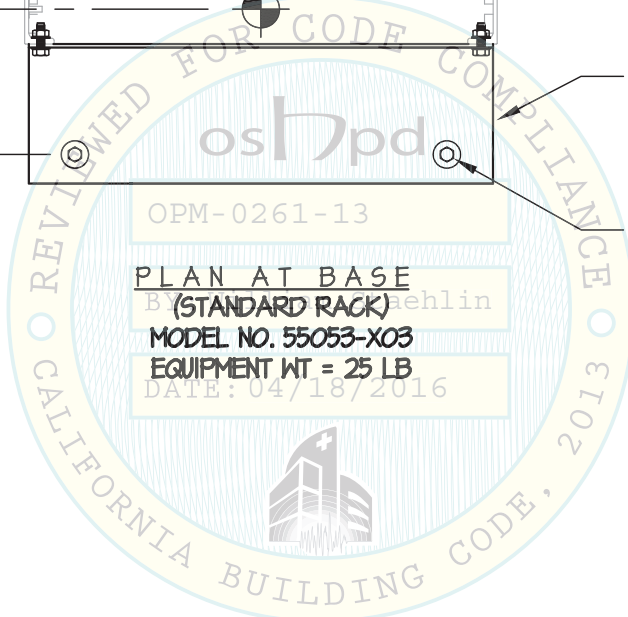

### CHATWORTH PRODUCTS INC.

### STANDARD & UNIVERSAL RACKS

DES. J. ROBERSON

JOB NO. 11-1453

DATE 3/23/16


SHEET

8

OF 15 SHEETS

#### SEISMIC SUPPORTS & ATTACHMENTS

#### CONCRETE SLAB ON METAL DECK

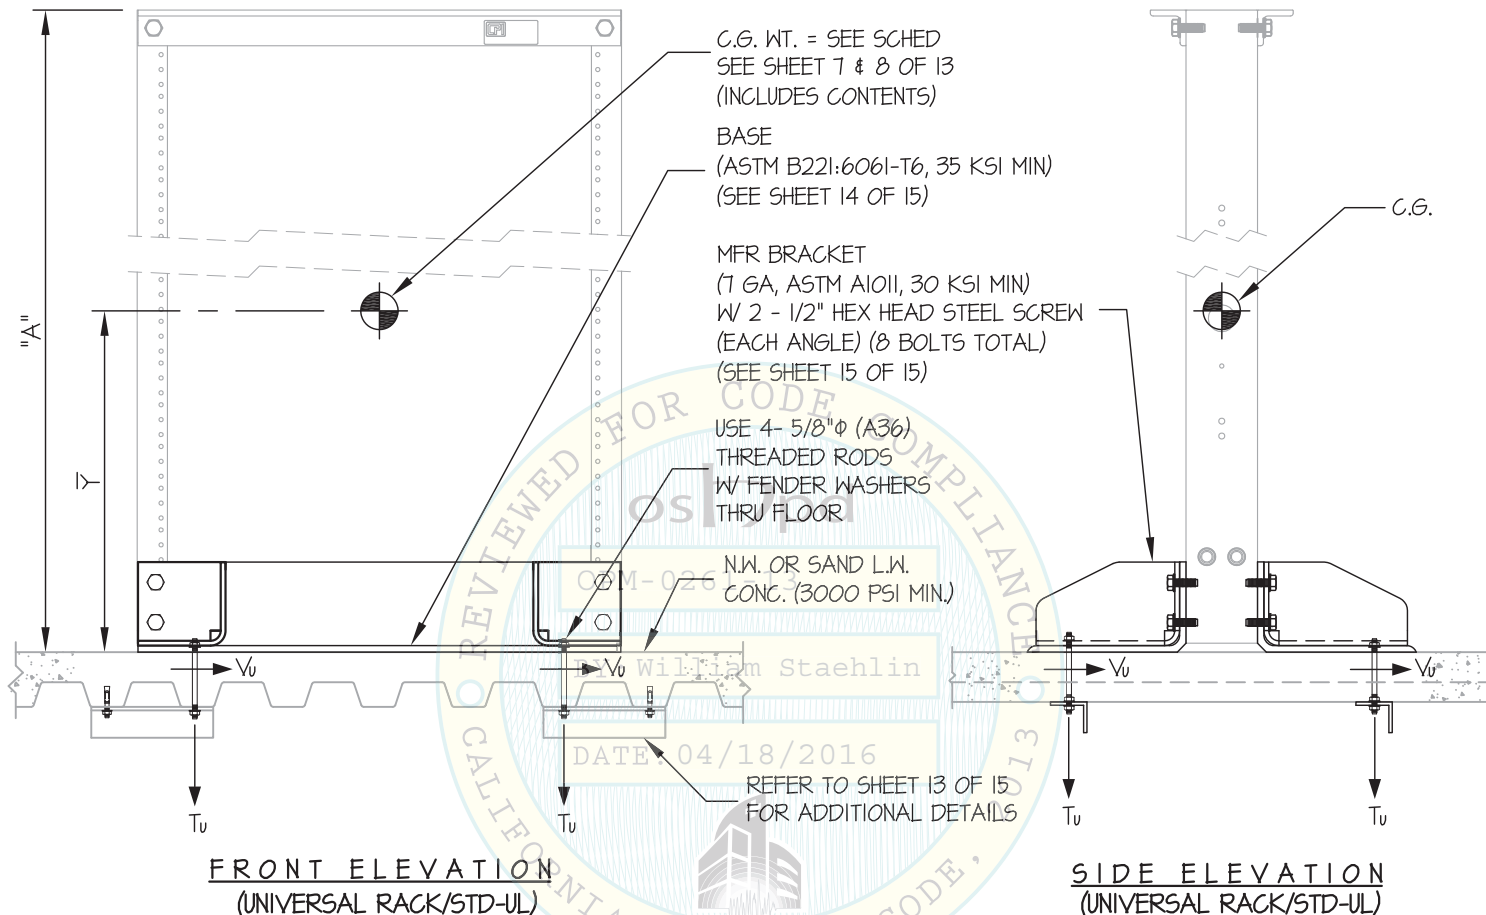

#### NOTES:

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10.


STRENGTH DESIGN IS USED. ( $S_{ds} = 2.20$ ,  $a_p = 2.5$ ,  $I_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_o = 2.5$ ,  $z/h \leq 1$ )

HORIZONTAL FORCE ( $E_h$ ) =  $1.65 W_p$

HORIZONTAL FORCE ( $E_{mh}$ ) =  $4.13 W_p$  (FOR CONCRETE ANCHORAGE)

VERTICAL FORCE ( $E_v$ ) =  $0.44 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEET 1 AND 2.

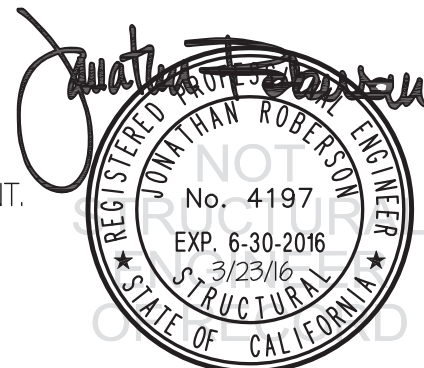

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET


**9**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS


MAX  $S_{Ds} \leq 2.20$

CONCRETE SLAB ON METAL DECK

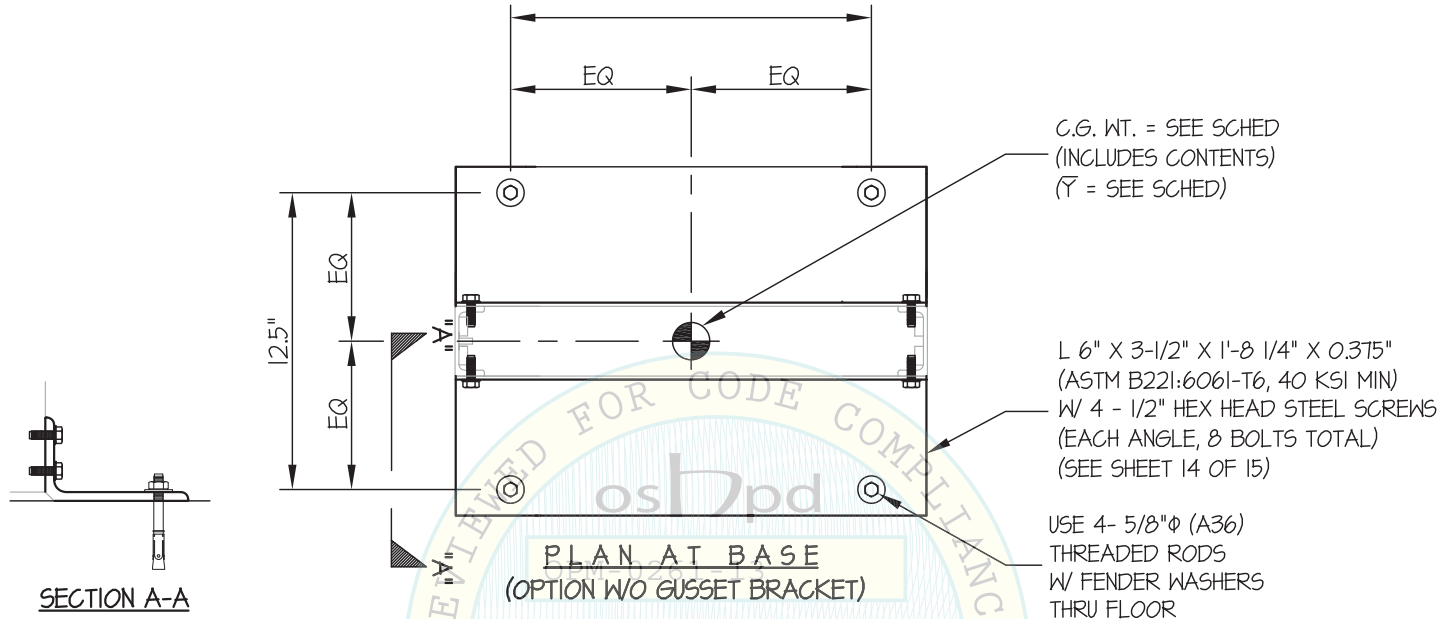

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	* $T_u$ (lb.)	* $V_u$ (lb.)
46353-X03 / 48353-X03	164	36	84	44	2623	68
46353-X05 / 48353-X05	144	37	90	47	2472	59
46353-X15 / 48353-X15	124	39	96	50	2274	51

\* (VALUES DO NOT INCLUDE  $\Omega$ )

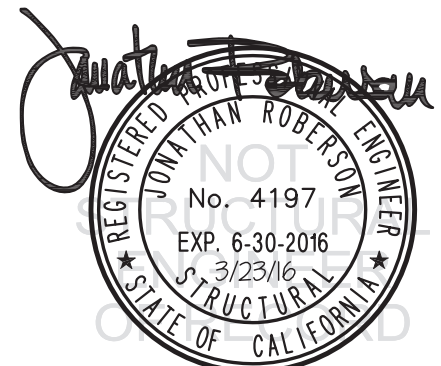

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET


**10**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

MAX  $S_{Ds} \leq 2.20$

CONCRETE SLAB ON METAL DECK

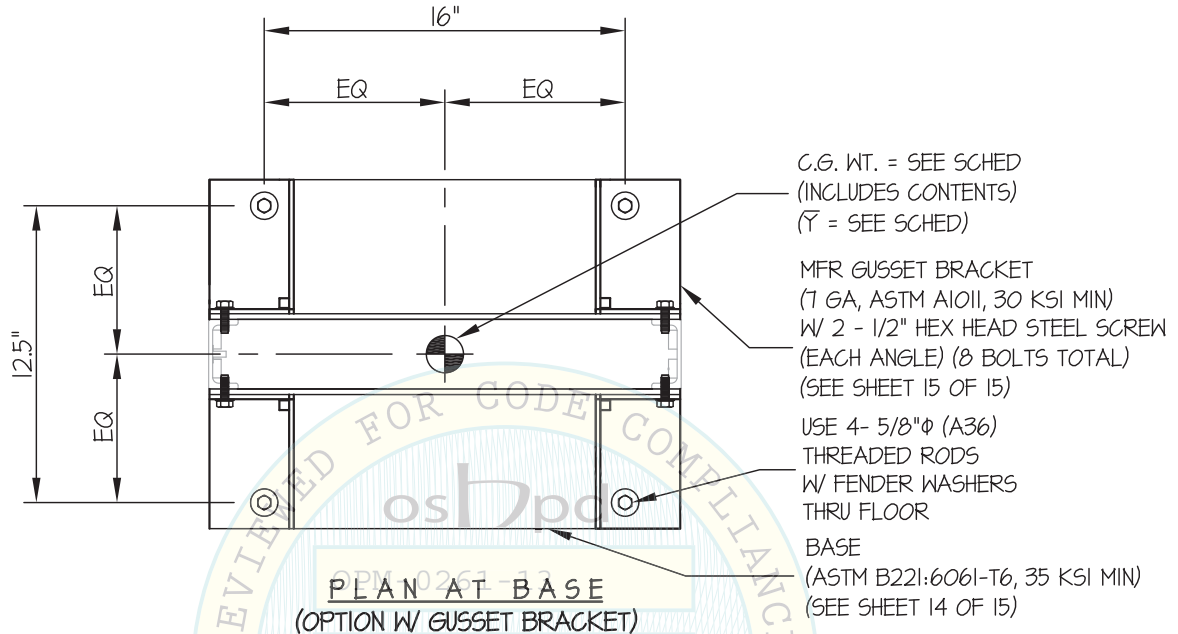

MODEL NUMBER (UNIVERSAL RACK)	TOTAL WEIGHT (lb.)	EQUIP. WEIGHT (lb.)	"A" (in.)	$\bar{Y}$ (in.)	* $T_u$ (lb.)	* $V_u$ (lb.)
46353-X03 / 48353-X03	339	44	84	44	1176	140
46353-X05 / 48353-X05	157	45	90	47	583	65
46353-X15 / 48353-X15	129	47	96	50	511	53

\* (VALUES DO NOT INCLUDE  $\Omega_0$ )



**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**


SHEET

**11**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE SLAB ON METAL DECK

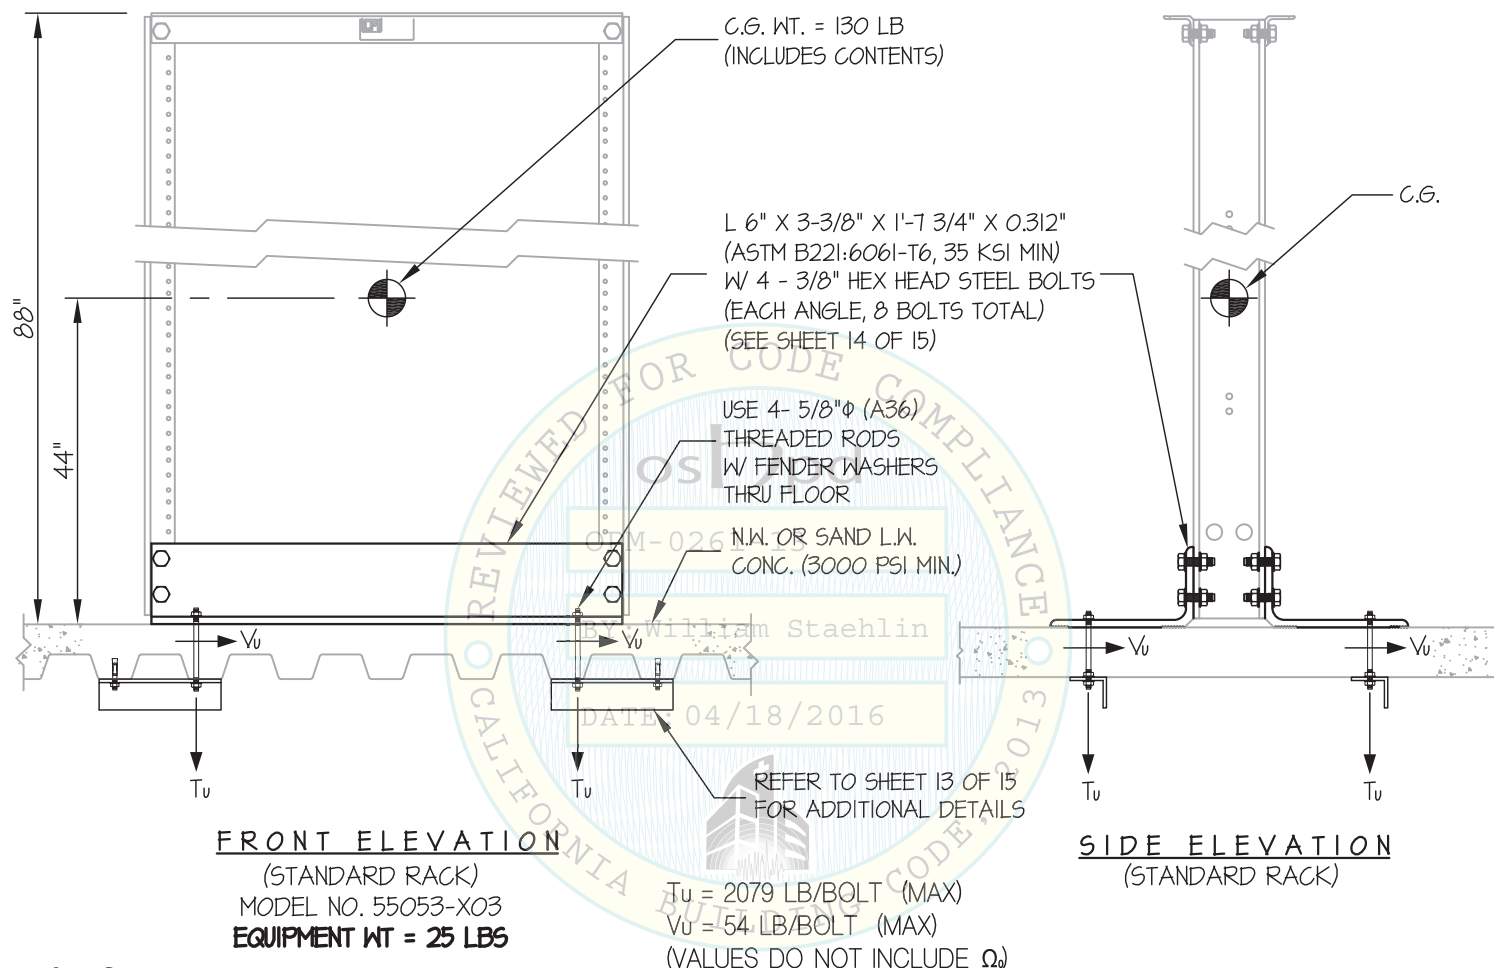

**NOTES:**

- FORCES ARE DETERMINED PER 2013 CALIFORNIA BUILDING CODE AND ASCE 7-10.


STRENGTH DESIGN IS USED. ( $S_{bs} = 2.20$ ,  $a_p = 2.5$ ,  $l_p = 1.5$ ,  $R_p = 6.0$ ,  $\Omega_o = 2.5$ ,  $z/h \leq 1$ )

HORIZONTAL FORCE ( $E_h$ ) =  $1.65 W_p$

HORIZONTAL FORCE ( $E_{mh}$ ) =  $4.13 W_p$  (FOR CONCRETE ANCHORAGE)

VERTICAL FORCE ( $E_v$ ) =  $0.44 W_p$

- CENTER OF GRAVITY (C.G.) AND WEIGHT ARE THE GOVERNING PARAMETERS FOR DESIGN. THIS PREAPPROVAL ENCOMPASSES ALL WEIGHTS UP TO THE MAXIMUM WEIGHT SHOWN.
- STRUCTURAL ENGINEER OF RECORD FOR THE BUILDING SHALL PROVIDE SUPPORT STRUCTURE DESIGNED TO SUPPORT WEIGHTS AND FORCES SHOWN IN COMBINATION WITH ALL OTHER LOADS THAT MAY BE PRESENT.
- SEE GENERAL NOTES: SHEET 1 AND 2.

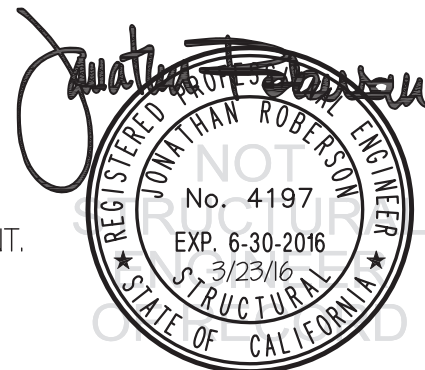

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET



**12**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

MAX  $S_{Ds} \leq 2.20$

CONCRETE SLAB ON METAL DECK

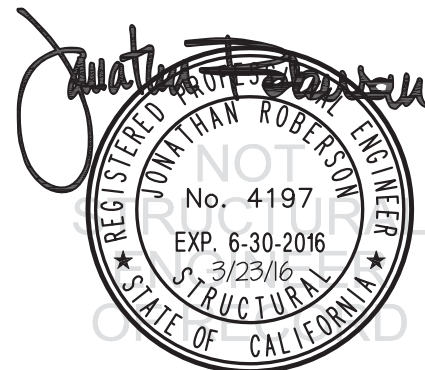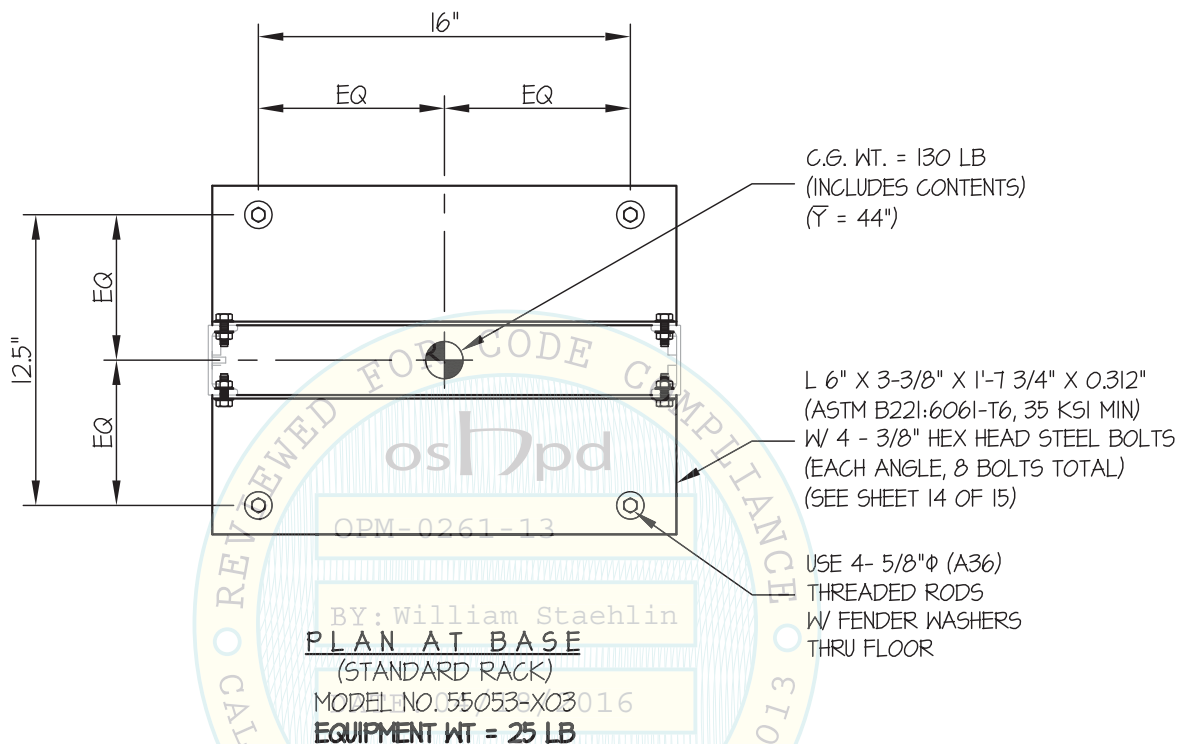

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**


SHEET

**13**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

CONCRETE DETAIL

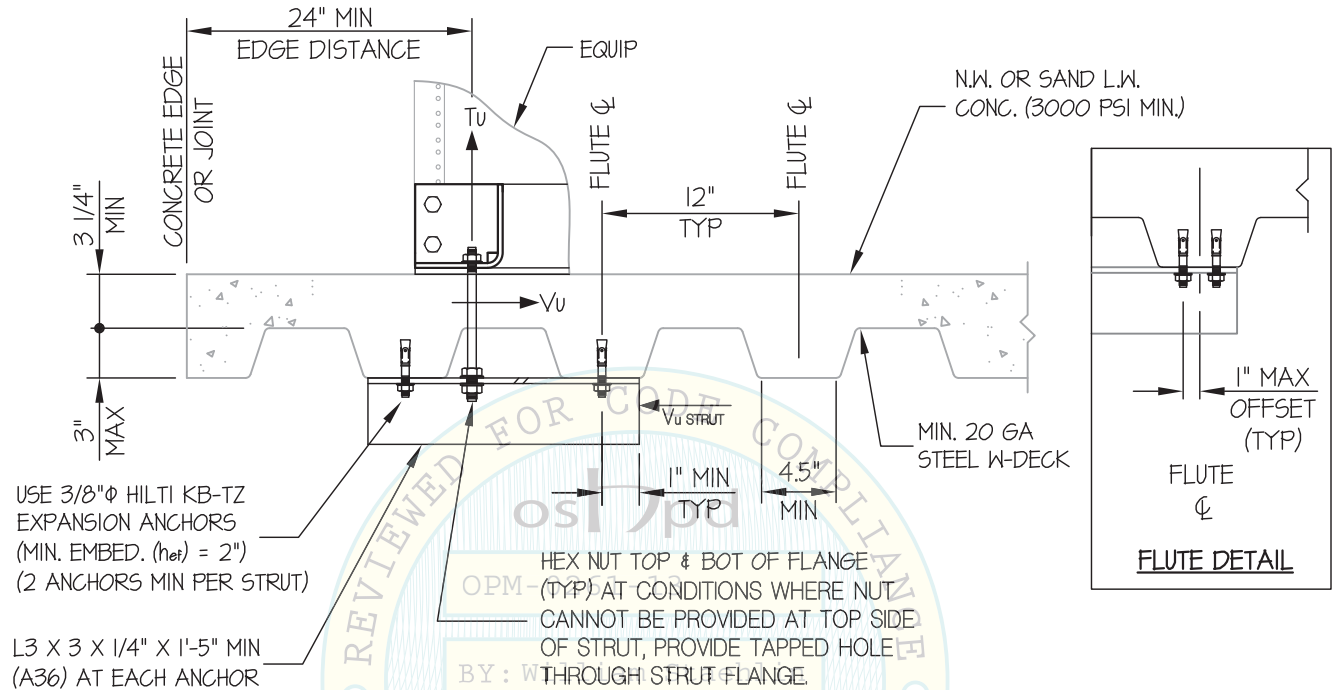

MIN STEEL DECK REQUIREMENTS AND STRUT DETAIL



**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**

SHEET

**14**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BRACKET DETAILS

STD = STD RACK 55053-X03

UNIV = UNIVERSAL RACK

0.312" THK (STD)


0.375" THK (UNIV)

BENT ANGLE: ASTM B221 6064-T6 AL, 35 KSI MIN

0.405" (STD)  
0.70" (UNIV)

18.37" (STD)  
18.85" (UNIV)


(2)- 3/4"Φ HOLES (TYP)

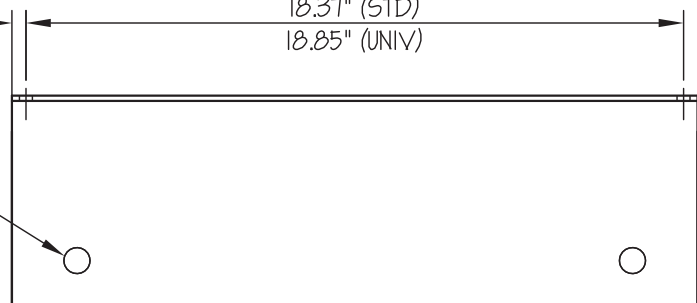


PLAN

(4)- 3/8"Φ BOLTS (STD)


(4)- 1/2"Φ SCREWS (UNIV)

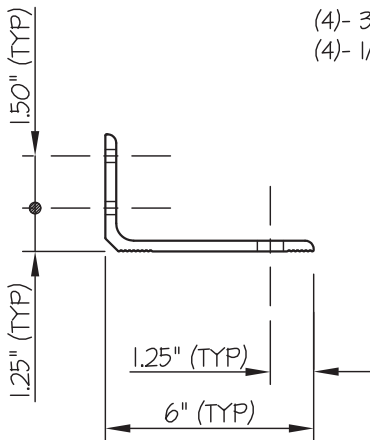

SIDE

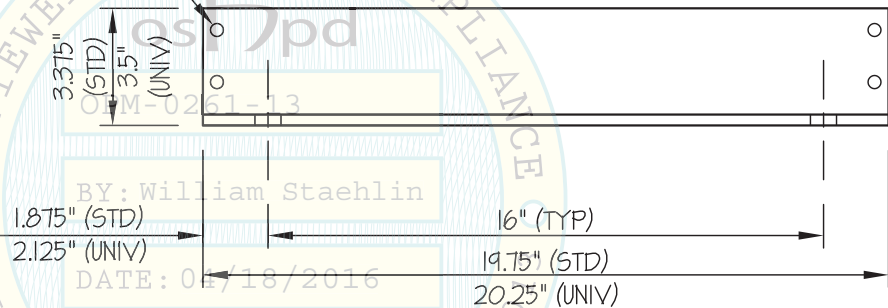

ELEVATION

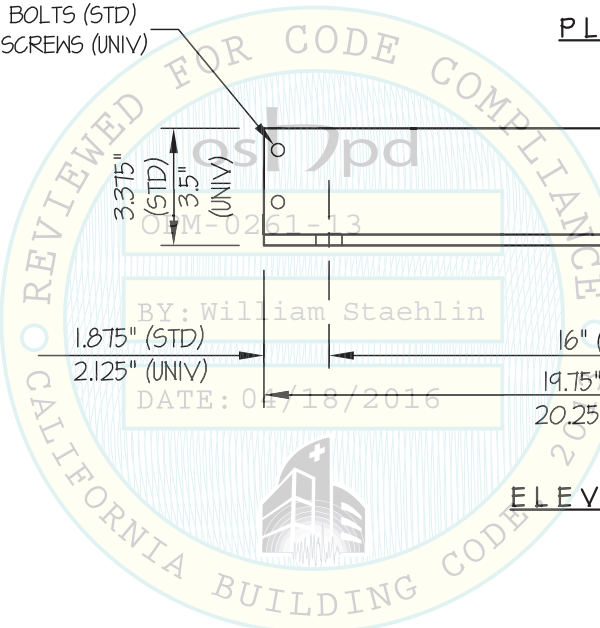

**CHATWORTH PRODUCTS INC.**

**STANDARD & UNIVERSAL RACKS**

DES. **J. ROBERSON**

JOB NO. **11-1453**

DATE **3/23/16**


SHEET

**15**

OF **15** SHEETS

SEISMIC SUPPORTS & ATTACHMENTS

BRACKET DETAILS

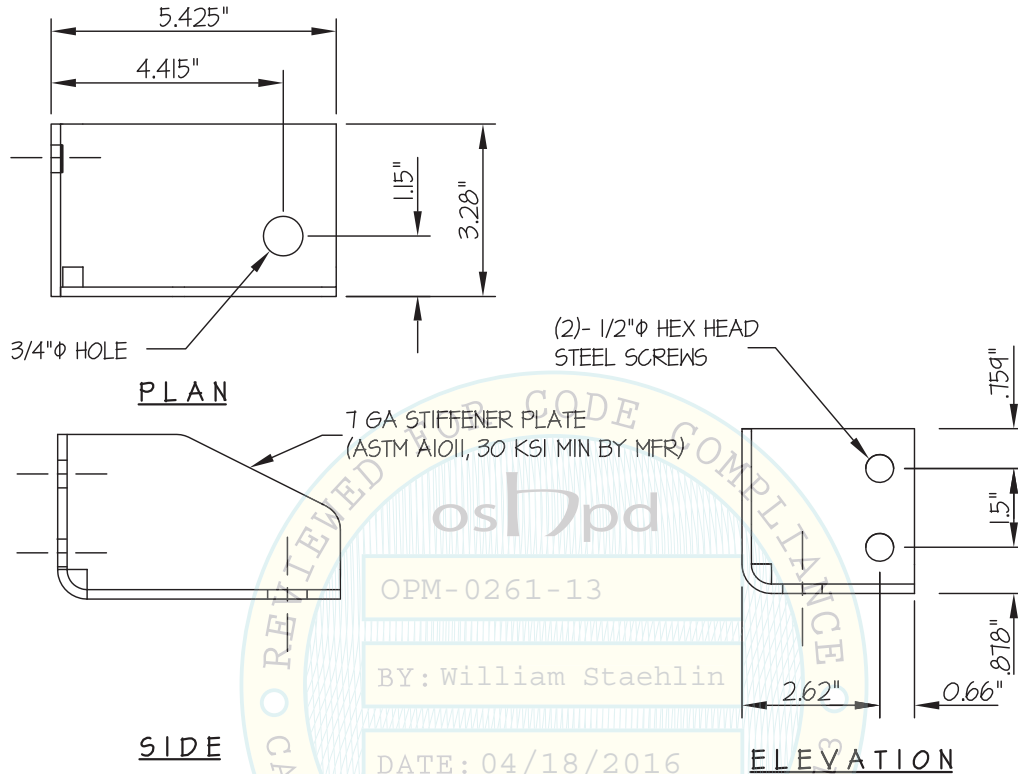

GUSSET BRACKET FOR UNIVERSAL RACK

