


UUT 2		
UNIT UNDER TEST (UUT) Sheets		
Manufacturer:	Functional Devices	
Product Line:	PSH AC Power Supplies	
Model Number	PSH500A	
Mounting:	Rigid Wall Mounted	
DCL Test Report:	23258-1601	


Product Construction Summary
 16 gage cold-rolled carbon steel, coated with smooth powder paint

Options / Subcomponent Summary
 Enclosed 500VA power supply with five 100A Class 2 outputs, 480/277/240/120 Vac to 24Vac

UUT Properties						
Weight (lb)	Dimensions (in)			Lowest Natural Frequency (Hz)		
	Length	Width	Height	F-B	S-S	V
30.2	6	12	12	N/A	N/A	N/A

UUT Highest Passed Seismic Run Information						
Building Code	Test Criteria	S	A _{FLX-H} (g)	A _{RIG-H} (g)	A _{FLX-V} (g)	A _{RIG-V} (g)
CBC 2019	ICC-ES AC156		3.09	2.32	1.29	0.51

Test Mounting Details
 The UUT was attached to the fixturing using four (4) #4 zinc-plated metal screws through the existing openings in the back of the back-box

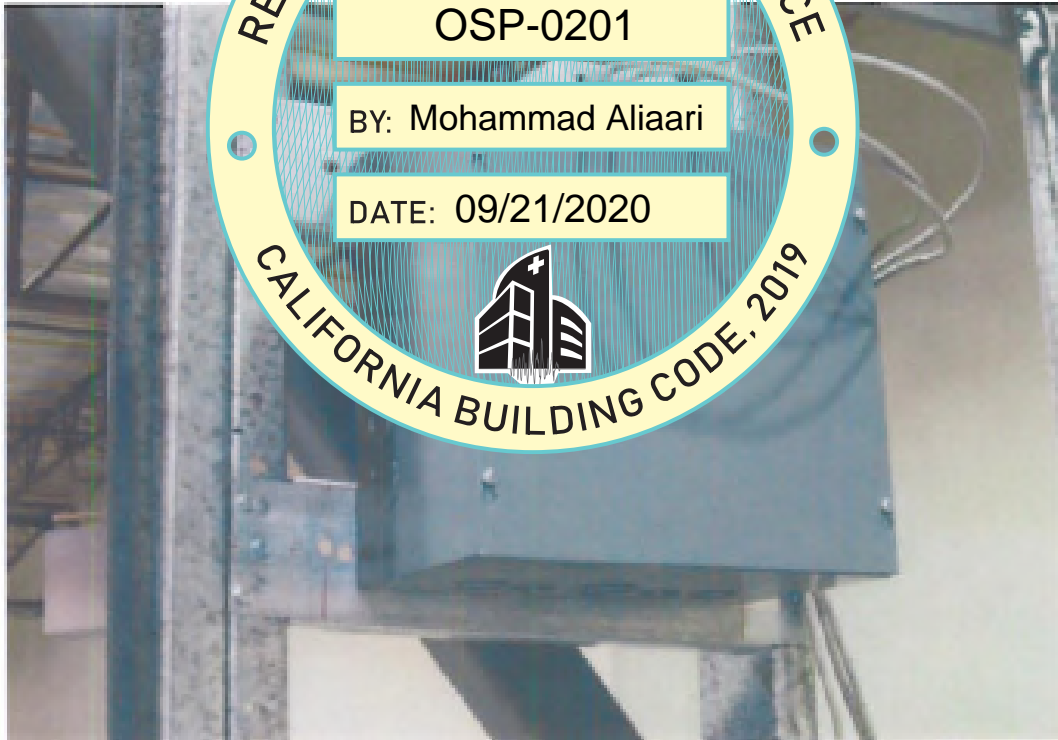

All units were filled with contents and maintained structural integrity and functionality after shake table test