



OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION

APPLICATION FOR OSHPD SPECIAL SEISMIC  
CERTIFICATION PREAPPROVAL (OSP)

OFFICE USE ONLY

APPLICATION #: OSP – 0515 – 10

OSHPD Special Seismic Certification Preapproval (OSP)

Type: ☐ New ☒ Renewal

Manufacturer Information

Manufacturer: ait-deutschland GmbH

Manufacturer's Technical Representative: Markus Zobler

Mailing Address: Industriestrasse 3; 95359 Kasendorf

Telephone: +49-9228-9906-1580

Email: [markus.zobler@ait-deutschland.eu](mailto:markus.zobler@ait-deutschland.eu)

Product Information

Product Name: cBoxX 60, xBoxX 70, Chiller Interface Panel (CIP), and Remote Control Panel (RCP)

Product Type: Water Chiller

Product Model Number: See Attachment

(List all unique product identification numbers and/or part numbers)

General Description: Chiller systems for cool fluid using air cooled refrigerant.

Mounting Description: Flexible floor mounted chillers and Rigid wall mounting for CIP and RCP units.

Applicant Information

Applicant Company Name: W.E. Gundy & Associates, Inc.

Contact Person: Travis Soppe, SE

Mailing Address: 1199 Shoreline Drive, Suite 310, Boise, ID 83702

Telephone: (208) 342-5898 Ext. 115


Email: [tsoppe@wegai.com](mailto:tsoppe@wegai.com)

I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2016.

Signature of Applicant:  Date: 12-10-2018

Title: President Company Name: W.E. Gundy & Associates, Inc.

"Access to Safe, Quality Healthcare Environments that Meet California's Diverse and Dynamic Needs"





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)**

Company Name: W.E. Gundy & Associates, Inc.

Name: Travis Soppe, SE California License Number: S6115

Mailing Address: 1199 Shoreline Drive, Suite 310, Boise, ID 83702

Telephone: (208) 342-5898 Ext. 115 Email: [tsoppe@wegai.com](mailto:tsoppe@wegai.com)

**Supports and Attachments Preapproval**

- ☐ Supports and attachments are preapproved under OPM-  
(Separate application for OSHPD Preapproval of Manufacturer's Certification (OPM) of Supports and attachments is required)
- ☒ Supports and attachments are not preapproved

**Certification Method**

- ☒ Testing in accordance with: ☒ ICC-ES AC156
- ☐ Other (Please Specify): \_\_\_\_\_


**Testing Laboratory**

Company Name: IABG mbH

Contact Name: Dr. Steffen Roedling

Mailing Address: Einsteinstrasse 20, Ottobrunn, Germany D-85521

Telephone: +49 (0) 89 / 6088-2052 Email: [roedling@iabg.de](mailto:roedling@iabg.de)





# OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT FACILITIES DEVELOPMENT DIVISION

## Seismic Parameters

Design in accordance with ASCE 7-10 Chapter 13: ☒ Yes ☐ No

Design Basis of Equipment or Components ( $F_p/W_p$ ) = See attachment

$S_{DS}$  (Design spectral response acceleration at short period, g) = 2.00 (z/h = 1); 2.50 (z/h = 0)

$a_p$  (In-structure equipment or component amplification factor) = See attachment

$R_p$  (Equipment or component response modification factor) = See attachment

$\Omega_0$  (System overstrength factor) = See attachment

$I_p$  (Importance factor) = 1.5

z/h (Height factor ratio) = 1 ( $S_{DS}$  = 2.00); 0 ( $S_{DS}$  = 2.50)

Equipment or Component Natural Frequencies (Hz) = See attachment

Overall dimensions and weight (or range thereof) = See attachment

Equipment or Components @ grade designed in accordance with ASCE 7-10 Chapter 15: ☐ Yes ☒ No

Design Basis of Equipment or Components (V/W) = See attachment

$S_{DS}$  (Design spectral response acceleration at short period, g) = See attachment

$S_{D1}$  (Design spectral response acceleration at 1 second period, g) = See attachment

R (Response modification coefficient) = OSP-0515-10

$\Omega_0$  (System overstrength factor) = See attachment

$C_d$  (Deflection amplification factor) = BY: Timothy J. Piland

$I_p$  (Importance factor) = 1.5

Height to Center of Gravity above base = DATE: 07/15/2019

Equipment or Component Natural Frequencies (Hz) = See attachment

Overall dimensions and weight (or range thereof) = See attachment

Tank(s) designed in accordance with ASME BPVC, 2015: ☐ Yes ☒ No

## List of Attachments Supporting Special Seismic Certification

☒ Test Report(s) ☐ Drawings ☐ Calculations ☒ Manufacturer's Catalog

☒ Other(s) (Please Specify): Certified System Matrix, UUT Summary Sheets, Subcomponent Certification Letter


## OSHPD Approval (For Office Use Only) – Approval Expires on December 31, 2022

Signature: Timothy J. Piland Date: July 15, 2019

Print Name: Timothy J. Piland Title: SSE

Special Seismic Certification Valid Up to:  $S_{DS}$  (g) = See Above z/h = See Above

Condition of Approval (if applicable): See attachment



**KKT Chillers - AIT Deutschland GmbH**  
**SPECIAL SEISMIC CERTIFICATION**  
**CERTIFIED SYSTEM AND COMPONENTS**



**Manufacturer:** KKT Chillers - AIT Deutschland GmbH

**System:** KKT Compact Chillers

System Component	KKT Chillers ID Number <sup>3</sup>	Dimensions (in)			Weight (lb)	Mounting	UUT
		Width	Length	Height			
cBoxX 60 Chiller	909060-00244 909060-00244z 909060-00424 909060-00424z	79.9	48.8	32.7	1,300 <sup>2)</sup>	flexible floor	UUT-1
cBoxX 70 Chiller	909070-00249 909070-00249z 909070-00425 909070-00425z	79.9	72.4	32.7	1,620 <sup>2)</sup>	flexible floor	UUT-2
Chiller Interface Panel (CIP)	909000.0072	43.3	24.0	13.6	120	rigid wall	UUT-3
Remote Control Panel (RCP)	909000.0071	11.8	12.0	4.7	11	rigid wall	UUT-4

<sup>1)</sup> All components are manufactured by AIT Deutschland GmbH unless noted otherwise. The part numbers listed uniquely identify the type of component, manufacturer, and material of construction for each sub-component within the tested units.

<sup>2)</sup> Weight includes normal operating fluid used during seismic test.

<sup>3)</sup> The identified chillers each have two internal KKT identification numbers that are used for marketing and an additional z designation for identifying different cooling liquids (same density of tested cooling liquid). The chillers listed with the two identification numbers and additional z designations are identical in design and construction.

**SEISMIC CERTIFICATION LIMITS**

System Component	Code	S <sub>DS</sub> (g)	z / h	I <sub>p</sub>	a <sub>p</sub>	R <sub>p</sub>	Ω <sub>0</sub>	F <sub>p</sub> / W <sub>p</sub>
cBoxX 60 Chiller	CBC 2016 ASCE 7-10	2.0	1.0	1.50	2.5	2.5	2.0	3.60
		2.5	0					1.50
cBoxX 70 Chiller		2.0	1.0	1.50	2.5	2.5	2.0	3.60
		2.5	0					1.50
Chiller Interface Panel (CIP)		2.0	1.0	1.50	2.5	6.0	2.0	1.50
		2.5	0					1.13
Remote Control Panel (RCP)		2.0	1.0	1.50	2.5	6.0	2.0	1.50
		2.5	0					1.13




UUT-1

## UNIT UNDER TEST (UUT) SUMMARY SHEET



**Mounting Details:** Flexible floor mounted on 4 - AMC Mecanocaucho Marinelager S/N:136024 isolation divices. Each isolator connects to the UUT with one M16 Grade 8.8 bolt and mounts to the table with 2 - M12 Grade 8.8 bolts.

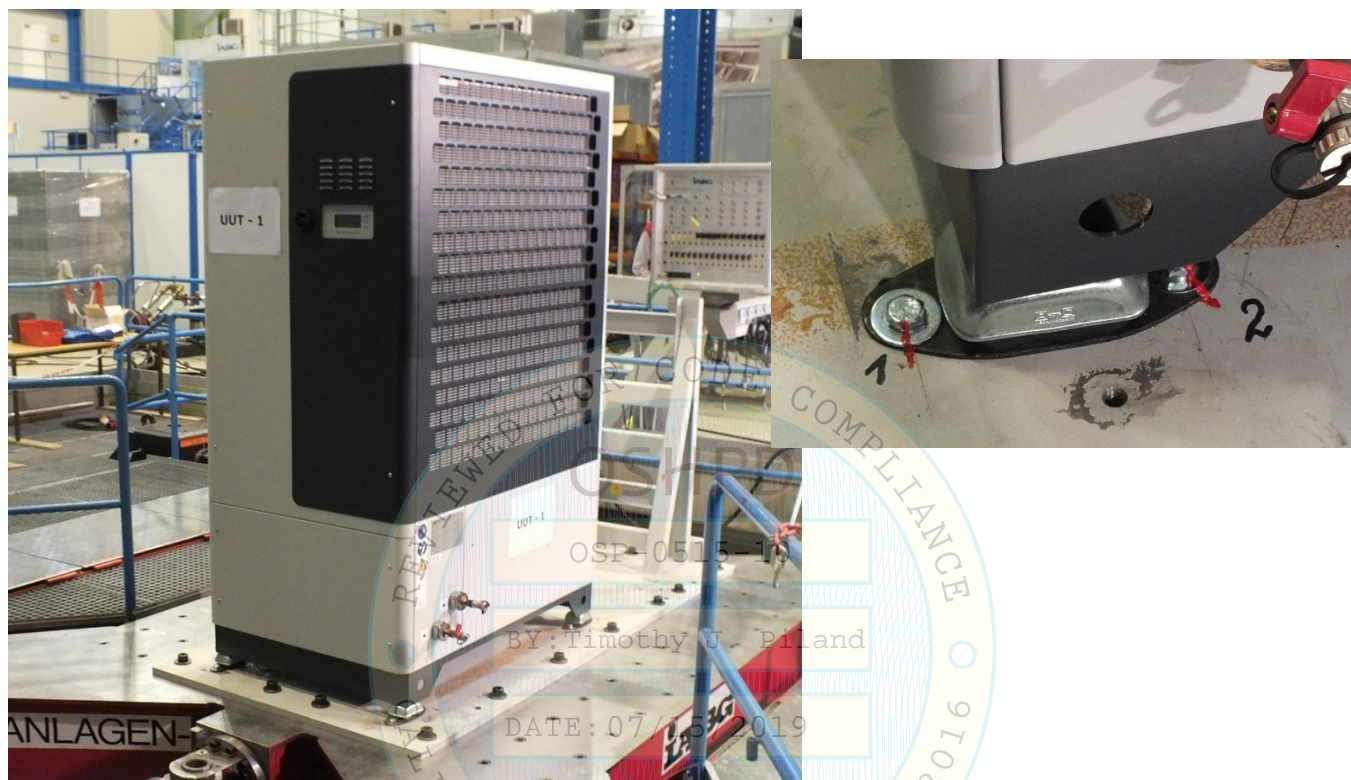

**Manufacturer:** KKT Chillers - AIT Deutschland GmbH

**Component:** Compact Chiller cBoxX 60

**SAP Number:** 909060-00244

**UUT Function:** Cools liquids using an air cooled refrigerant system

**UUT Description:** KKT Compact Chiller with 66kW net cooling capacity. Unit is floor mounted on vibration isolators as detailed above.

**Test Location:** IABG mbH, Germany

**Test Date:** November 2016

### UUT PROPERTIES

Weight (lb) *	Dimensions (inches)			Natural Frequency (Hz)		
	Width	Depth	Height	FB	SS	V
1,300	79.9"	48.8"	32.7"	4.2	3.0	9.4

\*Weight includes normal operating fluid.

### SEISMIC TEST PARAMETERS

Building Code / Test Criteria	$S_{DS}$ (g)	$z/h$	$I_p$	$A_{FLX-H}$ (g)	$A_{RIG-H}$ (g)	$A_{FLX-V}$ (g)	$A_{RIG-V}$ (g)
CBC 2016 / ICC-ES AC156	2.00	1.0	1.5	3.20	2.40		
	2.50	0.0	1.5			1.67	0.67


Note: The unit was full of contents during testing and remained fuctional before and after the ICC-ES AC156 test. The unit maintained structural integrity during and after the ICC-ES AC156 Test.

# UUT-2

## UNIT UNDER TEST (UUT) SUMMARY SHEET



**Mounting Details:** Flexible floor mounted on 4 - AMC Mecanocaucho Marinelager S/N:136024 isolation divices. Each isolator connects to the UUT with one M16 Grade 8.8 bolt and mounts to the table with 2 - M12 Grade 8.8 bolts.

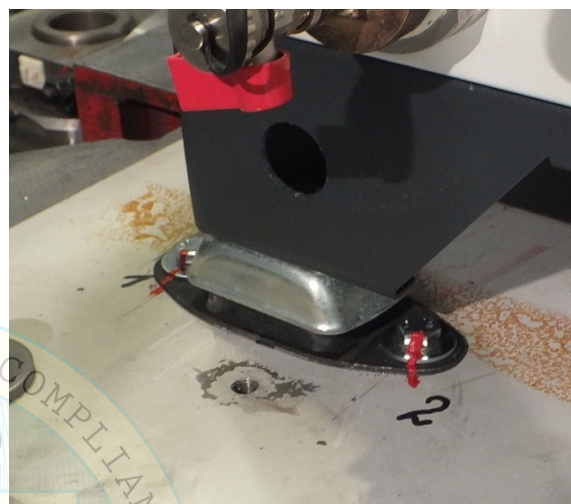

**Manufacturer:** KKT Chillers - AIT Deutschland GmbH

**Component:** Compact Chiller cBoxX 70

**SAP Number:** 909070-00249

**UUT Function:** Cools liquids using an air cooled refrigerant system

**UUT Description:** KKT Compact Chiller with 79kW net cooling capacity. Unit is floor mounted on vibration isolators as detailed above.

**Test Location:** IABG mbH, Germany

**Test Date:** November 2016

### UUT PROPERTIES

Weight (lb) *	Dimensions (inches)			Natural Frequency (Hz)		
	Width	Depth	Height	FB	SS	V
1,620	79.9"	72.4"	32.7"	4.8	2.6	8.5

\*Weight includes normal operating fluid.

### SEISMIC TEST PARAMETERS

Building Code / Test Criteria	S <sub>DS</sub> (g)	z / h	I <sub>P</sub>	A <sub>FLX-H</sub> (g)	A <sub>RIG-H</sub> (g)	A <sub>FLX-V</sub> (g)	A <sub>RIG-V</sub> (g)
CBC 2016 / ICC-ES AC156	2.00	1.0	1.5	3.20	2.40		
	2.50	0.0	1.5			1.67	0.67

Note: The unit was full of contents during testing and remained fuctional before and after the ICC-ES AC156 test. The unit maintained structural integrity during and after the ICC-ES AC156 Test.




UUT-3

# UNIT UNDER TEST (UUT) SUMMARY SHEET



**Mounting Details:** Rigid wall mounted with 3 - M8 Grade 8.8 bolts

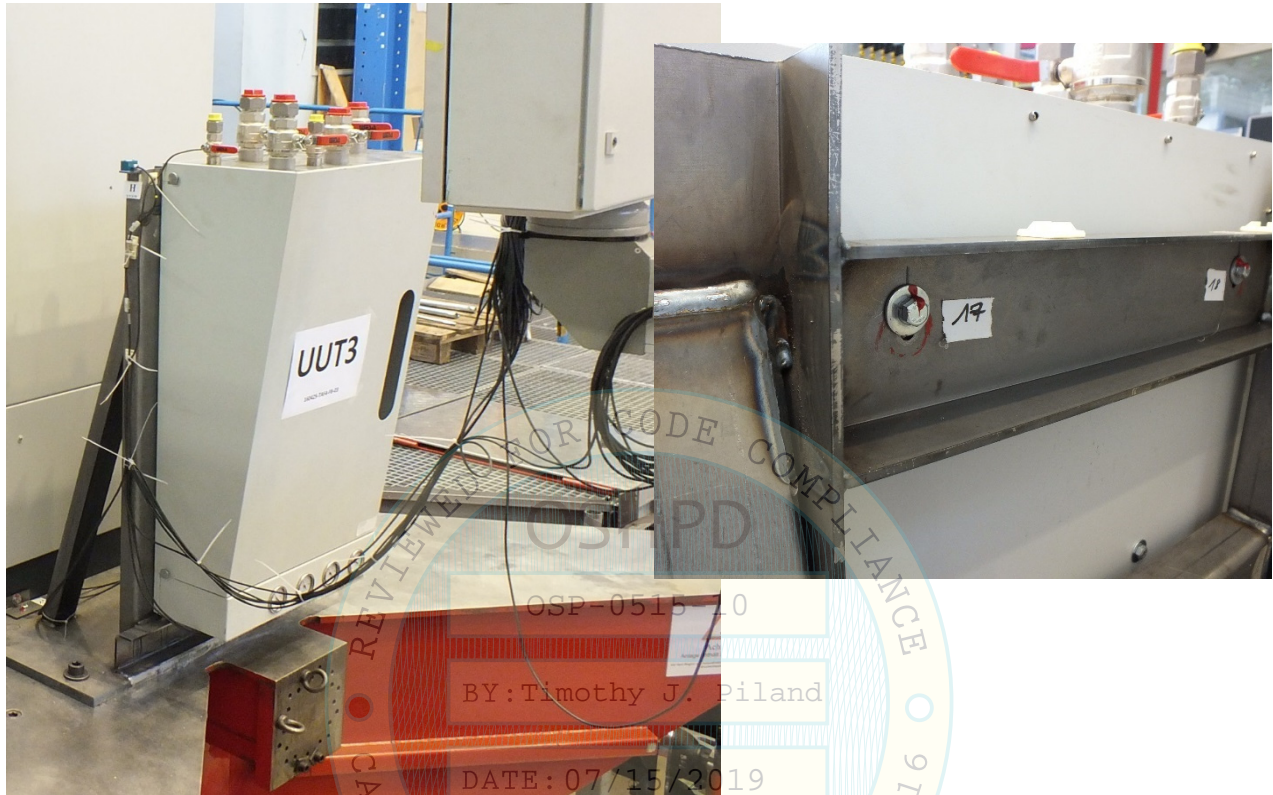

**Manufacturer:** KKT Chillers - AIT Deutschland GmbH

**Component:** Chiller Interface Panel (CIP)

**SAP Number:** 909000.0072

**UUT Function:** Serves as interface between connecting fluid lines and chiller

**UUT Description:** Component of KKT Chiller configurations. Contains pressure gauges, manual shut off valve, flow meter, and thermometer.

**Test Location:** IABG mbH, Germany

**Test Date:** April 2016

## UUT PROPERTIES

Weight (lb)	Dimensions (inches)			Natural Frequency (Hz)		
	Width	Depth	Height	FB	SS	V
120	43.3"	24.0"	13.6"	NA	NA	NA

## SEISMIC TEST PARAMETERS

Building Code / Test Criteria	$S_{DS}$ (g)	$z/h$	$I_p$	$A_{FLX-H}$ (g)	$A_{RIG-H}$ (g)	$A_{FLX-V}$ (g)	$A_{RIG-V}$ (g)
CBC 2016 / ICC-ES AC156	2.00	1.0	1.5	3.20	2.40		
	2.50	0.0	1.5			1.67	0.67

Note: The unit was full of contents during testing and remained functional before and after the ICC-ES AC156 test. The unit maintained structural integrity during and after the ICC-ES AC156 Test.

**UUT-4**

# UNIT UNDER TEST (UUT) SUMMARY SHEET



**Mounting Details:** Rigid wall mounted with 4 - M8 Grade 8.8 bolts



**Manufacturer:** KKT Chillers - AIT Deutschland GmbH

**Component:** Remote Control Panel (RCP)

**SAP Number:** 909000.0071

**UUT Function:** Remotely controls the KKT Compact Chillers

**UUT Description:** Remote control unit for KKT Compact Chiller configurations

**Test Location:** IABG mbH, Germany

**Test Date:** April 2016

## UUT PROPERTIES

Weight (lb)	Dimensions (inches)			Natural Frequency (Hz)		
	Width	Depth	Height	FB	SS	V
11	11.8"	12.0"	4.7"	NA	NA	NA

## SEISMIC TEST PARAMETERS

Building Code / Test Criteria	$S_{DS}$ (g)	$z/h$	$I_p$	$A_{FLX-H}$ (g)	$A_{RIG-H}$ (g)	$A_{FLX-V}$ (g)	$A_{RIG-V}$ (g)
CBC 2016 / ICC-ES AC156	2.00	1.0	1.5	3.20	2.40		
	2.50	0.0	1.5			1.67	0.67

Note: The unit was full of contents during testing and remained functional before and after the ICC-ES AC156 test. The unit maintained structural integrity during and after the ICC-ES AC156 Test.