



OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION

APPLICATION FOR OSHPD SPECIAL SEISMIC  
CERTIFICATION PREAPPROVAL (OSP)

OFFICE USE ONLY

APPLICATION #: OSP – 0338

OSHPD Special Seismic Certification Preapproval (OSP)

Type: ☐ New ☒ Renewal

Manufacturer Information

Manufacturer: Eaton

Manufacturer's Technical Representative: Art Jur

Mailing Address: 3990 Old Tasso Road NE, Cleveland, TN 37312

Telephone: 423-478-0201

Email: ArtJJur@eaton.com

Product Information

Product Name: Enclosed Circuit Breakers

Product Type: Enclosed Circuit Breakers

Product Model Number: See Product Range Summary

(List all unique product identification numbers and/or part numbers)

General Description: Enclosed molded case circuit breakers, 100-1200A, 600 Vac maximum. NEMA type 1, 3R, 4X and 12 enclosures.

Mounting Description: Rigid wall mounted.

Applicant Information

Applicant Company Name: Eaton

Contact Person: Eddie Wilkie

Mailing Address: 175 Vista Blvd, Arden, NC 28704

Telephone: 828-651-0707

Email: eddiwilkie@eaton.com


I hereby agree to reimburse the Office of Statewide Health Planning and Development review fees in accordance with the California Administrative Code, 2016.

Signature of Applicant: Eddie Wilkie

Date: 11/21/19

Title: Director of Engineering

Company Name: Eaton





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**California Licensed Structural Engineer Responsible for the Engineering and Test Report(s)**

Company Name: ISAT  
Name: William V. Joerger California License Number: SE 4545  
Mailing Address: 1020 Crews Road, Quite Q, Matthews, NC 28105  
Telephone: 510-714-0216 Email: wvjoerger@isatsb.com

**Supports and Attachments Preapproval**


- ☐ Supports and attachments are preapproved under OPM- \_\_\_\_\_  
(Separate application for OSHPD Preapproval of Manufacturer's Certification (OPM) of Supports and attachments is required)
- ☒ Supports and attachments are not preapproved

**Certification Method**

- ☒ Testing in accordance with: ☒ ICC-ES AC156
- ☐ Other (Please Specify): \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**Testing Laboratory**

Company Name: NTS Laboratories DATE: 04/04/2021  
Contact Name: Tom Boonarkat  
Mailing Address: P.O. Box 77777, Huntsville, AL 35807  
Telephone: 256-716-4291 Email: Tom.Boonarkat@nts.com





**OFFICE OF STATEWIDE HEALTH PLANNING AND DEVELOPMENT  
FACILITIES DEVELOPMENT DIVISION**

**Seismic Parameters**

Design in accordance with ASCE 7-10 Chapter 13: ☒ Yes ☐ No

Design Basis of Equipment or Components ( $F_p/W_p$ ) = 2.63

$S_{DS}$  (Design spectral response acceleration at short period, g) = 3.51

$a_p$  (In-structure equipment or component amplification factor) = 2.5

$R_p$  (Equipment or component response modification factor) = 6.0

$\Omega_0$  (System overstrength factor) = 2.0

$I_p$  (Importance factor) = 1.5

$z/h$  (Height factor ratio) = 1

Equipment or Component Natural Frequencies (Hz) = N/A, wall mounted.

Overall dimensions and weight (or range thereof) = See Product Range Summary

Equipment or Components @ grade designed in accordance with ASCE 7-10 Chapter 15: ☐ Yes ☒ No

Design Basis of Equipment or Components ( $V/W$ ) = \_\_\_\_\_

$S_{DS}$  (Design spectral response acceleration at short period, g) = \_\_\_\_\_

$S_{D1}$  (Design spectral response acceleration at 1 second period, g) = \_\_\_\_\_

$R$  (Response modification coefficient) = \_\_\_\_\_

$\Omega_0$  (System overstrength factor) = \_\_\_\_\_

$C_d$  (Deflection amplification factor) = \_\_\_\_\_

$I_p$  (Importance factor) = 1.5

Height to Center of Gravity above base = \_\_\_\_\_

Equipment or Component Natural Frequencies (Hz) = \_\_\_\_\_

Overall dimensions and weight (or range thereof) = \_\_\_\_\_

Tank(s) designed in accordance with ASME BPVC, 2015: ☐ Yes ☒ No

**List of Attachments Supporting Special Seismic Certification**

☒ Test Report(s) ☒ Drawings ☐ Calculations ☐ Manufacturer's Catalog

☐ Other(s) (Please Specify): \_\_\_\_\_

**OSHPD Approval (For Office Use Only) – Approval Expires on December 31, 2025**

Signature: William Staehlin

Date: April 4, 2021

Print Name: William Staehlin

Title: Senior Structural Engineer

Special Seismic Certification Valid Up to:  $S_{DS}$  (g) = 3.51  $z/h$  = 1

Condition of Approval (if applicable): \_\_\_\_\_

**Certified Product Range Summary**  
**Enclosed Circuit Breakers<sup>a</sup>**


Model	NEMA Enclosure Type	Breaker Frame	Maximum Current (Amperes)	Enclosure Dimensions (in.)			Weight (lbs.)	S <sub>DS</sub> (g)	Unit Tested
				Width	Depth	Height			
SFDN100	1 <sup>b</sup>	F	100	9.13	5.2	19.13	13	3.51	Extrapolated
SGDN100	1 <sup>b</sup>	G	100	8.56	6.28	17.5	12	3.51	Extrapolated
SFD100E	1 <sup>b</sup>	F (ELCB)	100	8.56	6.28	23.25	15	3.51	Extrapolated
FFDN100	1 <sup>b</sup>	F	100	9.72	6.28	18.81	12	3.51	Extrapolated
FFD100E	1 <sup>b</sup>	F (ELCB)	100	9.72	6.28	24.56	15	3.51	Extrapolated
WGDN100	4X <sup>c</sup>	G	100	8.84	9.31	19.91	16	3.51	Extrapolated
WFDN100	4X <sup>c</sup>	F	100	8.84	9.31	19.91	16	3.51	Extrapolated
WFDN100E	4X <sup>c</sup>	F (ELCB)	100	8.84	9.31	19.91	20	3.51	Extrapolated
JGDN100	12 <sup>b</sup>	G	100	9.16	9.31	19.91	16	3.51	Extrapolated
JFDN100	12 <sup>b</sup>	F	100	9.16	9.31	19.91	16	3.51	Extrapolated
JFDN100E	12 <sup>b</sup>	F (ELCB)	100	9.16	9.31	19.91	19	3.51	Extrapolated
RGDN100	3R <sup>b</sup>	G	100	9.16	9.31	19.91	16	3.51	Extrapolated
RFDN100	3R <sup>b</sup>	F	100	9.16	9.31	25.66	19	3.51	Extrapolated
RFDN100E	3R <sup>b</sup>	F (ELCB)	100	9.19	9.31	19.91	19	3.51	Extrapolated
SFDN225	1 <sup>b</sup>	F	225	8.56	6.28	23.25	15	3.51	Extrapolated
FFDN225	1 <sup>b</sup>	F	225	9.72	6.28	24.56	15	3.51	Extrapolated
WFDN225	4X <sup>c</sup>	F	225	8.84	9.31	25.66	20	3.51	Extrapolated
JFDN225	12 <sup>b</sup>	F	225	9.16	9.31	25.66	19	3.51	Extrapolated
RFDN225	3R <sup>b</sup>	F	225	9.16	9.31	25.66	19	3.51	Extrapolated
SJDN250	1 <sup>b</sup>	J	250	10.92	7.2	34.7	31	3.51	Extrapolated
FJDN250	1 <sup>b</sup>	J	250	12.23	7.2	36.02	32	3.51	Extrapolated
WJDN250	4X <sup>c</sup>	J	250	11.56	10.22	37.5	39	3.51	Extrapolated
RJDN250	3R <sup>b</sup>	J	250	11.88	10.22	37.5	37	3.51	Extrapolated
JJDN250	12 <sup>b</sup>	J	250	11.88	10.22	37.53	37	3.51	Extrapolated
SKDN400	1 <sup>b</sup>	K	400	11.06	10.94	38.81	53	3.51	Extrapolated
FKDN400	1 <sup>b</sup>	K	400	12.38	10.94	40.13	53	3.51	Extrapolated
WKDN400	4X <sup>c</sup>	K	400	12.38	14.06	41.69	74	3.51	UUT 1
JKDN400	12 <sup>b</sup>	K	400	12.31	14.06	41.69	58	3.51	Interpolated
RKDN400	3R <sup>b</sup>	K	400	12.31	14.06	41.69	58	3.51	Interpolated
SLG630E	1 <sup>b</sup>	LG (ELCB)	600	21.87	9.96	51.06	90	3.51	Interpolated
SLG630	1 <sup>b</sup>	LG	600	21.88	10	53.75	108	3.51	UUT 3
SLDN600	1	L	600	14.31	12.38	45.88	81	3.51	Interpolated
JLG630	12 <sup>b</sup>	LG	600	23.06	14.1	53.37	94	3.51	Interpolated
JLG630	12 <sup>b</sup>	LG (ELCB)	600	23.06	14.1	53.37	94	3.51	Interpolated
RLG630	3R <sup>b</sup>	LG	600	23.06	14.1	53.37	94	3.51	Interpolated
RLG630	3R <sup>b</sup>	LG (ELCB)	600	23.06	14.1	53.37	94	3.51	Interpolated
WLG630	4X <sup>c</sup>	LG	600	23.06	14.11	53.38	96	3.51	Interpolated
WLDN600	4X <sup>c</sup>	L	600	14.91	15.5	48.31	88	3.51	Interpolated
JLDN600	12 <sup>b</sup>	L	600	15.56	15.5	48.31	84	3.51	Interpolated
RLDN600	3R <sup>b</sup>	L	600	15.56	15.5	48.31	84	3.51	Interpolated
SNDN1200	1 <sup>b</sup>	M,N	1200	21.44	15.41	61.22	178	3.51	Interpolated
JNDN1200	12 <sup>b</sup>	M,N	1200	22.63	17.62	63.59	175	3.51	Interpolated
RNDN1200	3R <sup>b</sup>	M,N	1200	22.62	17.62	63.75	240	3.51	UUT 2

- a. Manufactured by Eaton.  
b. Enclosure made from carbon steel.  
c. Enclosure made from stainless steel.

**Certified Component Summary**  
**Molded Case Circuit Breakers (MCCB)**

Molded Case Circuit Breakers (MCCB) 1 - 3 Poles (3 Pole Data Shown)										
Frame	Model	Trip Type (TM, E, NT)*	Size (Amperes)	Voltage	Dimensions / Weights				Manufacturer	Unit
					Width (in.)	Depth (in.)	Height (in.)	Weight (lbs.)		
G		TM	100	480	3	2.63	4	1.37	Eaton	Extrapolated
F		TM, E	225	600	4.13	3.38	6	4.5	Eaton	Extrapolated
F w/ EL Module		TM, E	225	600	4.13	3.96	12.06	8.5	Eaton	Extrapolated
J		TM, E	250	600	4.13	4.06	10	13.5	Eaton	Extrapolated
K		TM, E	400	600	5.49	4.31	10.13	11.5	Eaton	Extrapolated
K	HKD3400F	TM	400	600	5.49	4.31	10.13	11.5	Eaton	UUT 1
LG		TM, E, NT	600	600	7.22	4.09	10.13	20	Eaton	Interpolated
LG	LGE3630NN	NT	600	600	7.22	4.09	10.13	20	Eaton	UUT 3
LG W/ EL Module		TM, E, NT	600	600	7.22	5.43	15.38	27	Eaton	Interpolated
L		TM, E, NT	600	600	8.25	3.81	10.75	25	Eaton	Interpolated
M		TM, E, NT	800	600	8.25	4.06	16	30	Eaton	Interpolated
N		TM, E, NT	1200	600	8.25	5.5	16	45	Eaton	Interpolated
N	NG31000WX04Y02	E	1200	600	8.25	5.5	16	45	Eaton	UUT 2

\* - "TM" = Thermal Magnetic, "E" = Electronic, "NT" = No Trip

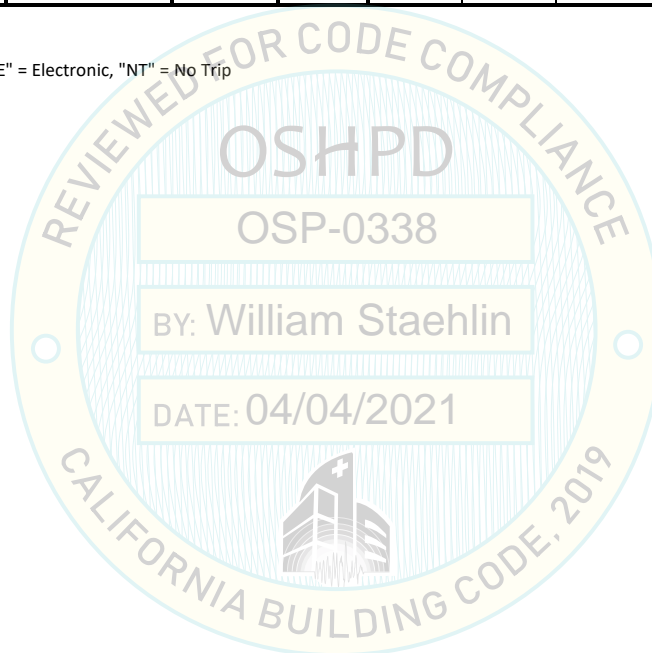

## Certified Enclosure Summary Enclosed Circuit Breakers

NEMA Enclosure Type	Dimensions (in.)			Manufacturer	Tested in Unit	Notes
	Width	Depth	Height			
1 (Surface Type)	8.56	6.28	17.5	Eaton	Extrapolated	1
1 (Flush Type)	9.72	6.28	18.81	Eaton	Extrapolated	1
1 (Surface Type)	9.13	5.2	19.13	Eaton	Extrapolated	1
4X	8.84	9.31	19.91	Eaton	Extrapolated	2
3R/12	9.16	9.31	19.91	Eaton	Extrapolated	1,3
3R	9.19	9.31	19.91	Eaton	Extrapolated	1,3
1 (Surface Type)	8.56	6.28	23.25	Eaton	Extrapolated	1
1 (Flush Type)	9.72	6.28	24.56	Eaton	Extrapolated	1
4X	8.84	9.31	25.66	Eaton	Extrapolated	2
3R/12	9.16	9.31	25.66	Eaton	Extrapolated	1,3
1 (Surface Type)	10.92	7.2	34.7	Eaton	Extrapolated	1
1 (Flush Type)	12.23	7.2	36.02	Eaton	Extrapolated	1
4X	11.56	10.22	37.5	Eaton	Interpolated	2
3R/12	11.88	10.22	37.53	Eaton	Extrapolated	1,3
1 (Surface Type)	11.06	10.94	38.81	Eaton	Extrapolated	1
1 (Flush Type)	12.38	10.94	40.13	Eaton	Extrapolated	1
4X	11.75	14.06	41.69	Eaton	Extrapolated	2
4X	12.38	14.06	41.69	Eaton	UUT 1	2
1 (Surface Type)	14.31	12.38	45.88	Eaton	Interpolated	1
4X	14.91	15.5	48.31	Eaton	Interpolated	2
3R/12	15.56	15.5	48.31	Eaton	Interpolated	1,3
3R/12	23.06	14.1	53.37	Eaton	Interpolated	1,3
4X	23.06	14.11	53.38	Eaton	Interpolated	2
1 (Surface Type)	21.88	10	53.75	Eaton	UUT3	1
1 (Surface Type)	21.44	15.41	61.22	Eaton	Interpolated	1
3R/12	22.62	17.62	63.75	Eaton	UUT 2	1,3

**Notes:**

1. Enclosure made carbon steel.
2. Enclosure made from AISI 304 stainless steel.
3. NEMA 3R includes rain shield and gasket material for door. NEMA 12 includes gasket material for seams.



## UUT 1 (Unit Under Test) Summary Sheet

**Manufacturer:** Eaton Corporation

**Product Line:** Enclosed Circuit Breaker

**Model Number:** WKDN400

**Product Construction Summary:** Cabinet is constructed of AISI 304 stainless steel, NEMA Type 4X enclosure rating.

**Options/Component Summary:** Molded Case Breaker K Frame 400A (HKD3400F)

### UUT Properties (As Tested)

Weight (lbs.)	Dimensions (inches)			Lowest Natural Frequency (Hz)		
	Width	Depth	Height	Front-Back	Side-Side	Vertical
74	12.38	14.06	41.69	N/A	N/A	N/A

### Seismic Test Parameters

Building Code	Test Criteria	C.G. Height (in.)	Sds	z/h	Ip	Aflx-H	Arig-H	Aflx-V	Arig-V
CBC 2019	ICC-ES AC156	N/A	3.51	1	1.5	5.62	4.21	2.35	0.95

UUT maintained structural integrity and functionality as confirmed in post test inspection and operation checks.



UUT 1 was mounted to a rigid wall frame using (6) 5/16 bolts. The wall frame was welded to the shake table.

## UUT 2 (Unit Under Test) Summary Sheet

**Manufacturer:** Eaton Corporation

**Product Line:** Enclosed Circuit Breaker

**Model Number:** RNDN1200

**Product Construction Summary:** Cabinet is constructed of powder-coated carbon steel, NEMA Type 3R enclosure rating.

**Options/Component Summary:** Molded Case Breaker N Frame 1200A (NG31000WX04Y02)

### UUT Properties (As Tested)

Weight (lbs.)	Dimensions (inches)			Lowest Natural Frequency (Hz)		
	Width	Depth	Height	Front-Back	Side-Side	Vertical
240	22.62	17.62	63.75	N/A	N/A	N/A

### Seismic Test Parameters

Building Code	Test Criteria	C.G. Height (in.)	Sds	z/h	Ip	Aflx-H	Arig-H	Aflx-V	Arig-V
CBC 2019	ICC-ES AC156	N/A	3.51	1	1.5	5.62	4.21	2.35	0.95

UUT maintained structural integrity and functionality as confirmed in post test inspection and operation checks.



UUT 2 was mounted to a rigid wall frame using (6) 5/16 bolts. The wall frame was welded to the shake table.



### UUT 3 (Unit Under Test) Summary Sheet

**Manufacturer:** Eaton Corporation

**Product Line:** Enclosed Circuit Breaker

**Model Number:** SLG630

**Product Construction Summary:** Cabinet is constructed of powder-coated carbon steel, NEMA Type 1 enclosure rating.

**Options/Component Summary:** Molded Case Breaker L Frame 600A (LGE3630NN)


#### UUT Properties (As Tested)

Weight (lbs.)	Dimensions (inches)			Lowest Natural Frequency (Hz)		
	Width	Depth	Height	Front-Back	Side-Side	Vertical
108	21.88	10	53.75	N/A	N/A	N/A

#### Seismic Test Parameters

Building Code	Test Criteria	C.G. Height (in.)	Sds	z/h	Ip	Aflx-H	Arig-H	Aflx-V	Arig-V
CBC 2019	ICC-ES AC156	N/A	3.51	1	1.5	5.62	4.21	2.35	0.95

UUT maintained structural integrity and functionality as confirmed in post test inspection and operation checks.

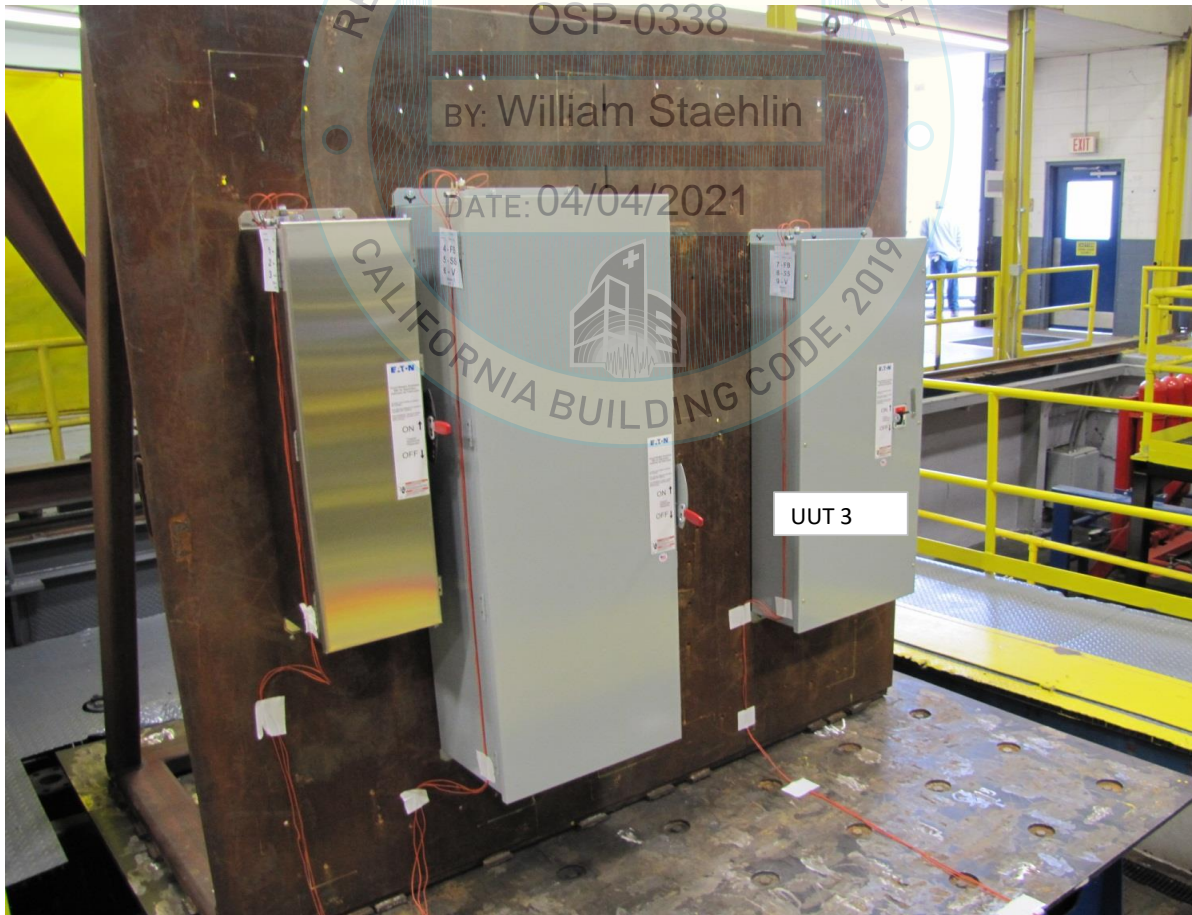

UUT 3 was mounted to a rigid wall frame using (6) 5/16 bolts. The wall frame was welded to the shake table.